


val/mse\_reconstruction

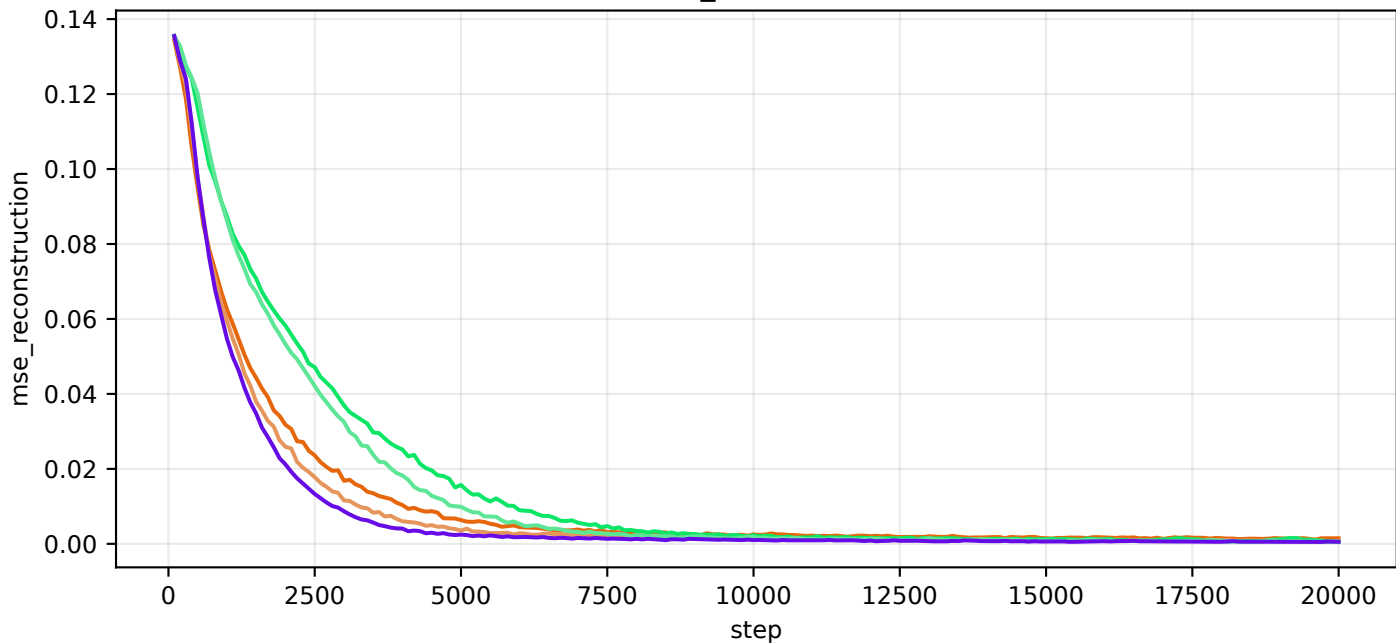

| run                                                  | min       | max    | end       | step  |
|------------------------------------------------------|-----------|--------|-----------|-------|
| <div></div> bpae_group1/mask00p_5000.0100.2000_r00   | 0.001113  | 0.1344 | 0.001485  | 19999 |
| <div></div> bpae_group1/mask00p_5000.0200.2000_r00   | 0.0006994 | 0.1353 | 0.0007975 | 19999 |
| <div></div> bpae_group2/mask00p_5000.0400.0064_r00   | 0.0005563 | 0.1355 | 0.0005563 | 19999 |
| <div></div> bpae_group2/mask00p_5000.0400.0128_r00   | 0.0004955 | 0.1355 | 0.000576  | 19999 |
| <div></div> bpae_baseline/mask00p_5000.0400.2000_r00 | 0.0004835 | 0.1355 | 0.0005584 | 19999 |