


val/mse_reconstruction

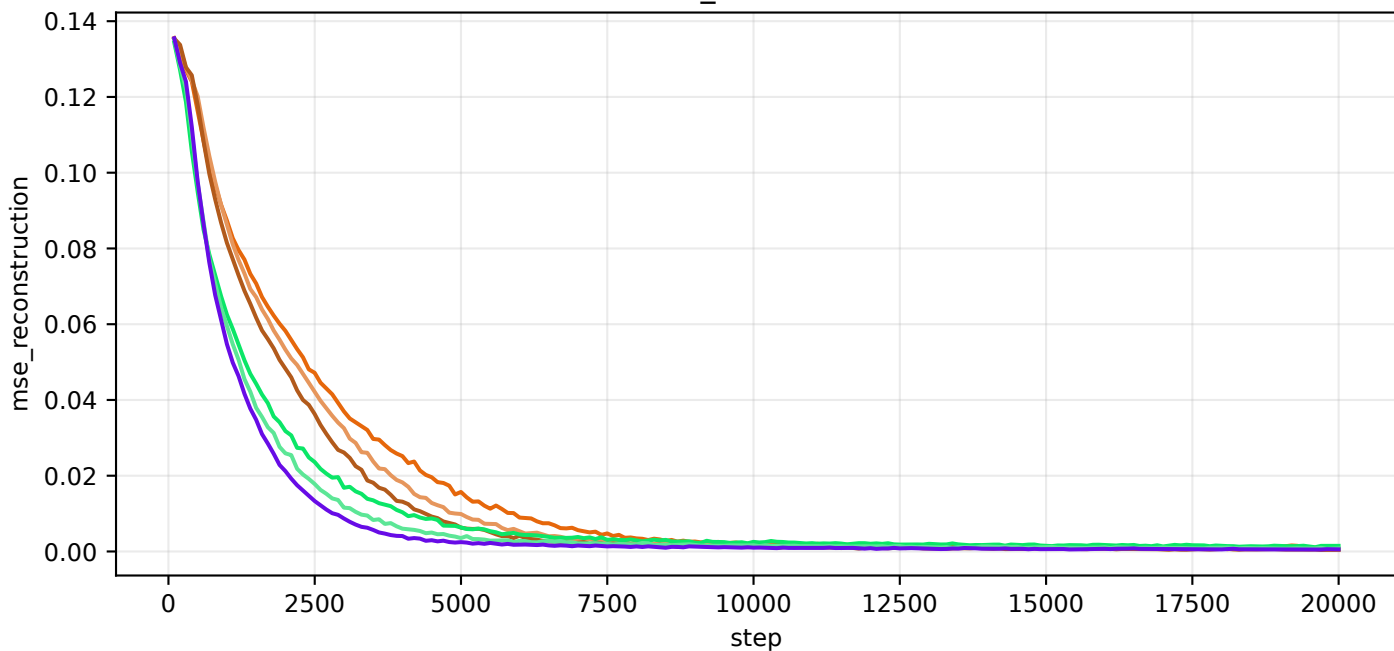

run	min	max	end	step
bpae_group1/mask00p_5000.0400.0064_r00	0.0005563	0.1355	0.0005563	19999
bpae_group1/mask00p_5000.0400.0128_r00	0.0004955	0.1355	0.000576	19999
bpae_group1/mask00p_5000.0400.0250_r00	0.0004105	0.1354	0.0004452	19999
bpae_group2/mask00p_5000.0100.2000_r00	0.001113	0.1344	0.001485	19999
bpae_group2/mask00p_5000.0200.2000_r00	0.0006994	0.1353	0.0007975	19999
bpae_training/mask00p_5000.0400.2000_r00	0.0004835	0.1355	0.0005584	19999