


val/mse_reconstruction

**run**

bpae_baseline/mask00p_5000.0400.2000_r00

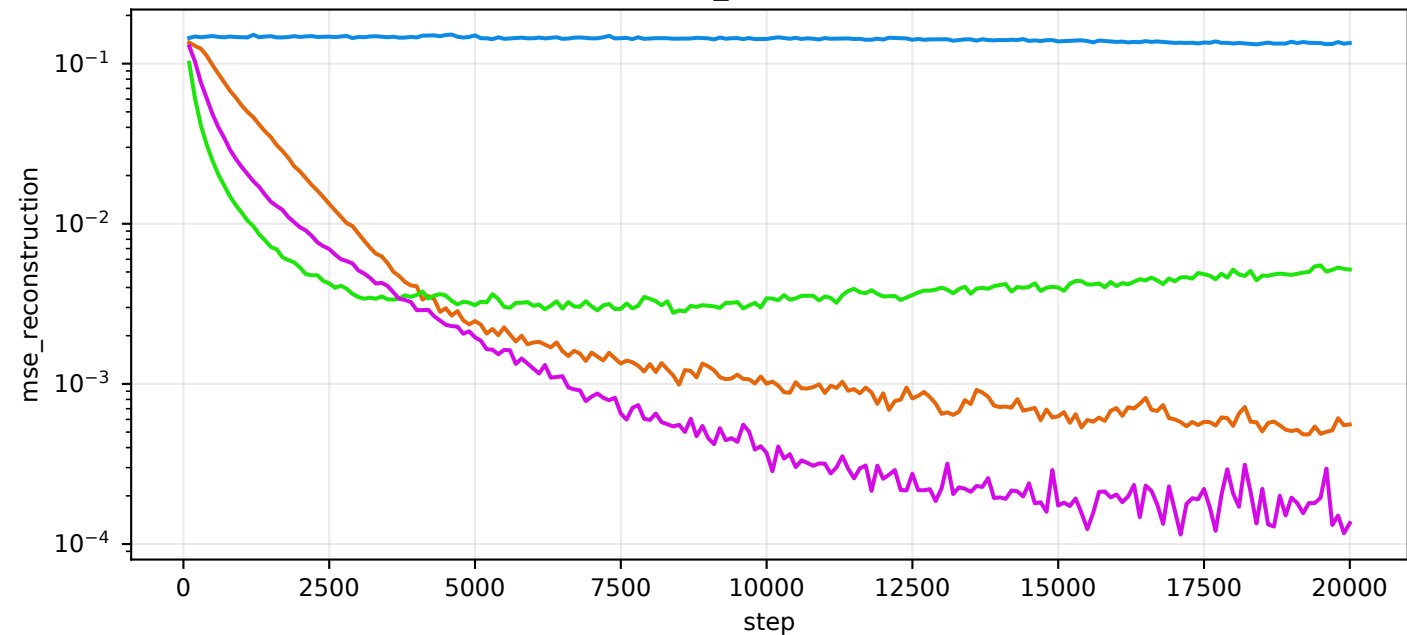

dfaae_training/mask00p_5000.0400.2000_r00



drtpae_training/mask00p_5000.0400.2000_r00



hytaae_training/mask00p_5000.0400.2000_s20

min**max****end****step**

0.0004835

0.1355

0.0005584

19999

0.002775

0.1011

0.005175

19999

0.1319

0.1519

0.1345

19999

0.0001146

0.1286

0.000135

19999