


val/mse_reconstruction

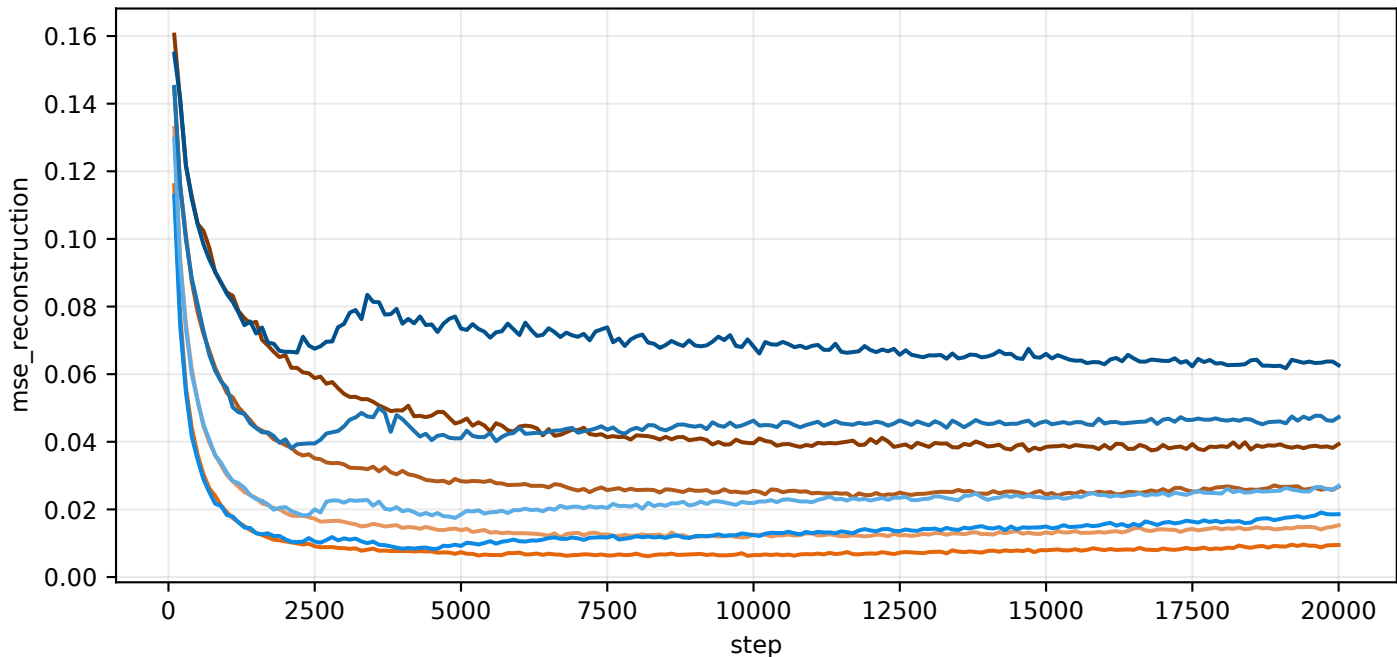

run	min	max	end	step
 dfaae_group1/mask50p_5000.0400.2000_r00	0.006163	0.1159	0.009498	19999
 dfaae_group1/mask75p_5000.0400.2000_r00	0.01171	0.1328	0.0153	19999
 dfaae_group1/mask90p_5000.0400.2000_r00	0.02357	0.1446	0.02675	19999
 dfaae_group1/mask95p_5000.0400.2000_r00	0.0373	0.1604	0.03932	19999
 dfaae_group2/mask50p_5000.0400.2000_r01	0.00834	0.1128	0.01858	19999
 dfaae_group2/mask75p_5000.0400.2000_r01	0.01747	0.1297	0.02696	19999
 dfaae_group2/mask90p_5000.0400.2000_r01	0.03805	0.145	0.04728	19999
 dfaae_group2/mask95p_5000.0400.2000_r01	0.06174	0.1548	0.06262	19999