


train/latent_post_active_rate

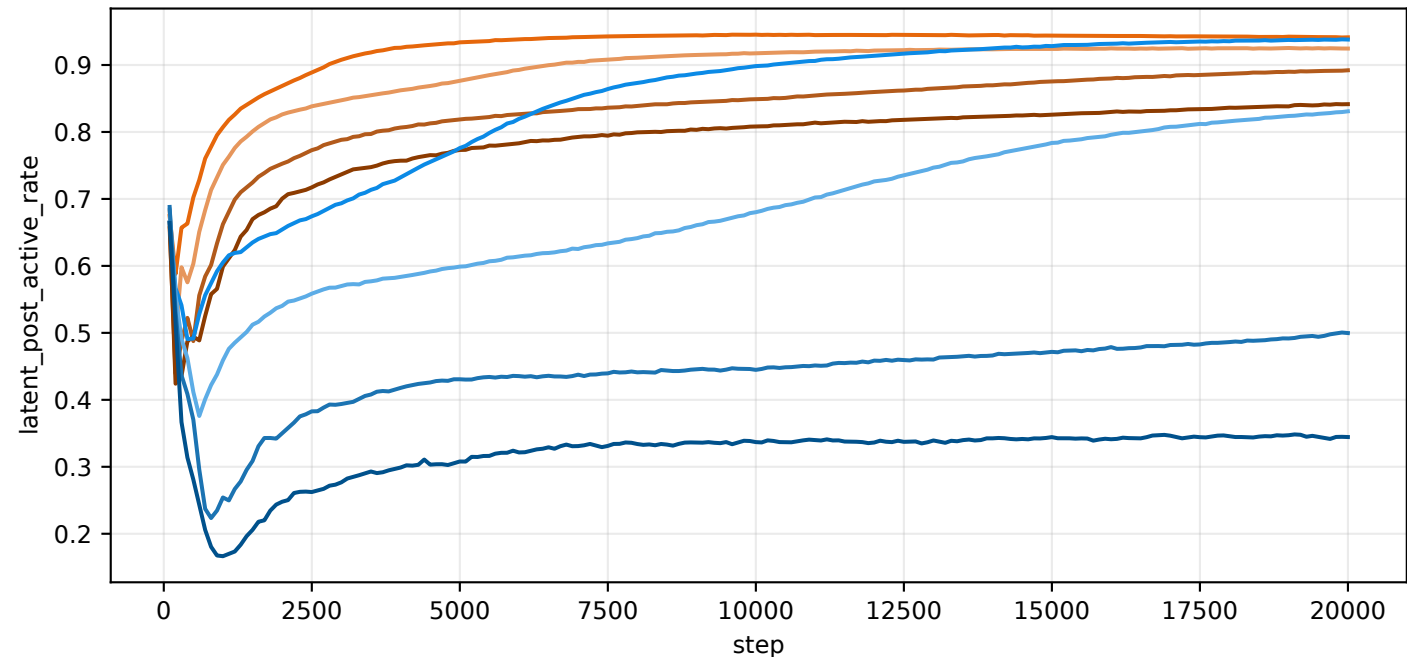

run

min

max

end

step

bpae_group1/mask50p_5000.0400.2000_r00

0.588

0.9454

0.9413

19999

bpae_group1/mask75p_5000.0400.2000_r00

0.4963

0.9254

0.9246

19999

bpae_group1/mask90p_5000.0400.2000_r00

0.439

0.8921

0.8921

19999

bpae_group1/mask95p_5000.0400.2000_r00

0.4241

0.8416

0.8415

19999

bpae_group2/mask50p_5000.0400.0064_r00

0.4906

0.9383

0.938

19999

bpae_group2/mask75p_5000.0400.0064_r00

0.3759

0.8308

0.8308

19999

bpae_group2/mask90p_5000.0400.0064_r00

0.2235

0.688

0.4997

19999

bpae_group2/mask95p_5000.0400.0064_r00

0.1665

0.6641

0.3444

19999