


train/latent_post_hoyer

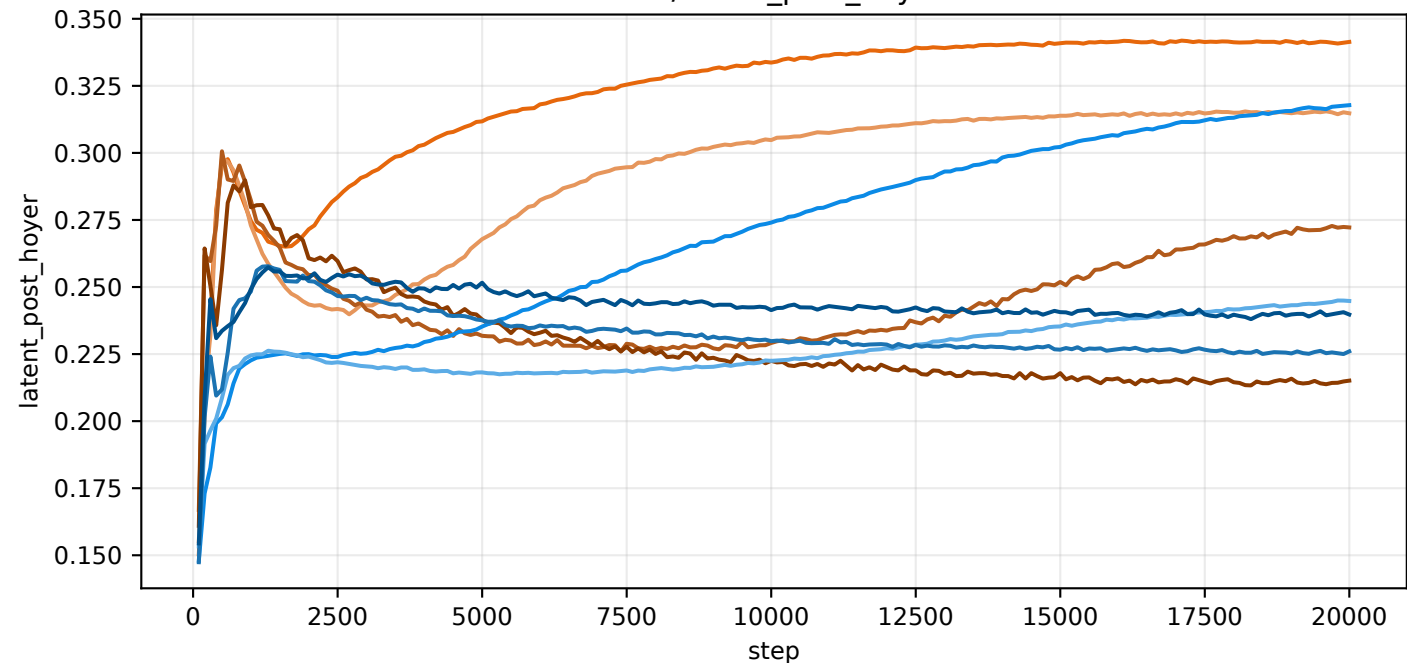

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.1504	0.3419	0.3414	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.1553	0.3155	0.3148	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.1669	0.3006	0.2722	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.161	0.2898	0.2151	19999
bpae_group2/mask50p_5000.0400.0064_r00	0.1479	0.3178	0.3178	19999
bpae_group2/mask75p_5000.0400.0064_r00	0.1533	0.245	0.2448	19999
bpae_group2/mask90p_5000.0400.0064_r00	0.1474	0.2578	0.226	19999
bpae_group2/mask95p_5000.0400.0064_r00	0.1544	0.2574	0.2397	19999