


train/mse_reconstruction_step

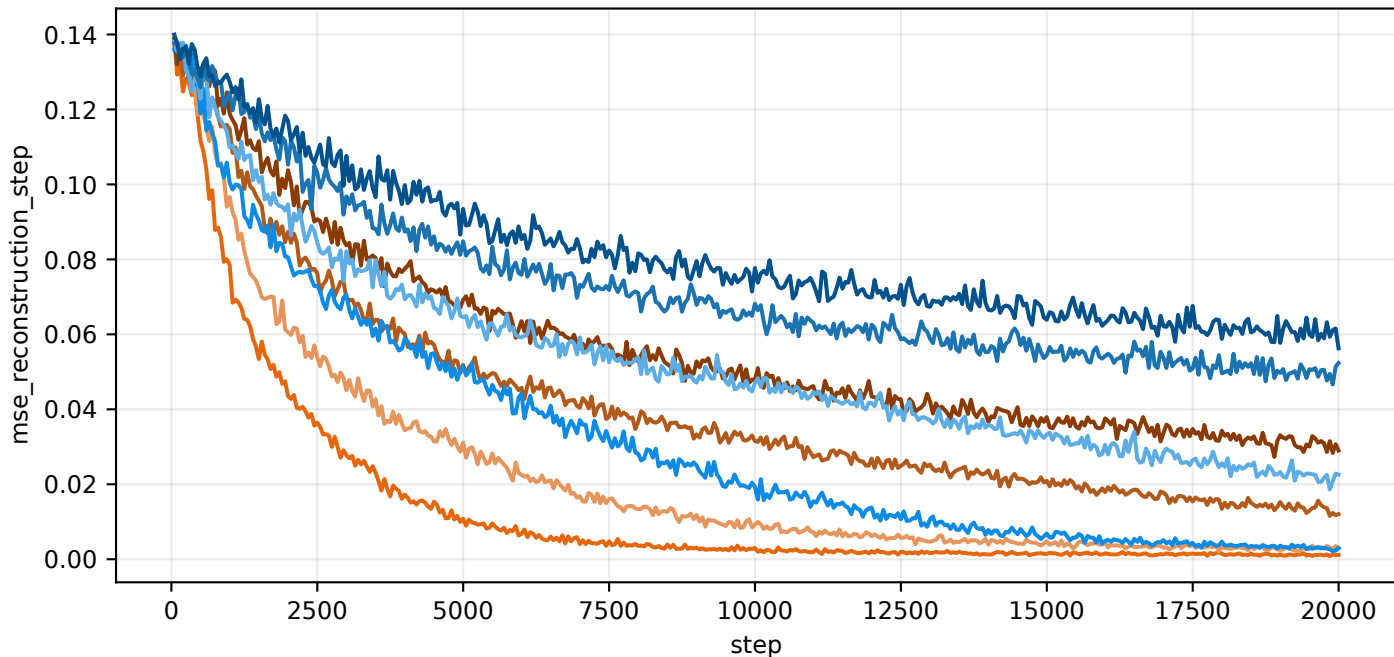

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.0008092	0.1387	0.001149	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.002039	0.1367	0.002963	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.01158	0.1386	0.01203	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.0273	0.1389	0.02899	19999
bpae_group2/mask50p_5000.0400.0064_r00	0.002192	0.1362	0.002969	19999
bpae_group2/mask75p_5000.0400.0064_r00	0.01862	0.1382	0.02258	19999
bpae_group2/mask90p_5000.0400.0064_r00	0.04663	0.1378	0.05235	19999
bpae_group2/mask95p_5000.0400.0064_r00	0.05626	0.14	0.05626	19999