


train/patterns_active_rate

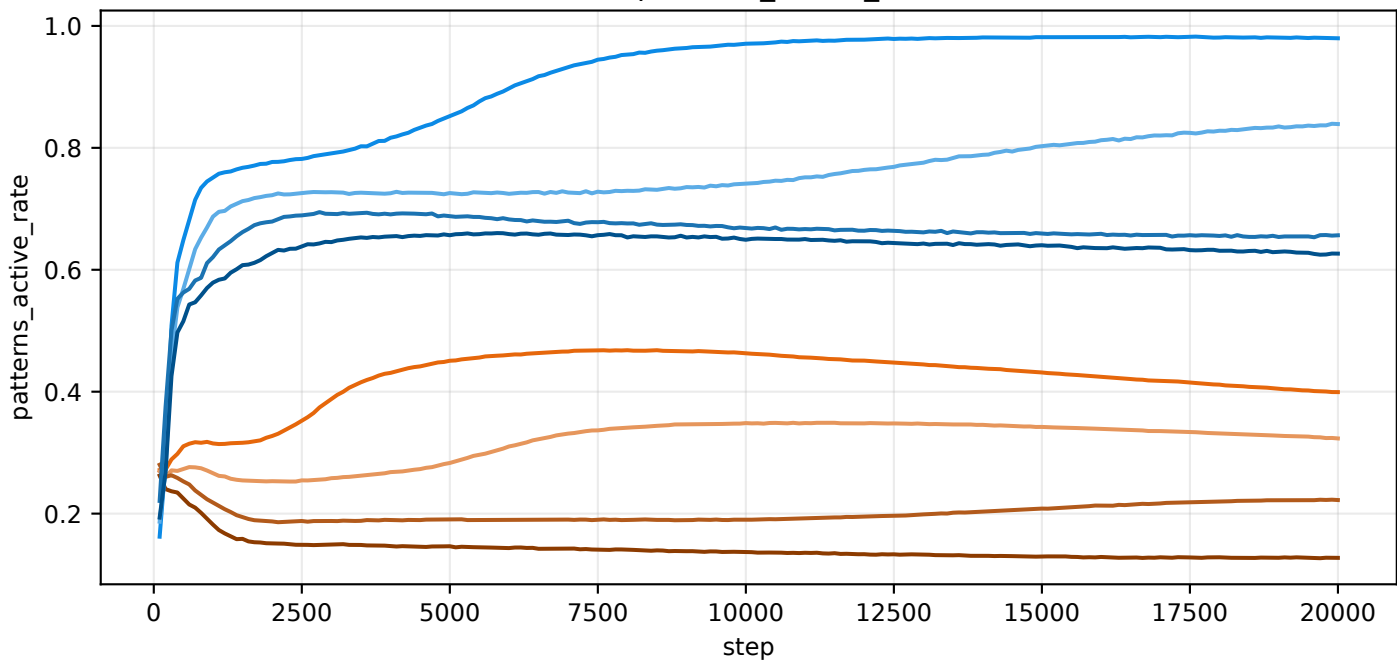

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.2713	0.4682	0.3993	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.2526	0.3494	0.3233	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.1859	0.2802	0.2223	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.1269	0.2624	0.1274	19999
bpae_group2/mask50p_5000.0400.0064_r00	0.1622	0.9825	0.9797	19999
bpae_group2/mask75p_5000.0400.0064_r00	0.1868	0.8395	0.839	19999
bpae_group2/mask90p_5000.0400.0064_r00	0.2208	0.6946	0.6566	19999
bpae_group2/mask95p_5000.0400.0064_r00	0.1935	0.6602	0.6265	19999