


val/mse_masked

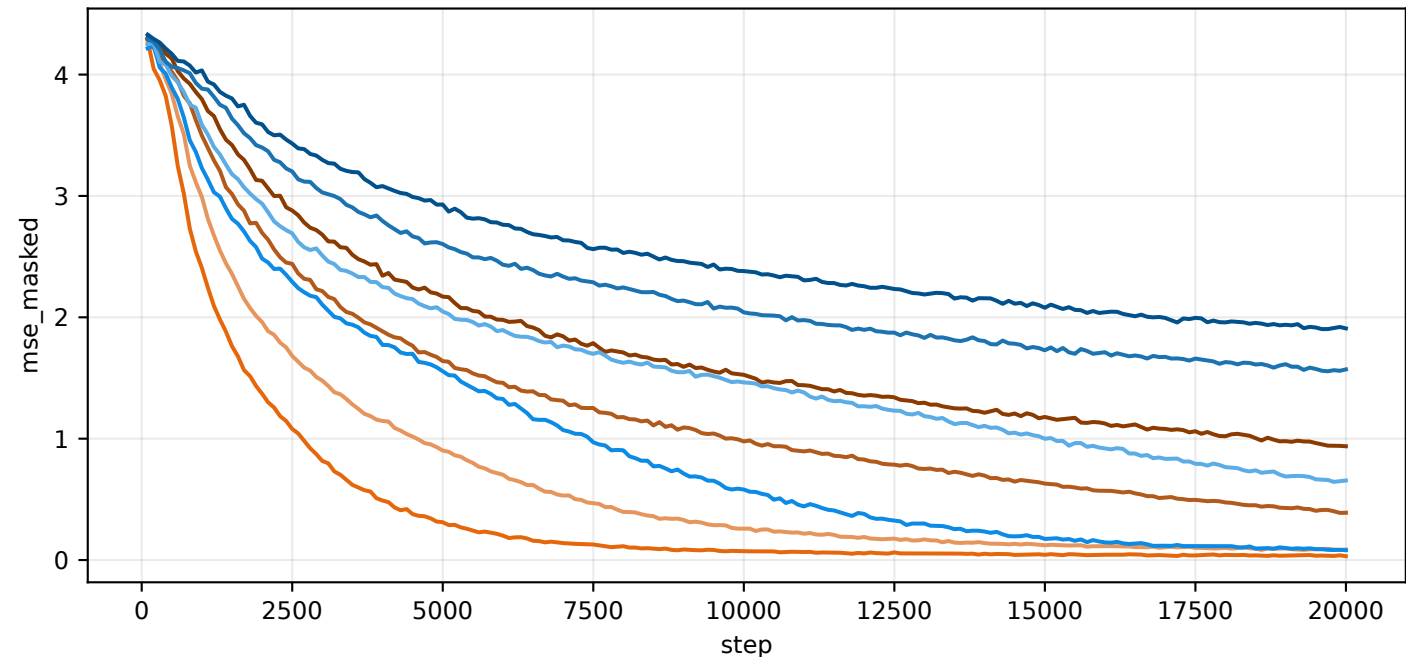

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.03163	4.281	0.03163	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.08346	4.249	0.0861	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.3884	4.293	0.3897	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.9377	4.307	0.9377	19999
bpae_group2/mask50p_5000.0400.0064_r00	0.08143	4.238	0.08143	19999
bpae_group2/mask75p_5000.0400.0064_r00	0.6439	4.257	0.6554	19999
bpae_group2/mask90p_5000.0400.0064_r00	1.555	4.292	1.571	19999
bpae_group2/mask95p_5000.0400.0064_r00	1.903	4.329	1.909	19999