


val/mse_reconstruction

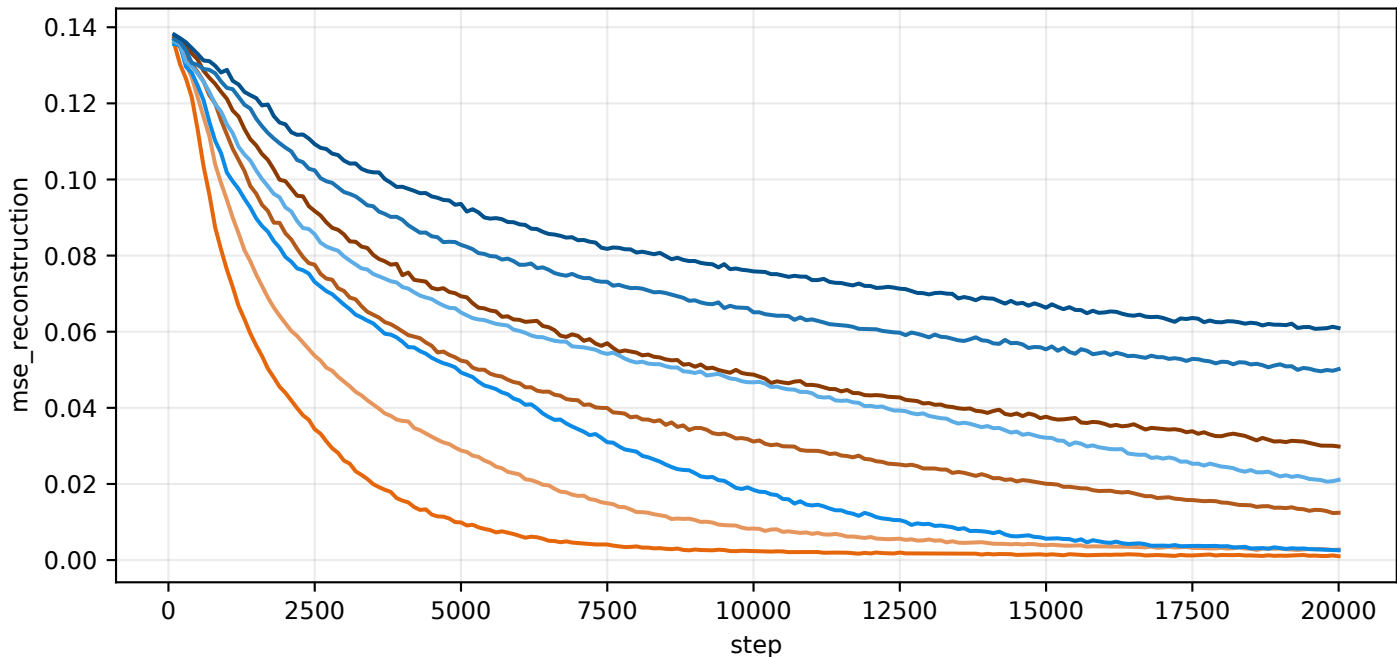

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.001019	0.1357	0.001019	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.002657	0.136	0.002754	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.01236	0.1367	0.01242	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.02985	0.1375	0.02985	19999
bpae_group2/mask50p_5000.0400.0064_r00	0.002578	0.1356	0.002578	19999
bpae_group2/mask75p_5000.0400.0064_r00	0.0206	0.1363	0.02107	19999
bpae_group2/mask90p_5000.0400.0064_r00	0.04961	0.1368	0.05018	19999
bpae_group2/mask95p_5000.0400.0064_r00	0.06075	0.1381	0.06097	19999