


val/patterns_active_rate

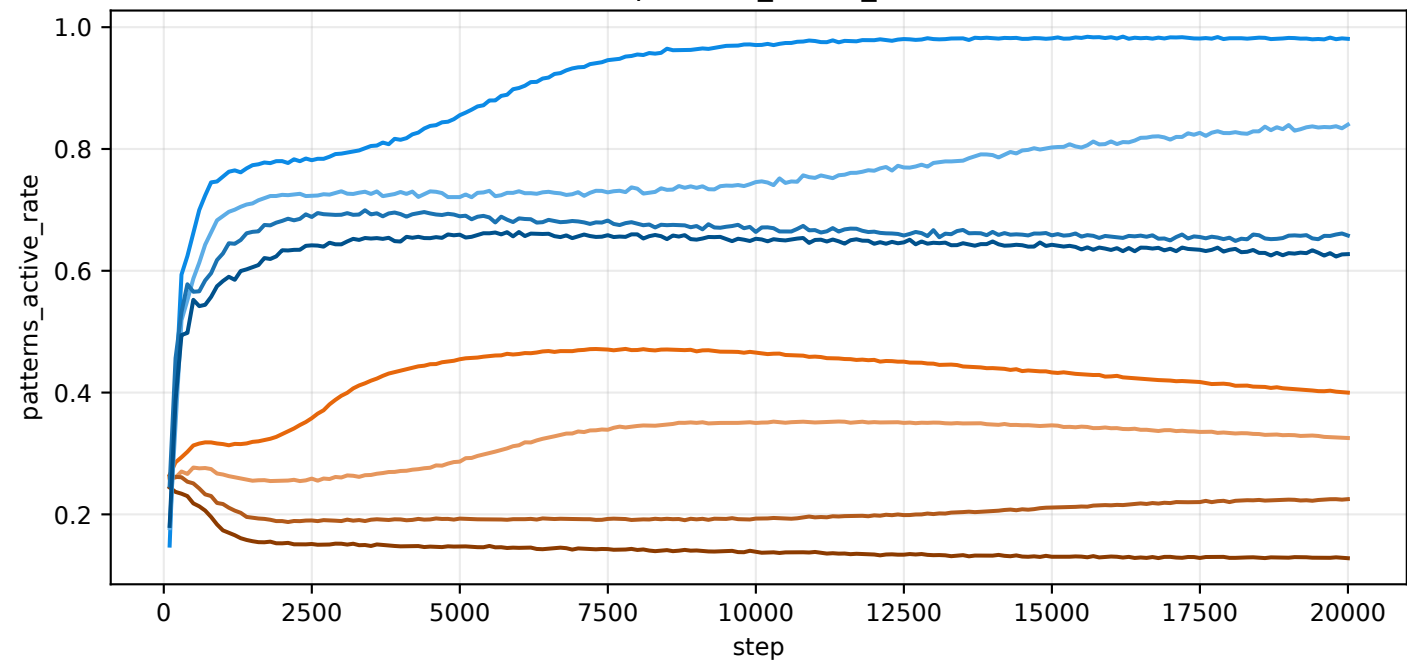

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.2647	0.4717	0.3999	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.2546	0.3525	0.3254	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.1874	0.2632	0.225	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.128	0.2441	0.128	19999
bpae_group2/mask50p_5000.0400.0064_r00	0.1487	0.9845	0.9809	19999
bpae_group2/mask75p_5000.0400.0064_r00	0.1774	0.84	0.84	19999
bpae_group2/mask90p_5000.0400.0064_r00	0.2473	0.6994	0.6579	19999
bpae_group2/mask95p_5000.0400.0064_r00	0.1811	0.6637	0.6273	19999