


train/latent_post_active_rate

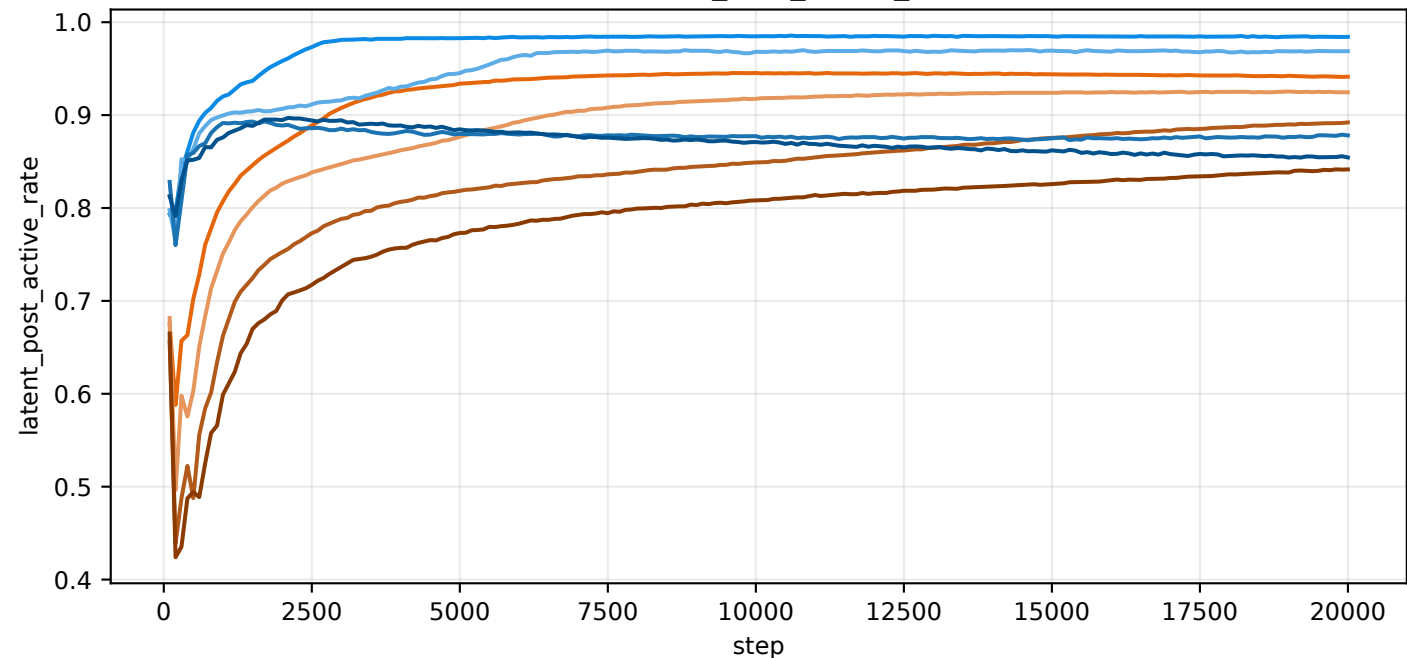

run

min

max

end

step

bpae_group1/mask50p_5000.0400.2000_r00

0.588

0.9454

0.9413

19999

bpae_group1/mask75p_5000.0400.2000_r00

0.4963

0.9254

0.9246

19999

bpae_group1/mask90p_5000.0400.2000_r00

0.439

0.8921

0.8921

19999

bpae_group1/mask95p_5000.0400.2000_r00

0.4241

0.8416

0.8415

19999

bpae_group2/mask50p_5000.0100.2000_r00

0.7931

0.9856

0.9842

19999

bpae_group2/mask75p_5000.0100.2000_r00

0.7652

0.97

0.9688

19999

bpae_group2/mask90p_5000.0100.2000_r00

0.76

0.8933

0.8781

19999

bpae_group2/mask95p_5000.0100.2000_r00

0.7913

0.897

0.8544

19999