


train/mse_reconstruction_step

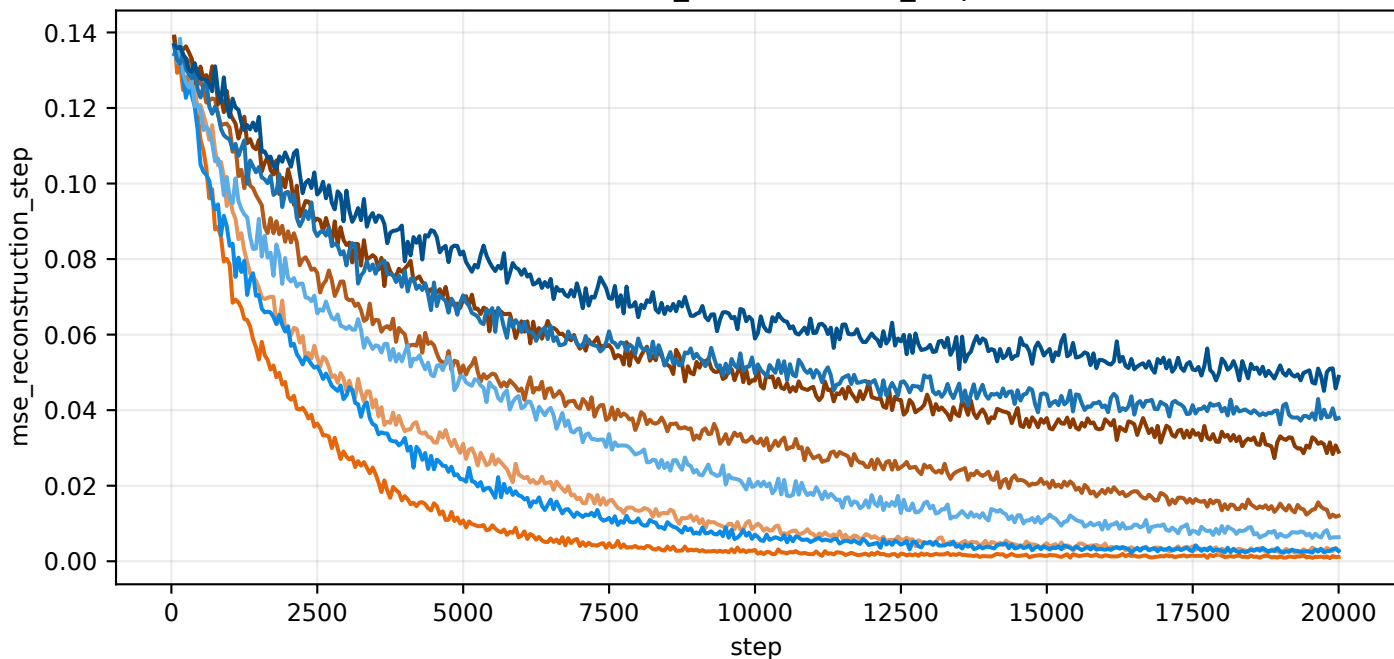

run	min	max	end	step
 bpae_group1/mask50p_5000.0400.2000_r00	0.0008092	0.1387	0.001149	19999
 bpae_group1/mask75p_5000.0400.2000_r00	0.002039	0.1367	0.002963	19999
 bpae_group1/mask90p_5000.0400.2000_r00	0.01158	0.1386	0.01203	19999
 bpae_group1/mask95p_5000.0400.2000_r00	0.0273	0.1389	0.02899	19999
 bpae_group2/mask50p_5000.0100.2000_r00	0.002238	0.1362	0.002688	19999
 bpae_group2/mask75p_5000.0100.2000_r00	0.006108	0.1383	0.006371	19999
 bpae_group2/mask90p_5000.0100.2000_r00	0.03625	0.1361	0.03791	19999
 bpae_group2/mask95p_5000.0100.2000_r00	0.04511	0.1368	0.04883	19999