


train/patterns_active_rate

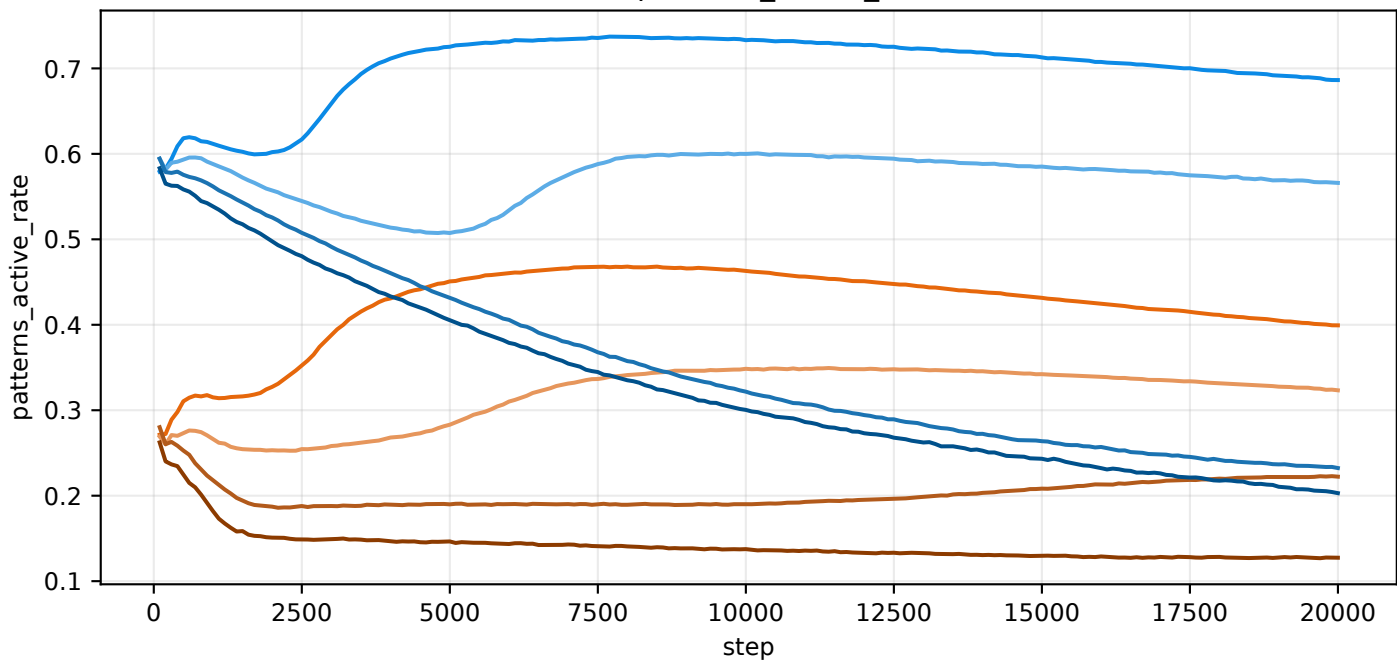

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.2713	0.4682	0.3993	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.2526	0.3494	0.3233	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.1859	0.2802	0.2223	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.1269	0.2624	0.1274	19999
bpae_group2/mask50p_5000.0100.2000_r00	0.5791	0.7372	0.6864	19999
bpae_group2/mask75p_5000.0100.2000_r00	0.5074	0.6006	0.566	19999
bpae_group2/mask90p_5000.0100.2000_r00	0.2324	0.5944	0.2324	19999
bpae_group2/mask95p_5000.0100.2000_r00	0.203	0.5831	0.203	19999