


val/mse_masked

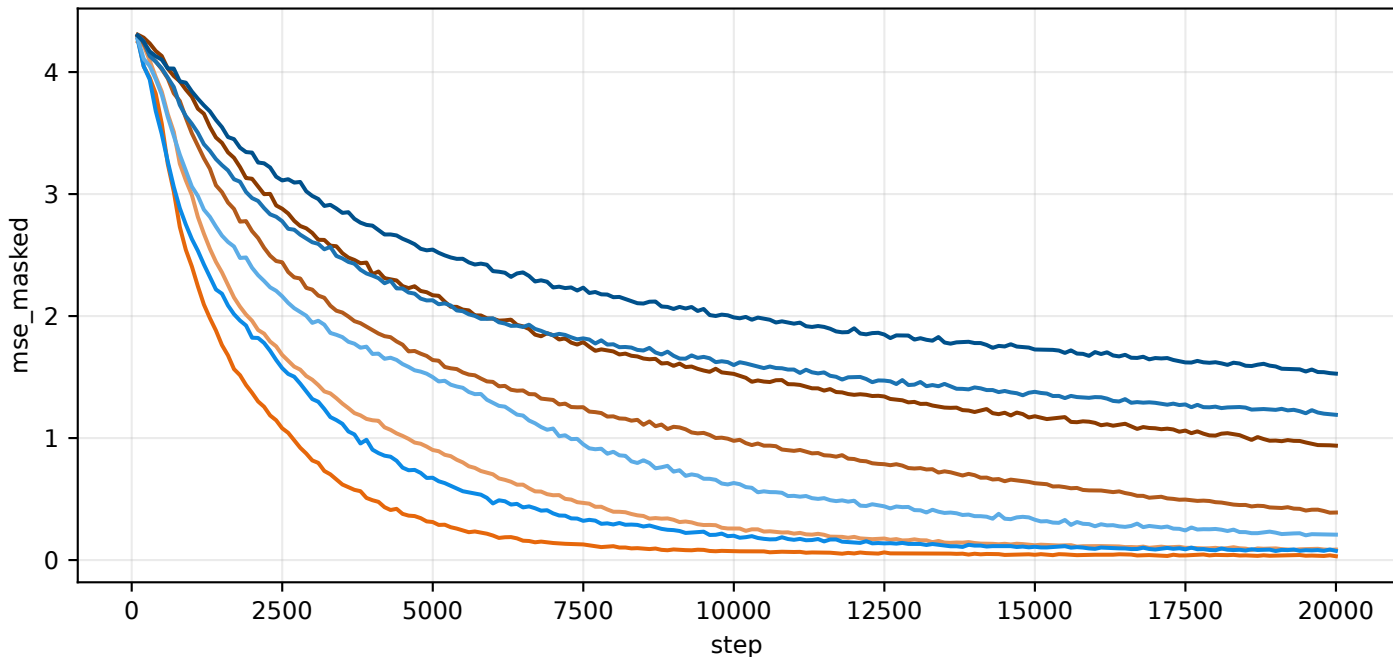

run	min	max	end	step
bpaes_group1/mask50p_5000.0400.2000_r00	0.03163	4.281	0.03163	19999
bpaes_group1/mask75p_5000.0400.2000_r00	0.08346	4.249	0.0861	19999
bpaes_group1/mask90p_5000.0400.2000_r00	0.3884	4.293	0.3897	19999
bpaes_group1/mask95p_5000.0400.2000_r00	0.9377	4.307	0.9377	19999
bpaes_group2/mask50p_5000.0100.2000_r00	0.07439	4.266	0.07558	19999
bpaes_group2/mask75p_5000.0100.2000_r00	0.2028	4.275	0.2083	19999
bpaes_group2/mask90p_5000.0100.2000_r00	1.191	4.3	1.191	19999
bpaes_group2/mask95p_5000.0100.2000_r00	1.528	4.299	1.528	19999