


val/mse_reconstruction

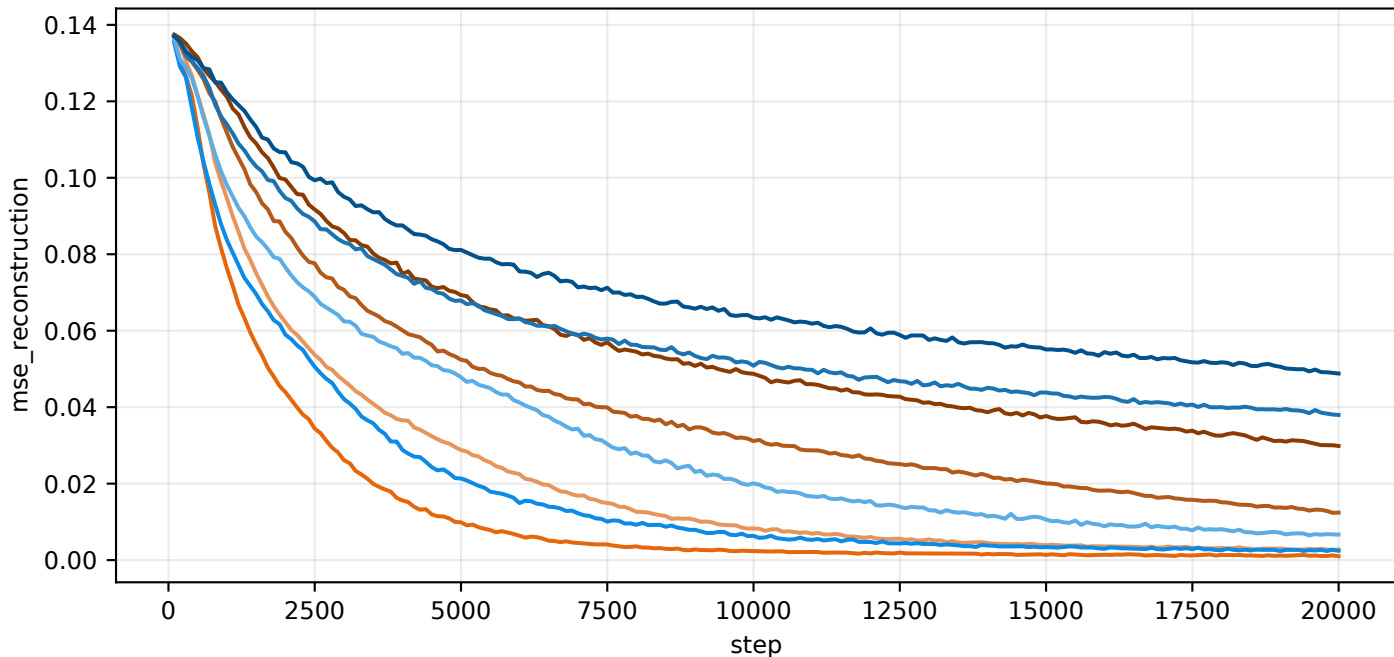

run	min	max	end	step
■ bpae_group1/mask50p_5000.0400.2000_r00	0.001019	0.1357	0.001019	19999
■ bpae_group1/mask75p_5000.0400.2000_r00	0.002657	0.136	0.002754	19999
■ bpae_group1/mask90p_5000.0400.2000_r00	0.01236	0.1367	0.01242	19999
■ bpae_group1/mask95p_5000.0400.2000_r00	0.02985	0.1375	0.02985	19999
■ bpae_group2/mask50p_5000.0100.2000_r00	0.002368	0.1353	0.002437	19999
■ bpae_group2/mask75p_5000.0100.2000_r00	0.006465	0.1363	0.006666	19999
■ bpae_group2/mask90p_5000.0100.2000_r00	0.03797	0.137	0.03797	19999
■ bpae_group2/mask95p_5000.0100.2000_r00	0.04881	0.1371	0.04881	19999