


val/patterns_corr_offdiag

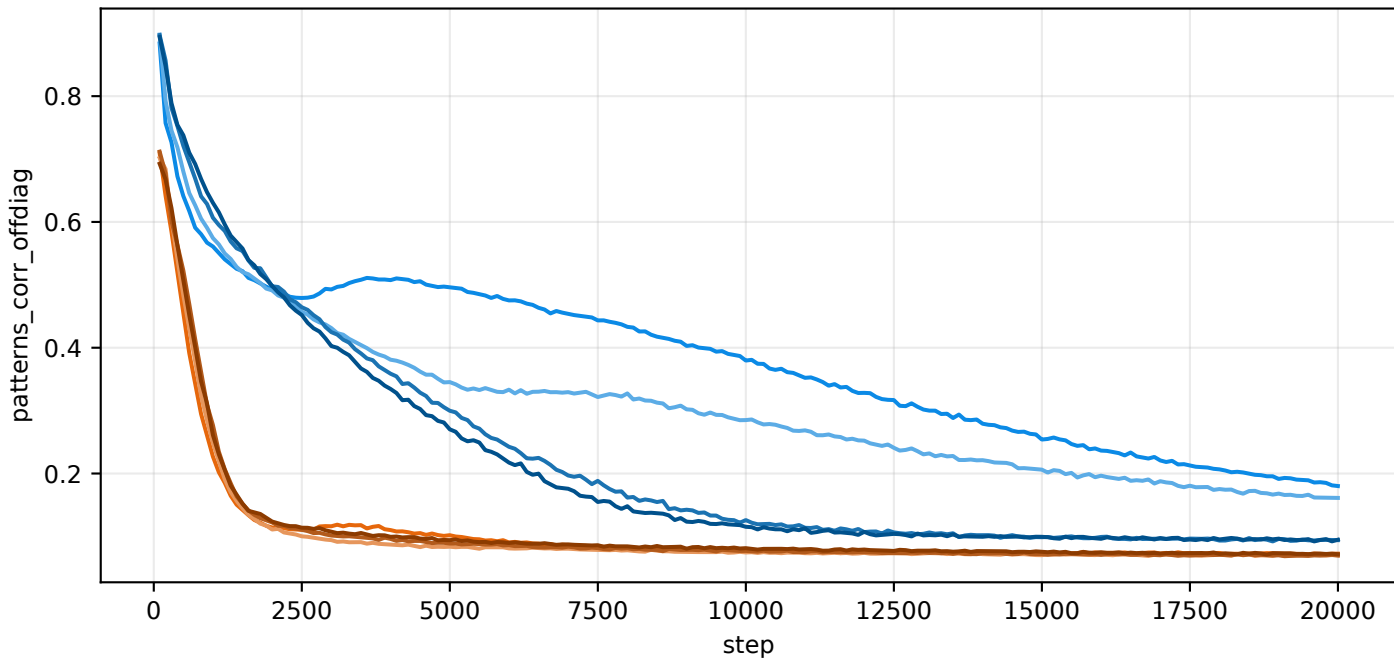

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.07146	0.7093	0.07255	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.06887	0.702	0.06994	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.06852	0.7118	0.06962	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.07114	0.6925	0.07172	19999
bpae_group2/mask50p_5000.0100.2000_r00	0.1801	0.8838	0.1801	19999
bpae_group2/mask75p_5000.0100.2000_r00	0.1612	0.8979	0.1612	19999
bpae_group2/mask90p_5000.0100.2000_r00	0.09202	0.8971	0.09407	19999
bpae_group2/mask95p_5000.0100.2000_r00	0.09203	0.894	0.09472	19999