


val/reconstruction_bce

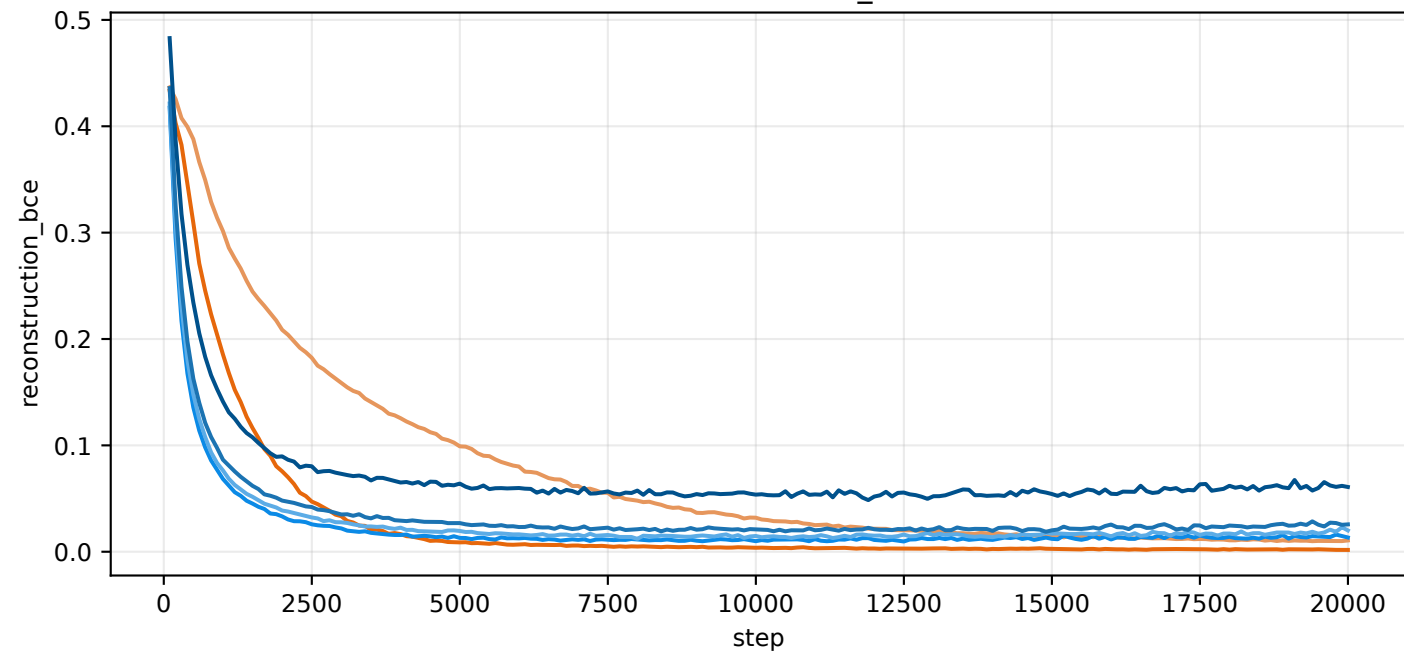

run	min	max	end	step
bpae_fcmt/mask00p-5000.0400.2000-00r	0.001713	0.4336	0.001713	19999
bpae_fcmt/mask75p-5000.0400.2000-00r	0.009921	0.4367	0.01063	19999
dfaae_fcmt/mask00p-5000.0400.2000-00r	0.009644	0.4174	0.01338	19999
dfaae_fcmt/mask10p-5000.0400.2000-00r	0.01209	0.4214	0.02004	19999
dfaae_fcmt/mask40p-5000.0400.2000-00r	0.01877	0.4359	0.02572	19999
dfaae_fcmt/mask75p-5000.0400.2000-00r	0.04855	0.4829	0.06088	19999