


val/reconstruction_mse

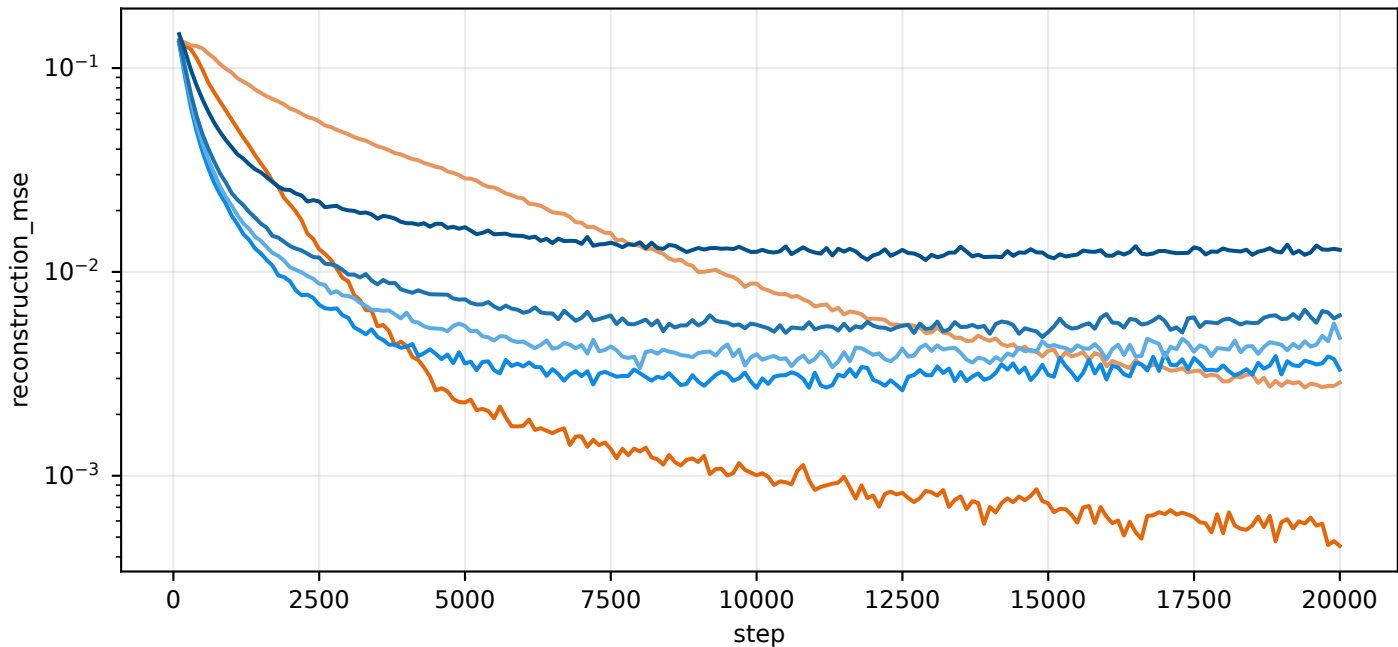

run	min	max	end	step
bpaе_fcmt/mask00p-5000.0400.2000-00r	0.0004526	0.1353	0.0004526	19999
bpaе_fcmt/mask75p-5000.0400.2000-00r	0.002707	0.136	0.002865	19999
dfaae_fcmt/mask00p-5000.0400.2000-00r	0.002624	0.1319	0.003313	19999
dfaae_fcmt/mask10p-5000.0400.2000-00r	0.003368	0.1329	0.00475	19999
dfaae_fcmt/mask40p-5000.0400.2000-00r	0.00479	0.1367	0.006119	19999
dfaae_fcmt/mask75p-5000.0400.2000-00r	0.01143	0.1467	0.01283	19999