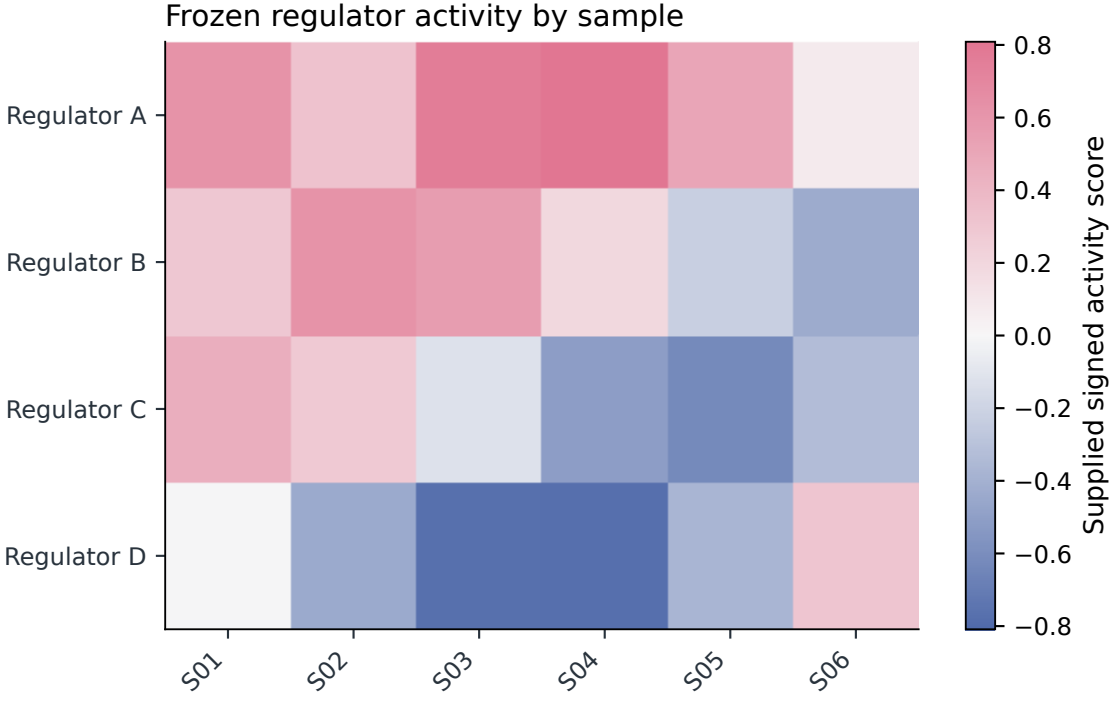
Frozen regulator activity by sample
Regulator A
Regulator B
Regulator C
Regulator D
S01
S02
S03
S04
S05
S06
0.8
0.6
0.4
0.2
0.0
−0.2
−0.4
−0.6
−0.8
Supplied signed activity score