Mass spectrum mirror

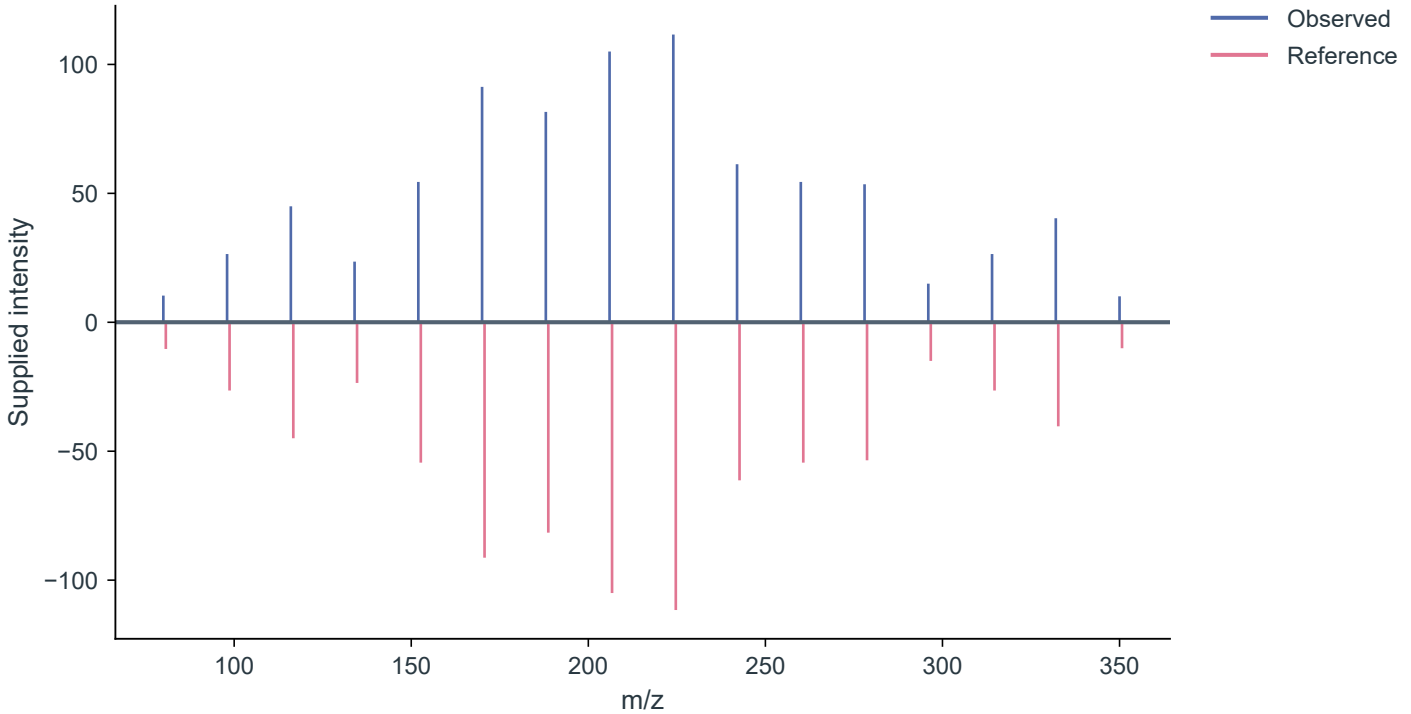

Observed and reference peaks
No peak matching, compound identification, rescaling or deconvolution performed.