
Supplied raw p: * < 0.05, ** < 0.01, *** < 0.001; filled diamond < 0.05

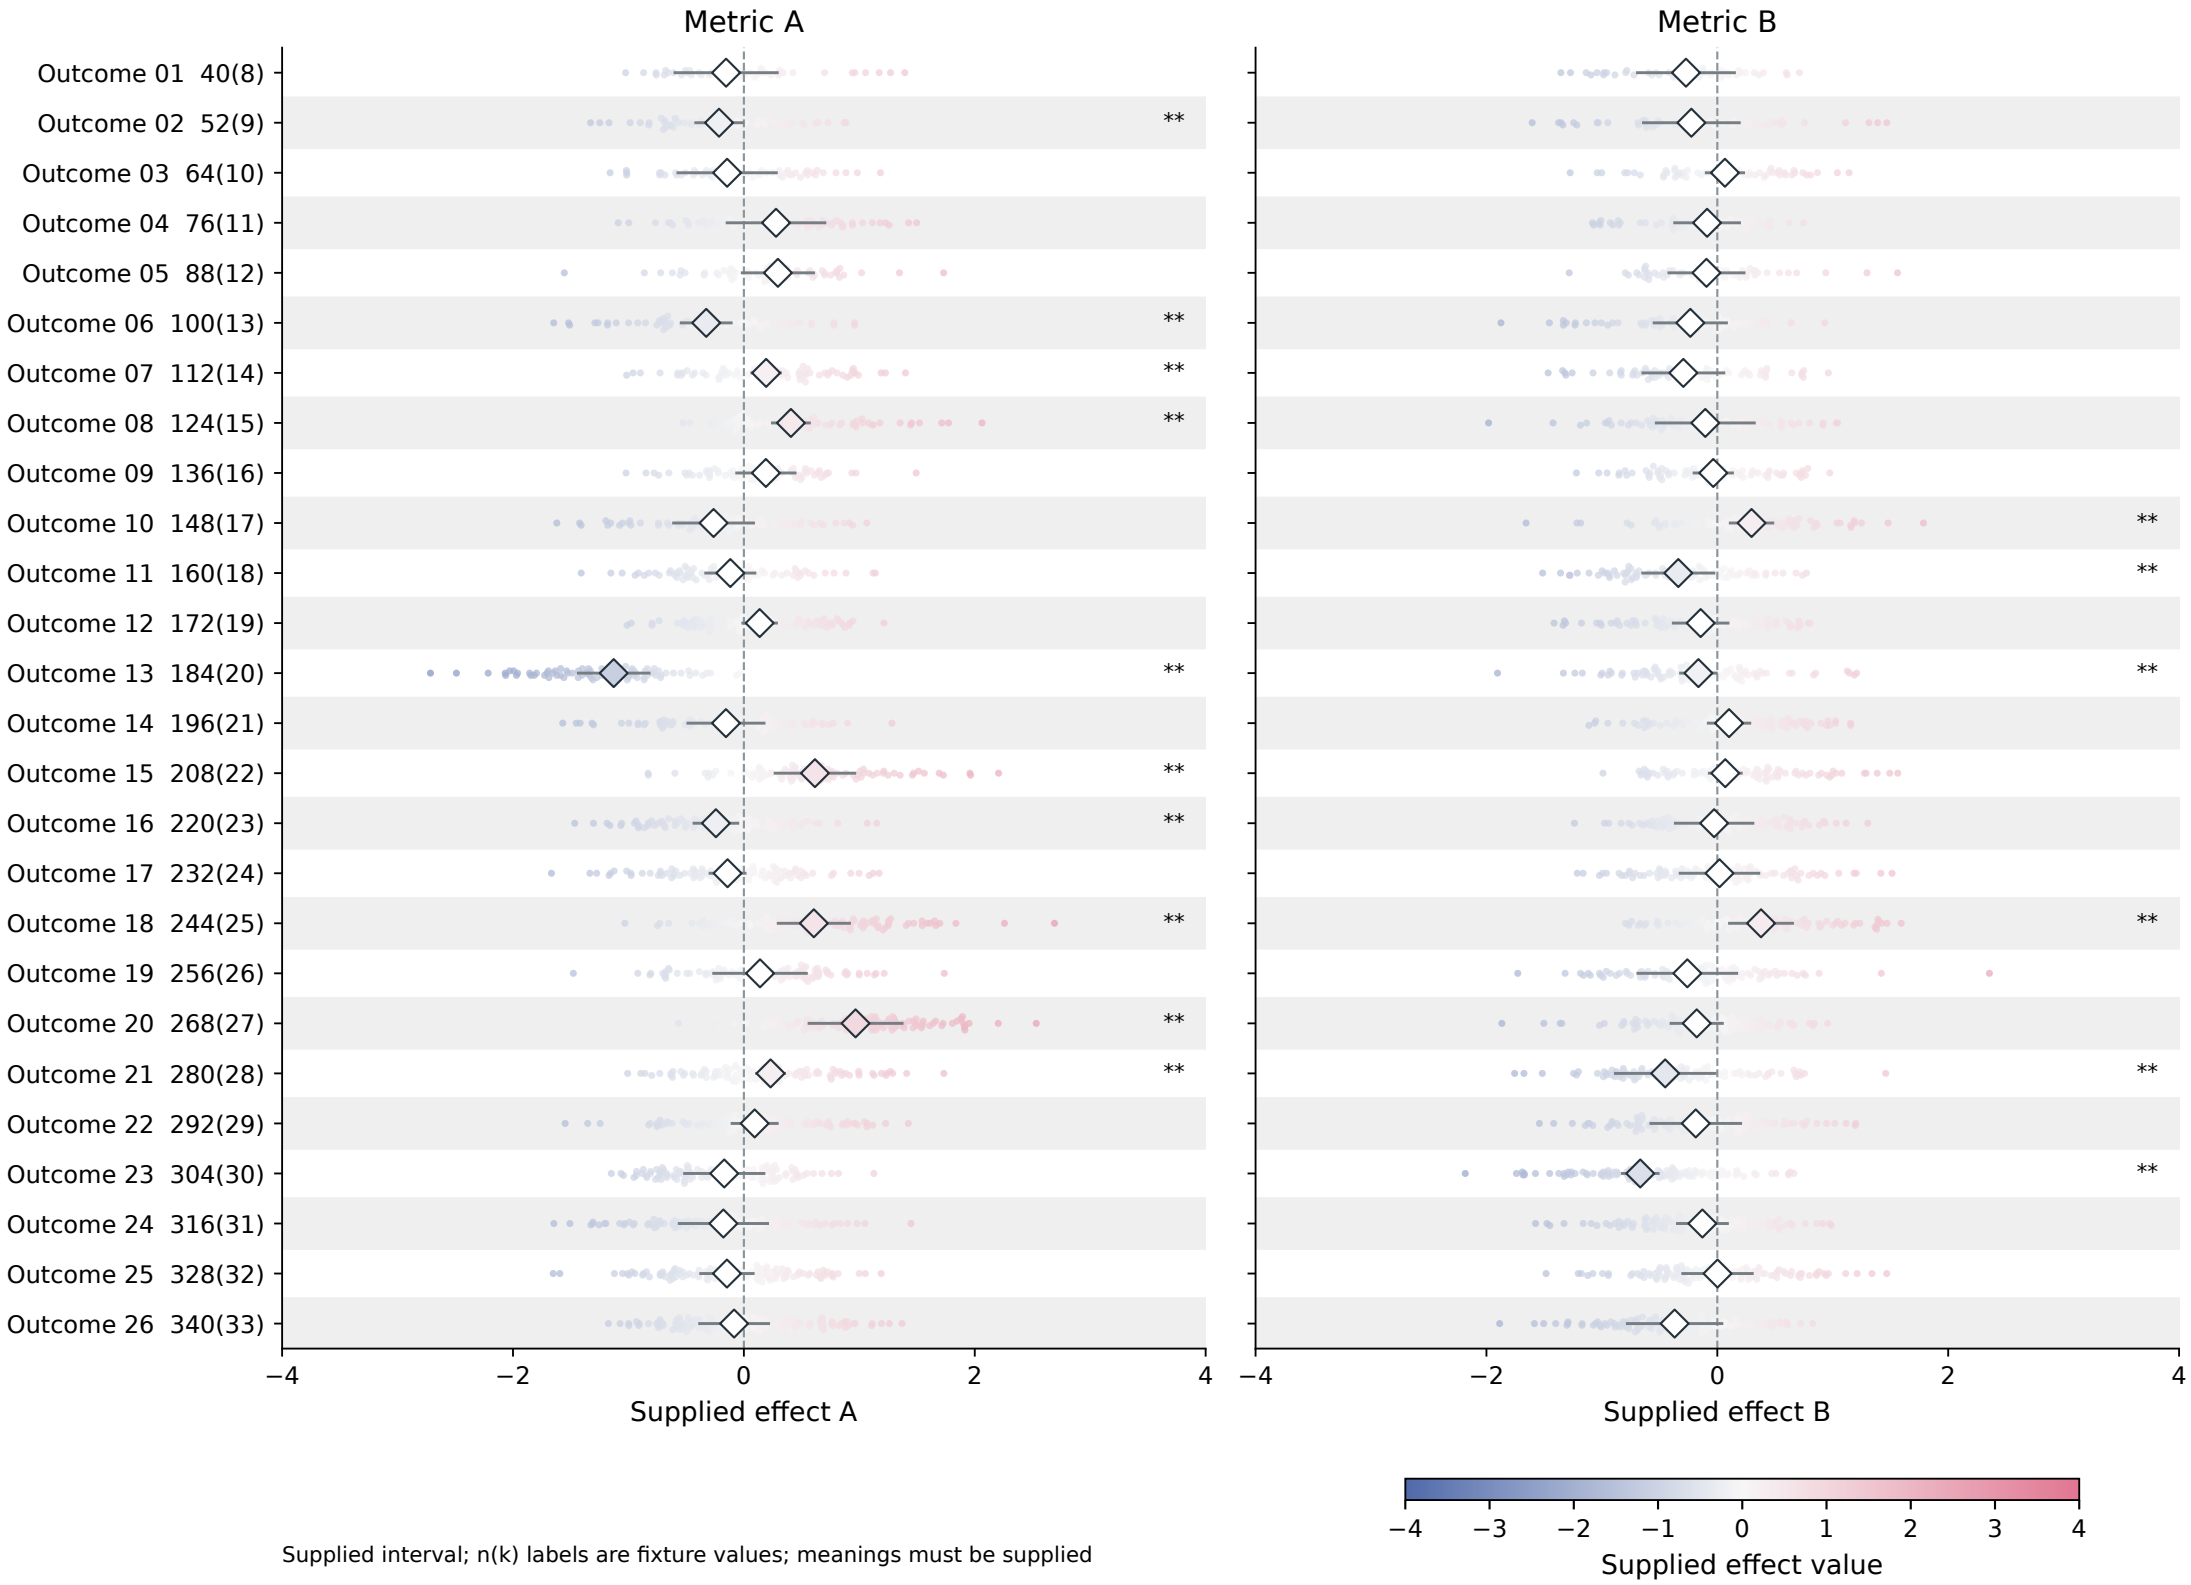

Supplied interval; n(k) labels are fixture values; meanings must be supplied

Software test fixture; not biological evidence