



CONCEPT, NOT FOR FABRICATION

H2Guard · [github.com/BoujeeEnjinia1701/h2guard](https://github.com/BoujeeEnjinia1701/h2guard)

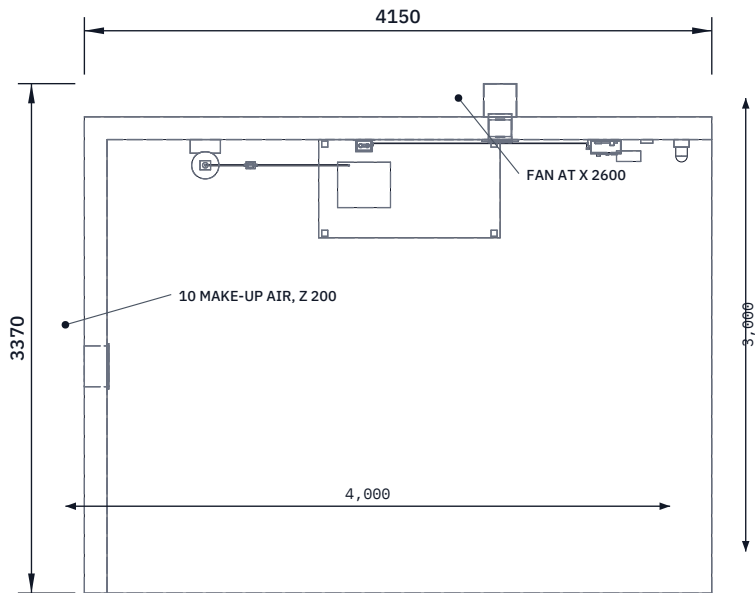


TOP VIEW

Scale 1:50; looking down (along -Z)

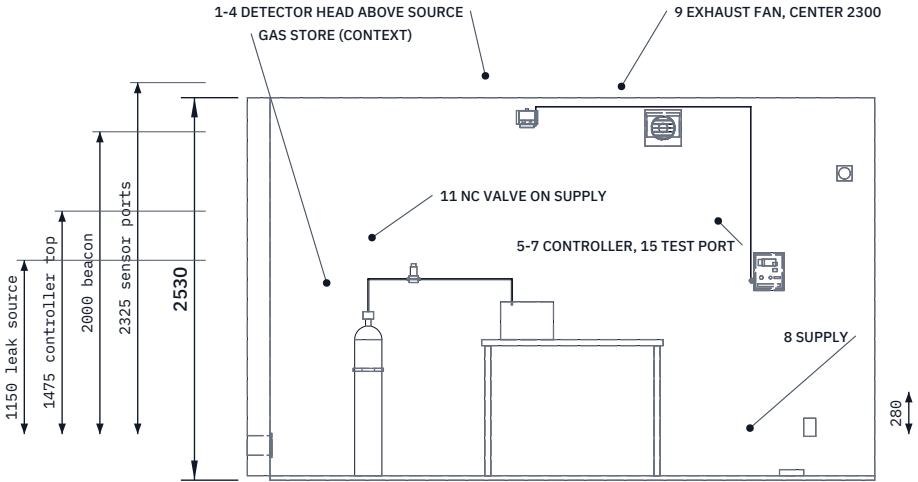


FRONT VIEW

Scale 1:50; looking at the front (along +Y)

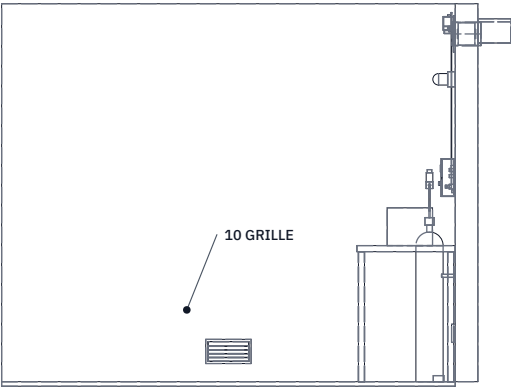

RIGHT VIEW

Scale 1:50; looking at the right side (along -X)

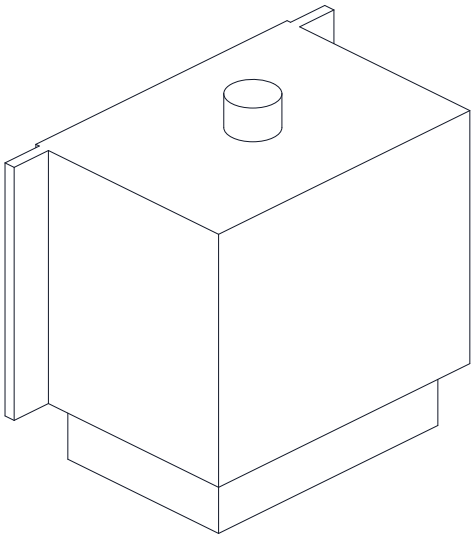

DETECTOR HEAD, ITEMS 1 TO 4

Not to scale; ports and bump test cup face down

MAIN DIMENSIONS AND INTERFACES (MM)

Room 4000 x 3000 x 2500 (30 m3); leak source 1150 above floor  
Head 110 x 80 x 90; ports 175 below ceiling, 1175 above source  
Arrestor discs 25 x 2; sensor 2.2 behind disc  
Bump cup 96 x 66 x 22 (114 mL); tube 4 OD, 2,695 run  
Controller 200 x 250 x 90; top 1,025 below ceiling  
Fan 150 duct, sleeve 190; grille top 80 below ceiling  
Make-up grille 300 x 160 on far wall, center 200  
Valve 1/4 in NC after regulator; gas fitting by a competent person  
Head directly above each likely leak point; offset limit set at TRL 4  
Warning held 5 min closes valve and latches (firmware, DDR-002)  
Third-angle; front view from -Y (room side); HGD-CAL-001

H2GUARD

[github.com/BoujeeEnjinia1701/h2guard](https://github.com/BoujeeEnjinia1701/h2guard)

General arrangement in the 30 m3 reference room

DRAWING NO.

HGD-DWG-001

REV

P3

SHEET

1 of 1

SIZE

ANSI B

SCALE

1:50

UNITS

mm

PROJECTION



DATE

2026-09-25

DRAWN

Amish Chadha

MATERIAL / NOTES

Bought-in parts per bom/bom.csv; room, bench and gas store are context. PRELIMINARY, NOT FOR FABRICATION

Licensed CERN-OHL-S-2.0 · Design Molecule Lab · [designmolecule.com](https://designmolecule.com)

Generated from cad/src; do not edit by hand