



CONCEPT, NOT FOR FABRICATION

REV	DESCRIPTION	DATE	BY
P1	Preliminary GA for TRL 3 (from cad/src/model.py)	2026-09-25	AC

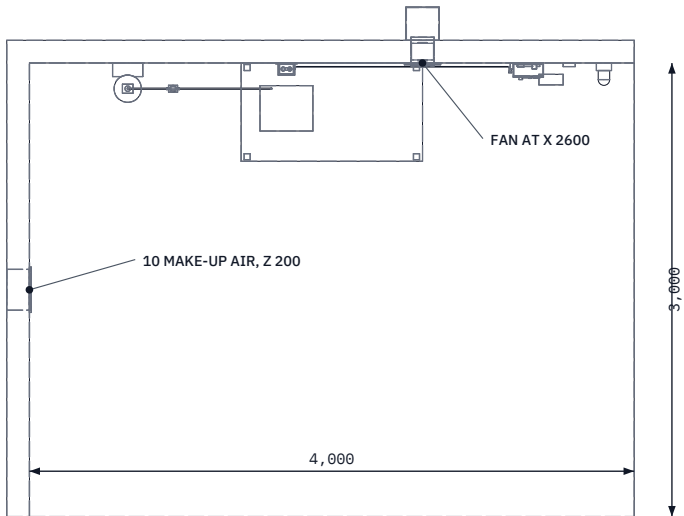


TOP VIEW

Scale 1:50

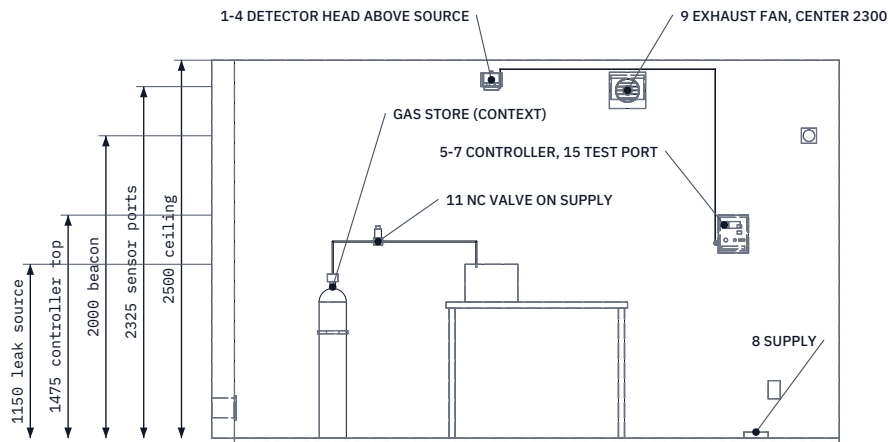


FRONT VIEW

Scale 1:50

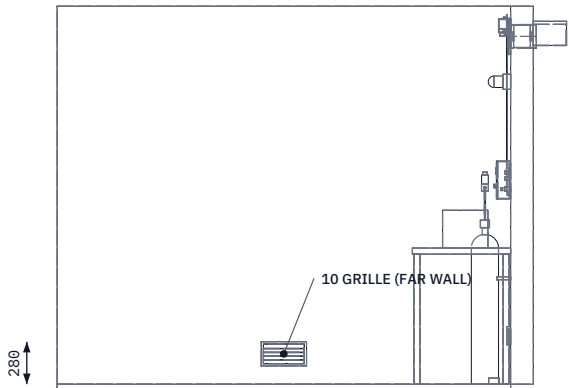

RIGHT VIEW

Scale 1:50

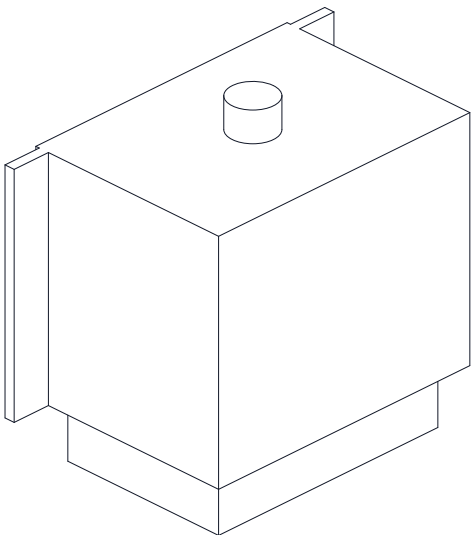

DETECTOR HEAD, ITEMS 1 TO 4

Not to scale; ports and bump test cup face down

MAIN DIMENSIONS AND INTERFACES (MM)

Room 4000 x 3000 x 2500 (30 m3); leak source 1150 above floor

Head 110 x 80 x 90; ports 175 below ceiling, 1175 above source

Arrestor discs 25 x 2; sensor 2.2 behind disc

Bump cup 96 x 66 x 22 (114 mL); tube 4 OD, 2,695 run

Controller 200 x 250 x 90; top 1,025 below ceiling

Fan 150 duct, sleeve 190; grille top 80 below ceiling

Make-up grille 300 x 160 on far wall, center 200

Valve 1/4 in NC after regulator; gas fitting by a competent person

Third-angle; front view from -Y (room side); HGD-CAL-001

H2GUARD

General arrangement in the 30 m3 reference room

DRAWING NO.

HGD-DWG-001

REV

P1

SHEET

1 of 1

SIZE

ANSI B

SCALE

1:50

UNITS

mm

PROJECTION



DATE

2026-09-25

DRAWN

Amish Chadha

MATERIAL / NOTES

Bought-in parts per bom/bom.csv; room, bench and gas store are context. PRELIMINARY, NOT FOR FABRICATION

Licensed CERN-OHL-S-2.0 · Open Hardware Portfolio · amishchadha.com

Generated from cad/src; do not edit by hand