


CONCEPT, NOT FOR FABRICATION


TremorTrace · github.com/BoujeeEnjinia1701/tremortrace

REV	DESCRIPTION	DATE	BY
P1	General arrangement for TRL 3 (TRT-CAL-001)	2026-09-25	AC
P2	Textile strap, charge at 50 mA (TRT-DDR-002)	2026-09-25	AC

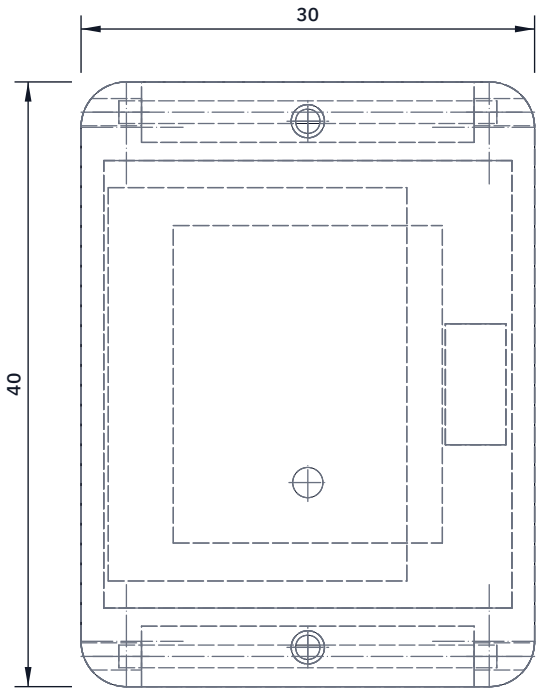


TOP VIEW

Scale 2:1; looking down (along -Z)

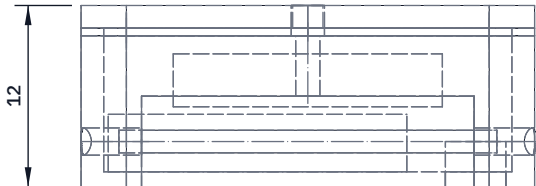


FRONT VIEW

Scale 2:1; looking at the front (along +Y)

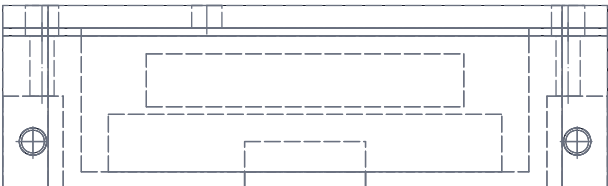

RIGHT VIEW

Scale 2:1; looking at the right side (along -X)

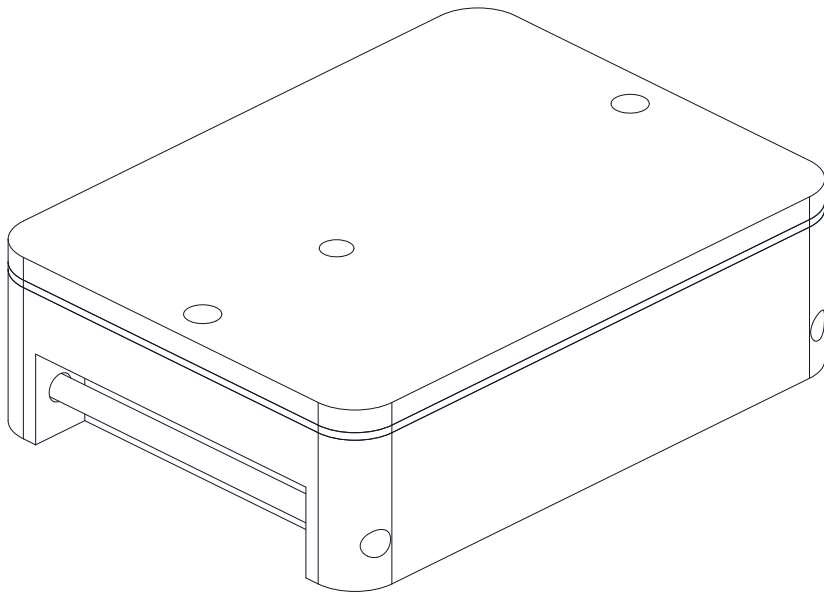

ISOMETRIC VIEW

Not to scale; strap omitted; seen from the front right and above, about 30 deg elevation

MAIN DIMENSIONS (MM)

Pod envelope 40 across wrist x 30 along forearm x 12 high

Base 10.0 high, wall 1.5, floor 1.0; lid 1.5

Gasket 0.5 compressed; corner radius 3

Cavity 27.0 x 29.6 x 9.5

Lugs: 22 between horns, notch 4 deep x 6 high

Spring bar holes 1.8 dia, 2 from end, 3 above skin

Lid screws 2 x M2 x 6 on centerline, 17.4 from center

Cell 19.75 x 26.02 x 3.8; module 17.8 x 21 x 3.5

Charging opening 4 x 8 in floor; LED bore 2 dia

PARTS LIST (ITEMS MATCH BOM/BOM.CSV)

- 1 Textile strap, 22 mm (not shown)
- 2 Enclosure lid, PETG
- 3 Controller and IMU module (XIAO class)
- 4 LiPo cell, 150 mAh protected
- 5 Enclosure base, PETG
- 6 Magnetic 2-pin charging connector

PARTS LIST, CONTINUED

- 7 TPU gasket
 - 8 Spring bars, 22 mm
 - 9 Lid screws, 2 x M2 x 6
 - 10 Light pipe, 2 mm
 - 11 Consumables
- Charge at 50 mA. Never charge while worn.
Not a medical device.

TREMORTRACE

github.com/BoujeeEnjinia1701/tremortrace

Wrist pod general arrangement

DRAWING NO. TRT-DWG-002		REV P2	SHEET 1 of 1	SIZE ANSI B
SCALE 2:1	UNITS mm	PROJECTION 	DATE 2026-09-25	DRAWN Amish Chadha
MATERIAL / NOTES Base and lid PETG, gasket TPU 95A; bought parts per bom/bom.csv. PRELIMINARY, NOT FOR FABRICATION				
Licensed CERN-OHL-S-2.0 · Design Molecule Lab · designmolecule.com				Generated from cad/src; do not edit by hand