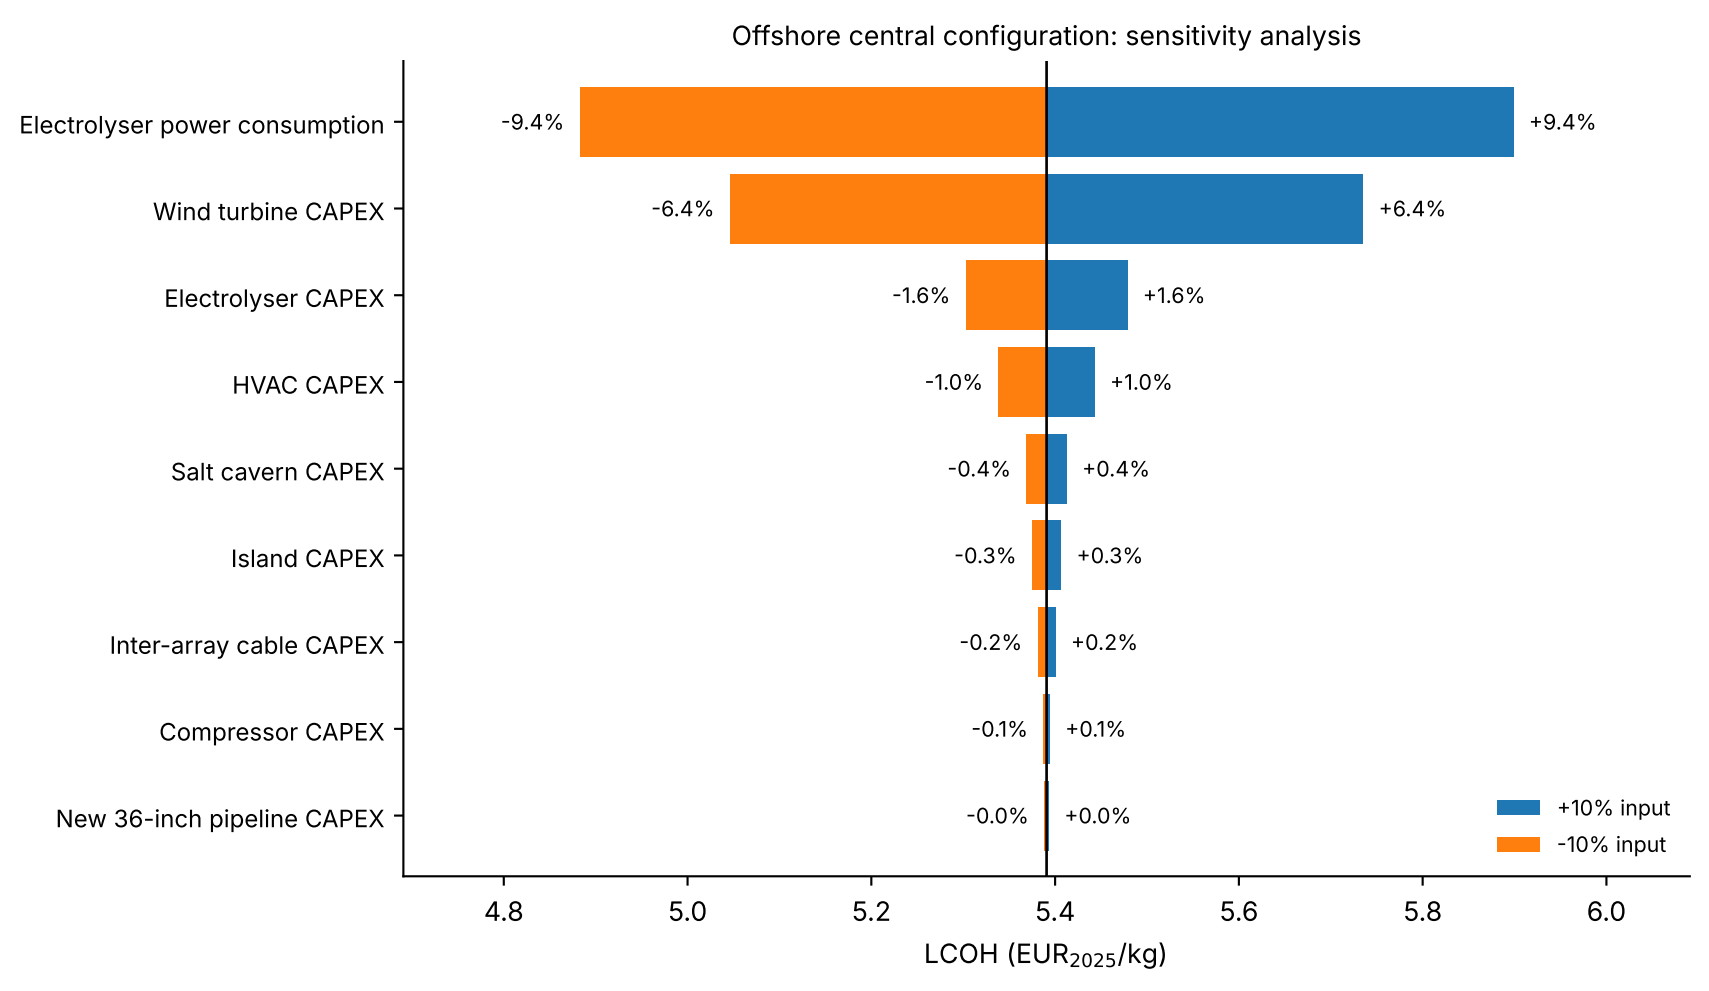
Offshore central configuration: sensitivity analysis
Electrolyser power consumption
Wind turbine CAPEX
Electrolyser CAPEX
HVAC CAPEX
Salt cavern CAPEX
Island CAPEX
Inter-array cable CAPEX
Compressor CAPEX
New 36-inch pipeline CAPEX
-9.4%
+9.4%
-6.4%
+6.4%
-1.6%
+1.6%
-1.0%
+1.0%
-0.4%
+0.4%
-0.3%
+0.3%
-0.2%
+0.2%
-0.1%
+0.1%
-0.0%
+0.0%
+10% input
-10% input
4.8
5.0
5.2
5.4
5.6
5.8
6.0
LCOH (EUR2025/kg)