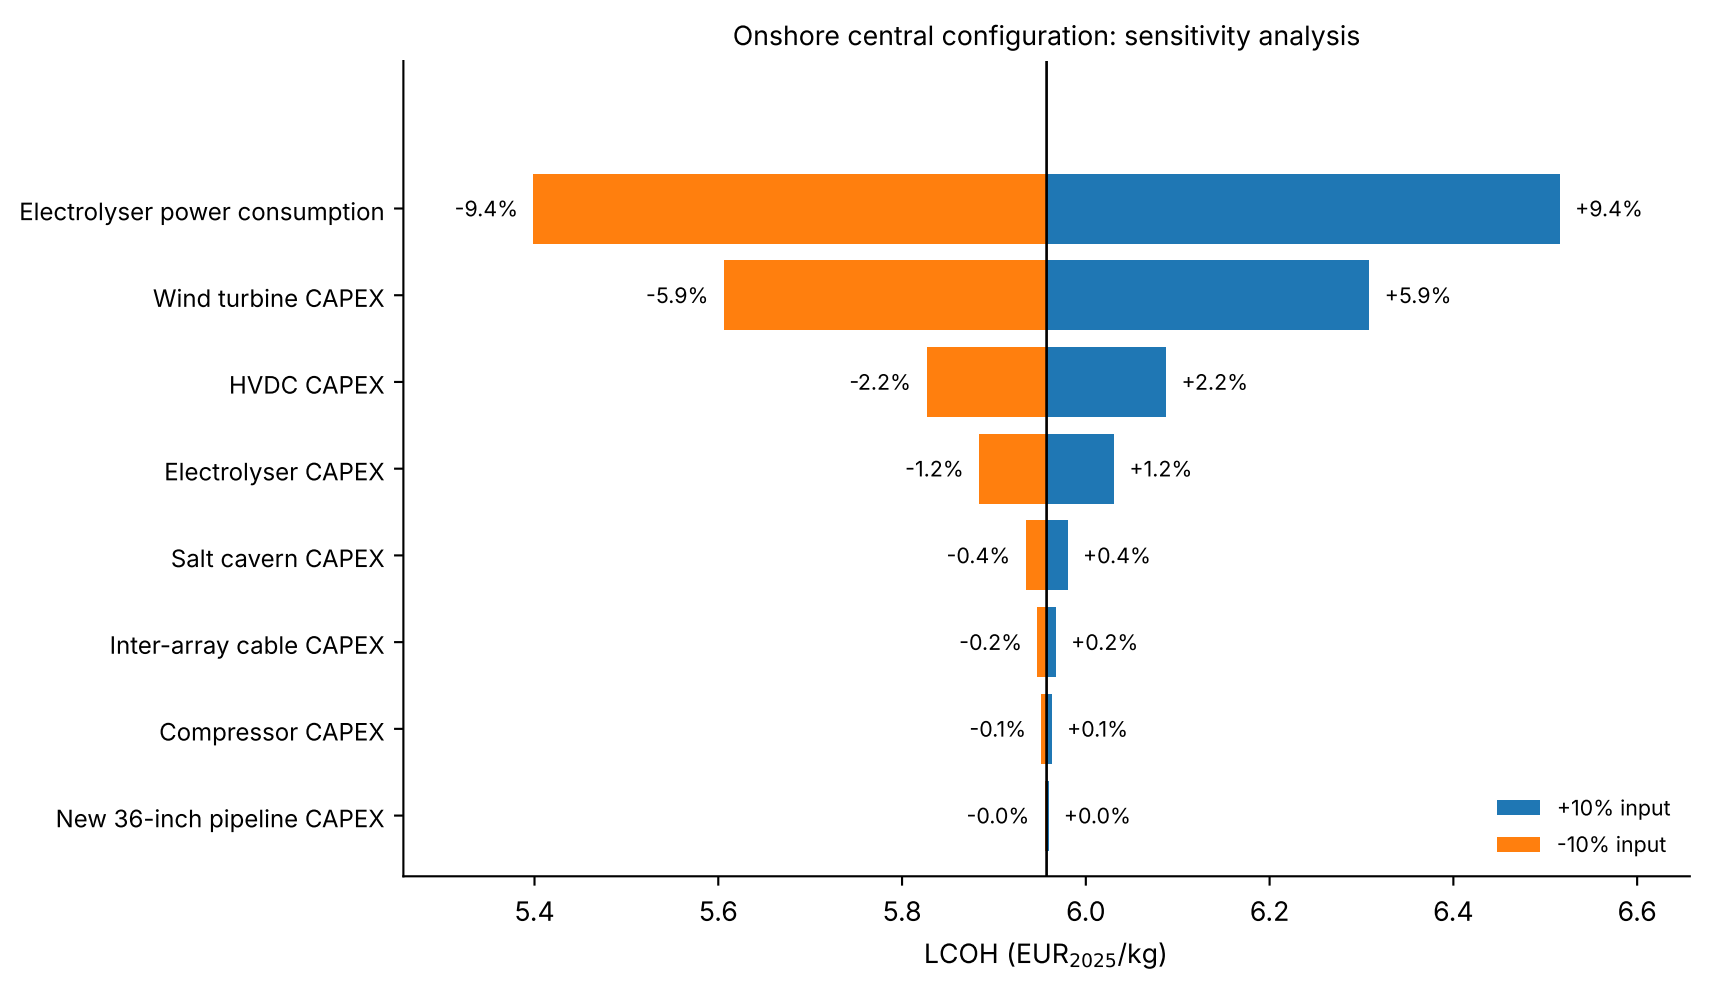
Onshore central configuration: sensitivity analysis
Electrolyser power consumption
Wind turbine CAPEX
HVDC CAPEX
Electrolyser CAPEX
Salt cavern CAPEX
Inter-array cable CAPEX
Compressor CAPEX
New 36-inch pipeline CAPEX
-9.4%
+9.4%
-5.9%
+5.9%
-2.2%
+2.2%
-1.2%
+1.2%
-0.4%
+0.4%
-0.2%
+0.2%
-0.1%
+0.1%
-0.0%
+0.0%
+10% input
-10% input
5.4
5.6
5.8
6.0
6.2
6.4
6.6
LCOH (EUR2025/kg)