


Fire Regulation and Universal Design Compliance Results



Room: 004 - Corridor

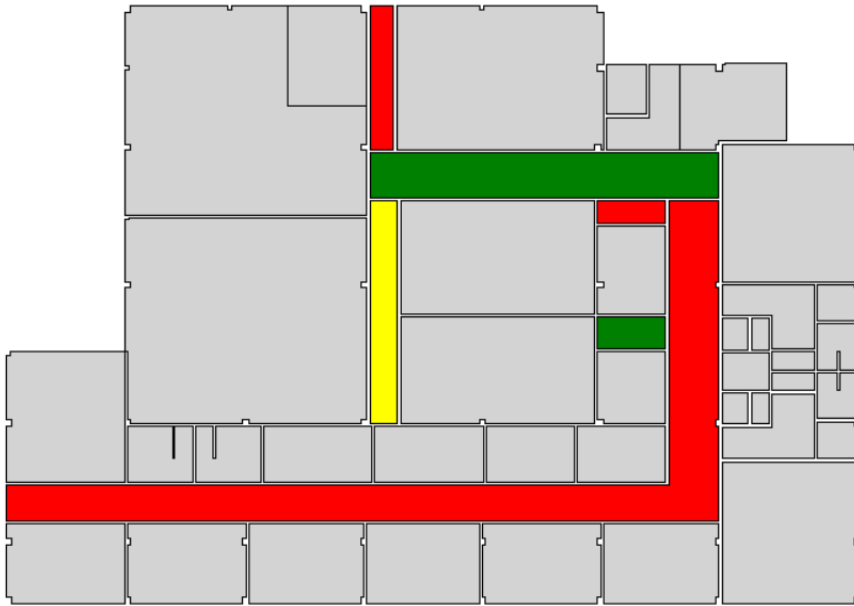

Calculated width: 2.3 m

Corridor is wide enough. Required width is 1.3 m.

Room: 005 - Corridor



Calculated width: 1.2 m

Corridor is not wide enough! Required width is 1.3 m!

Room: 009 - Corridor



Calculated width: 1.4 m

Corridor is wide enough according to BR18. Required width is 1.3 m.

But it is not compliant with Universal Design principles. The recommended corridor width is 1.5 m.

Room: 011 - Corridor



Calculated width: 1.8 m

Corridor is not wide enough! Required width is 1.3 m!

Room: 012 - Corridor



Calculated width: 1.1 m

Corridor is not wide enough! Required width is 1.3 m!

Room: 015 - Corridor



Calculated width: 1.65 m

Corridor is wide enough. Required width is 1.3 m.