
AHU01 - TT12-OAT
Outside Air Temperature

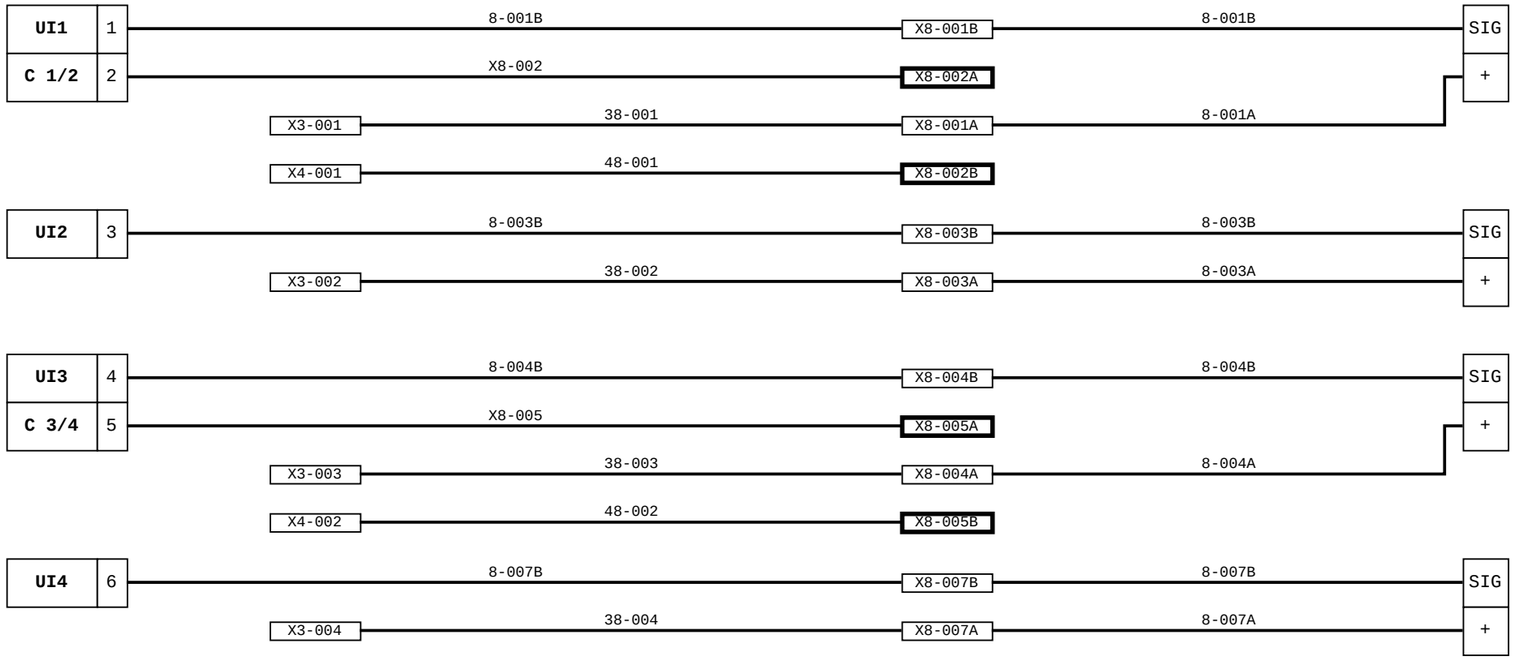

TT12-OAT

AHU02 - TT13-OAT
Outside Air Temperature

TT13-OAT

AHU03 - TT14-OAT
Outside Air Temperature

TT14-OAT

AHU04 - TT15-OAT
Outside Air Temperature

TT15-OAT

REV	DATE:	DESCRIPTION	CHK:
1	05/11/26	For Review	DF

Project:
Project

Client:
Client

Vendor:
Vendor

Drafter:
Drafter_Company

Drawing Set:
Drawing_Set


Drawing Name:
Drawing_Name

Revision Details:
Rev_Details

Revision:
1

Designer:	Drafter:	Checked
Designer	Drafter	Checked

Terminal Strip X3 - 24 VDC / X4 - 24 VDC Common

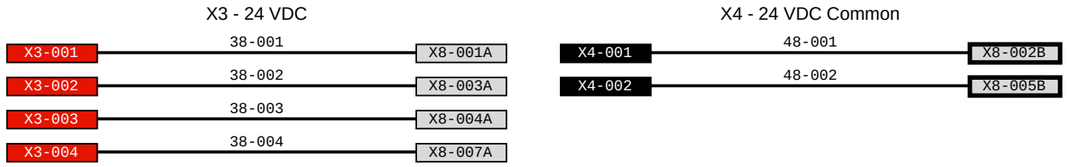

REV	DATE:	DESCRIPTION	CHK:
1	05/11/26	For Review	DF

Project:

Project

Client:

Client

Vendor:

Vendor

Drafter:

Drafter_Company

Drawing Set:

Drawing_Set


Drawing Name:

Drawing_Name

Revision Details:	Revision:
Rev_Details	1

Designer:	Drafter:	Checked
Designer	Drafter	Checked

Terminal Strip X8 - IO

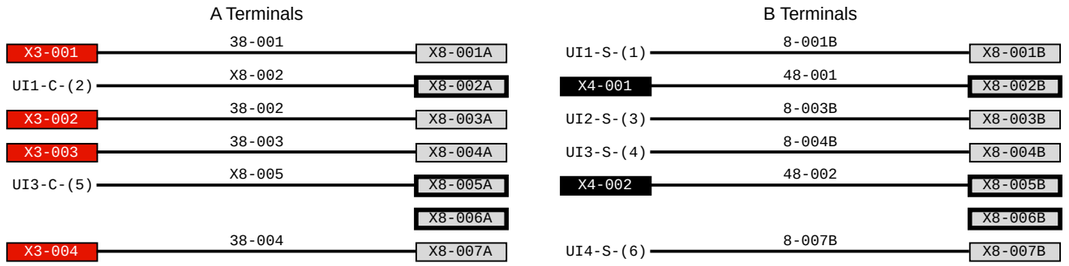

REV	DATE:	DESCRIPTION	CHK:
1	05/11/26	For Review	DF

Project:

Project

Client:

Client

Vendor:

Vendor

Drafter:

Drafter_Company

Drawing Set:

Drawing_Set

Drawing Name:

Drawing_Name

Revision Details:	Revision:
Rev_Details	1

Designer:	Drafter:	Checked
Designer	Drafter	Checked