

Modular Temperature Controllers

Radically Increase the Performance of Multipoint Temperature Control with the EJ1.



Achieve Optimum Temperature Control for a Device.

The EJ1 is a new type of Modular Controller that increases device performance from design and installation through maintenance. Additional functions required for multipoint temperature control have been added to the EJ1 to reduce even further the amount of work required for setup and communications. It enables building systems that meet customer needs.

The area for programless communications with PLCs has been expanded to 1,200 parameters.

Bit specifications for operation commands reduces the amount of work required for ladder programming.

NB-series PT screen templates for the EJ1 reduce the amount of work required to create screens and allow parameter values to be viewed and updated without the need to reconnect the unit to CX-Thermo.

CX-Thermo Support Software supports multi-node settings.

A switch can be set to enable monitoring the output status on operation indicators.

A switch can be set to use Modbus as the port B communications protocol.

Available with screw terminals or screw-less clamp terminals

Independent heating/cooling PID control and autotuning (AT) for heating and cooling.

Self-tuning (ST).

Optimum cycle control with the G3ZA and phase control with the G3PW.

Up to 256 loops per system for large-area control; allows easy expansion.


**Reduced
Design Work**

**Easy
Installation
and Setup**

**Smart
Concept**

**Flexible
Control and
Adjustment**

The Ultimate in User-friendly Design to Directly
Improve Device Performance.
Even Better Functions for Multipoint Temperature Control.

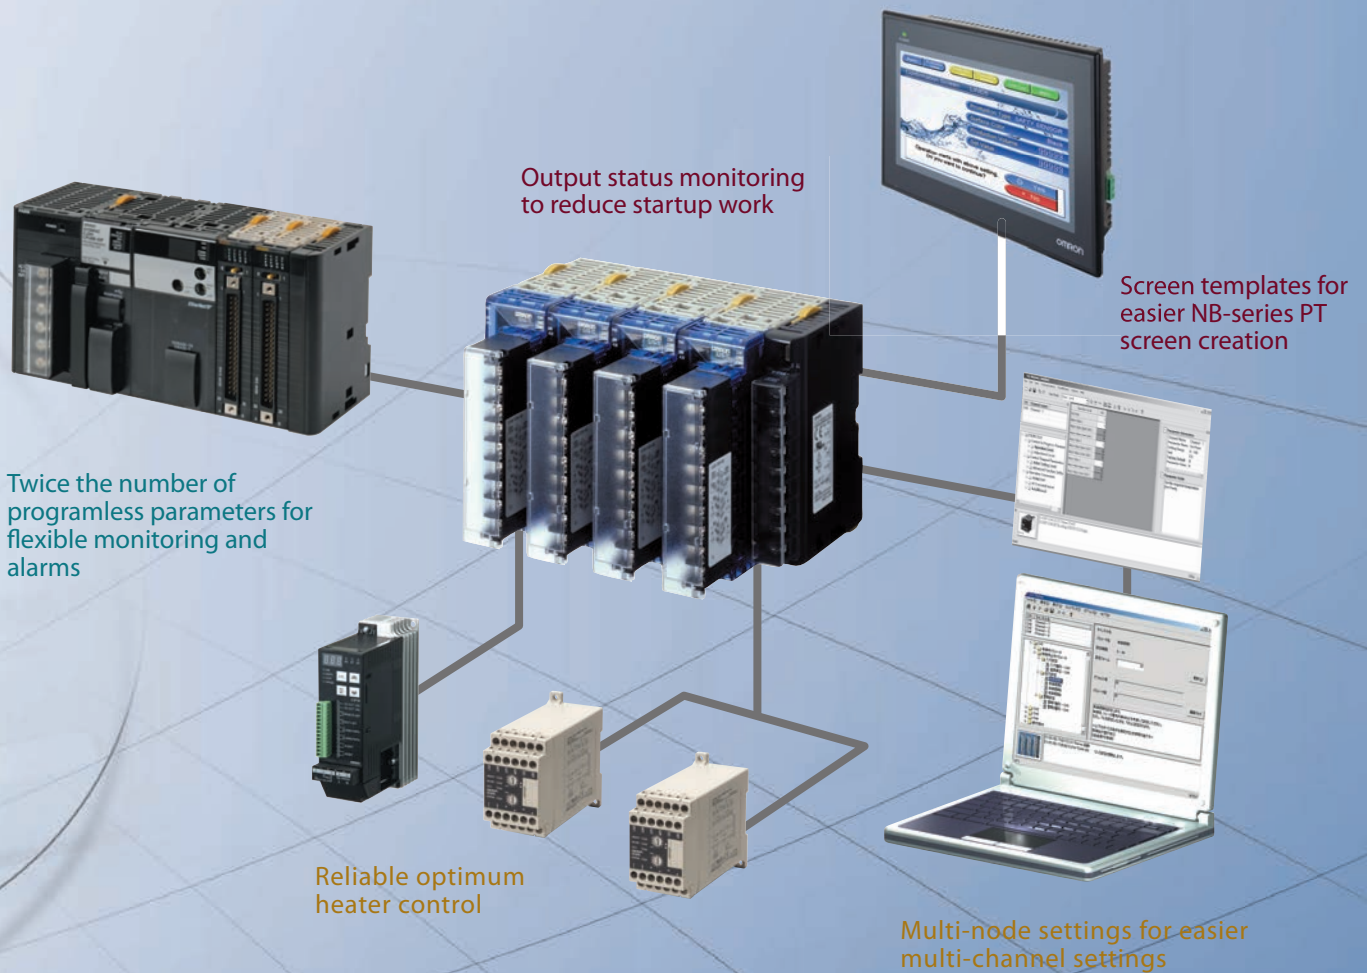

New Functions


Incredible User-friendly Design with Advance

Reduced Design Work

HFU
Ver.UP


The capacity of the area for programless communications with PLCs has been increased from 600 (version 1.1) to 1,200 parameters. You can now use more parameters for each loop or to support multipoint control.

Programless communications enables exchanging data simply by setting PLC flag operation and the EJ1 parameters. There is no need for creating a communications program. This results in a significant reduction in design work.

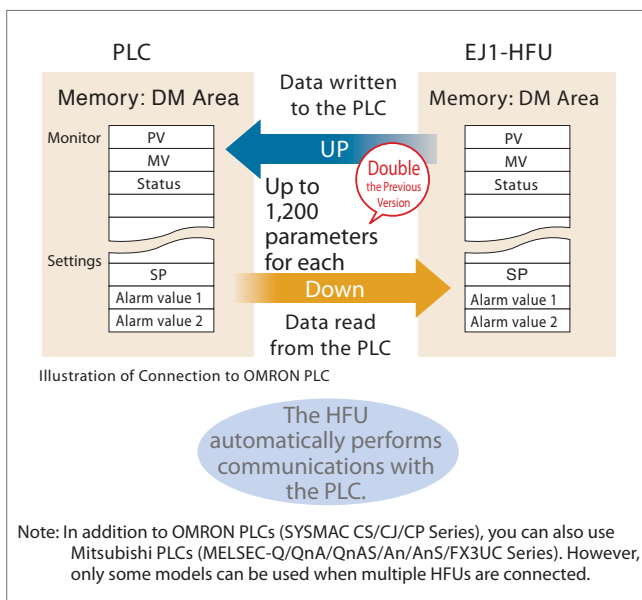

HFU
Ver.UP

Operation commands that were previously executed for each channel can now be executed using bit specifications, reducing the amount of work required to create ladder programs.

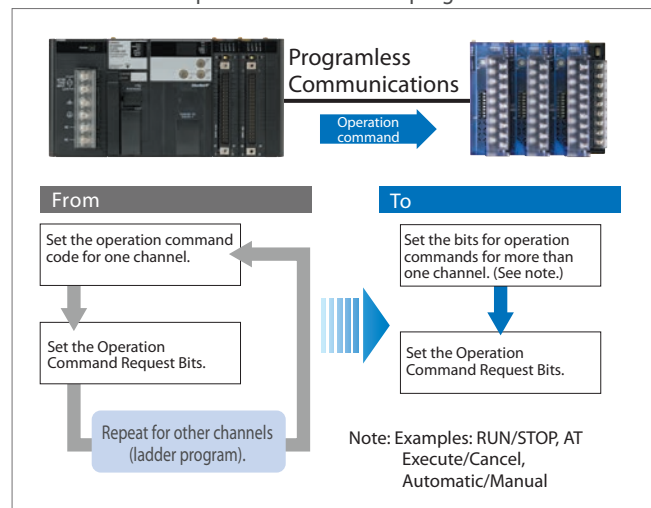

Connectivity
and
Compatibility

Screen templates for the EJ1 are a standard feature in the NB-series PTs. There is no need to create basic screens, such as for monitoring the process value, the set point, or the manipulated variable.

Setting (1)					Unit: 1
	CH1	CH2	CH3	CH4	
P	50.0	48.0	32.5	18.0	
I	5	6	10	5	
D	1.0	2.0	3.1	0.3	
STATUS	Change OK	Change OK	Change OK	Change OK	

Examples of Standard Screens

- Monitoring the Process Value (PV), Set Point (SP), or Manipulated Variable (MV)
- Displaying the status during RUN, STOP, Manual Mode, or AT operation
- Displaying the status of the two alarms using lamps
- RUN/STOP and AT Execute/Cancel operations for each channel

Note: Refer to the NB Series Programmable Terminal (Cat. No. V106-E1-11) for details.




New Functions

Functionality, Connectivity, and Compatibility

Easy Installation and Setup

CX-
Thermo
Ver.UP


The CX-Thermo Support Software supports multi-node settings to eliminate the need to change cable connections. It can be easily connected to any EJ1 Controller in a multi-node network.

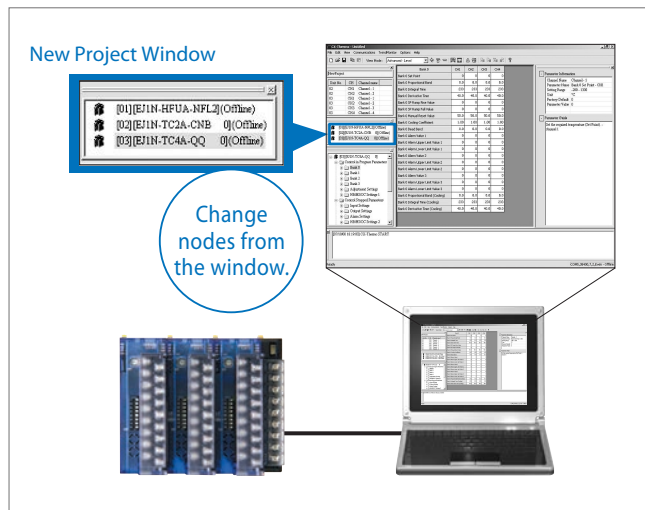

Flexible Control and Adjustments

TC
Ver.UP

Independent heating/cooling PID control (see note) and autotuning (AT) for heating/cooling are provided for devices such as extruders.

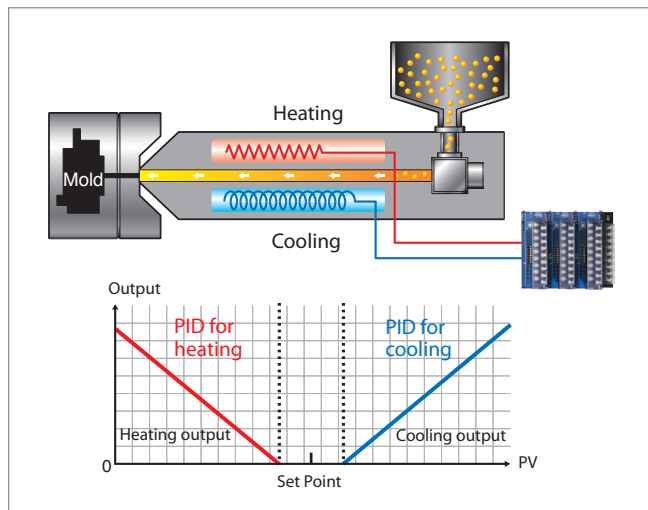

Note: This control method allows independently setting PID control for heating and cooling.

TC
Ver.UP

A switch can be set to enable monitoring the output status on the operation indicators. The output status when a device is starting can be checked without using any special software. The communications baud rate settings and protocol changes for Modbus can also be set on a DIP switch.

Operating

Operation Indicator	Indicator
PWR/1	Lit green while power is ON.
RUN/2	Lit green during operation.
ERR/3	Flashes or lights red when an error occurs.
ALM/4	Lights red when an alarm occurs.


Monitoring Output Status (New Function)

Operation Indicator	Indicator
PWR/1	Lit green while OUT1 is ON.
RUN/2	Lit green while OUT2 is ON.
ERR/3	Lit red while OUT3 is ON.
ALM/4	Lit red while OUT4 is ON.

Note: Pin 6 of switch 2 can be turned ON or OFF while the power is ON. Normally keep this pin set to OFF so that operation status can be checked.

TC
Ver.UP

Self-tuning (ST) (see note) can be used when AT is difficult to use to control devices with a large heating capacity.

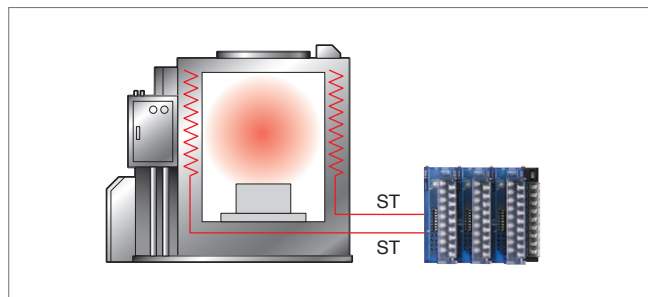

Note: Self-tuning (ST) finds the PID constants by using step response tuning (SRT) when the EJ1 is operating or the set point is changed.


Basic Functions

Flexibility Build Advanced Temperature Control Systems

Basic Functions

Smaller Control Panels

The EJ1 is the same size as PLCs to eliminate dead space.

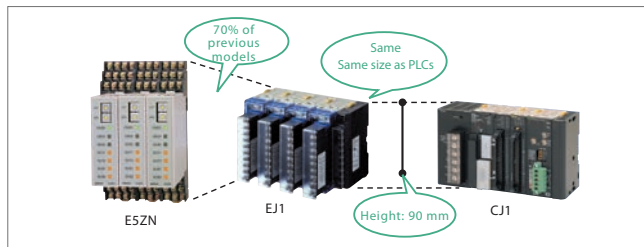


Reduces Customer Inventory

Fully universal inputs for all input points to reduce inventory.




Easy Installation and Wiring

Easy operation with one-touch terminal block attachment and removal and screw-less clamp terminals.

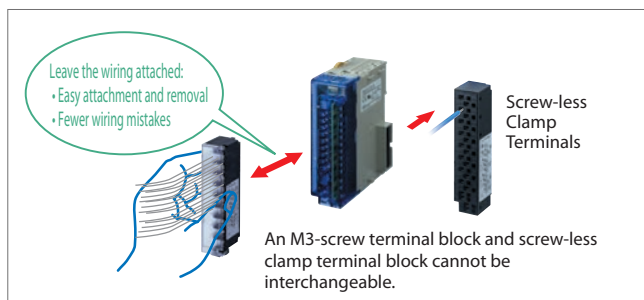


Reliable Basic Functions and Quality

Operates at ambient temperature up to 55°C! UL, CE, and RoHS compliant.

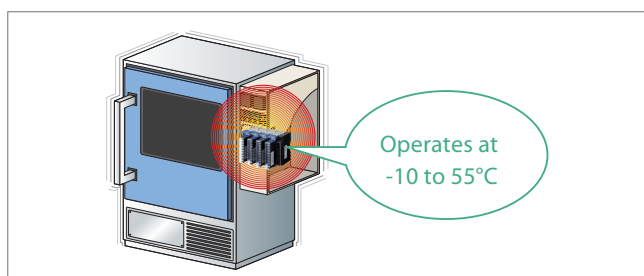


System Configuration

System with High Function Unit (HFU)

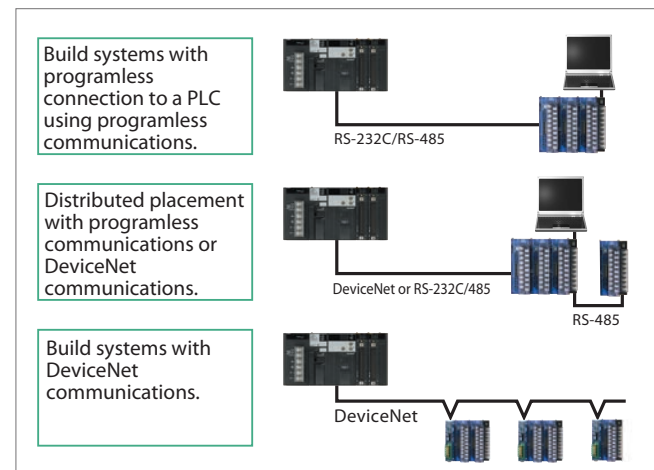

Programless Communications for 1,024-channel Systems


Up to 8 HFUs (see note) can be connected to a PLC.
Up to 32 Basic Units can be connected to each HFU. (See note.)

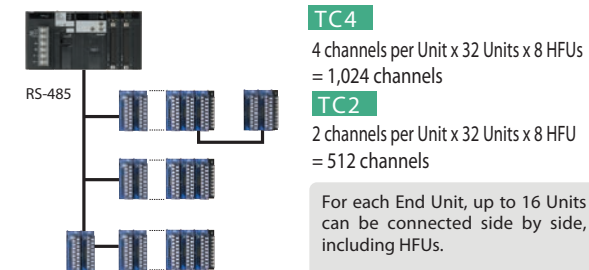

Note: EJ1N-HFU@-NFL@

Build 200-channel Systems with DeviceNet Communications

Up to 63 HFUs (see note) can be connected to a PLC.
Up to 16 Basic Units can be connected to each HFU. (See note.)


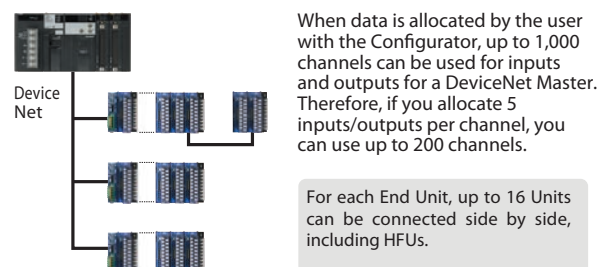


Note: EJ1N-HFUB-DRT

Applications



Electric Component Furnaces

The EJ1 can control up to 1,024 channels with programless communications. Monitoring of multipoint heater temperatures and integrated processing with high-precision controls are easy for continuous furnaces to create a system without waste.

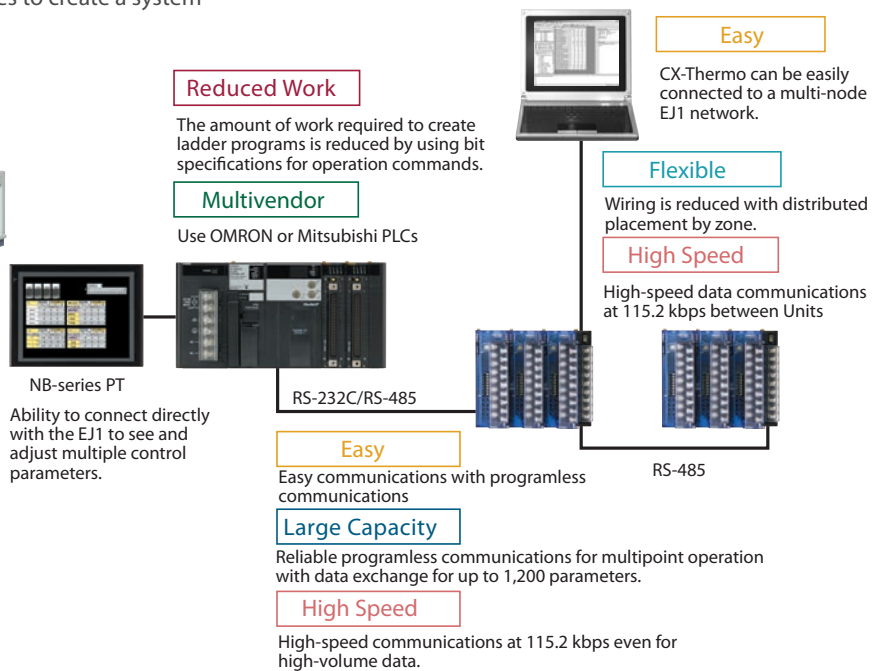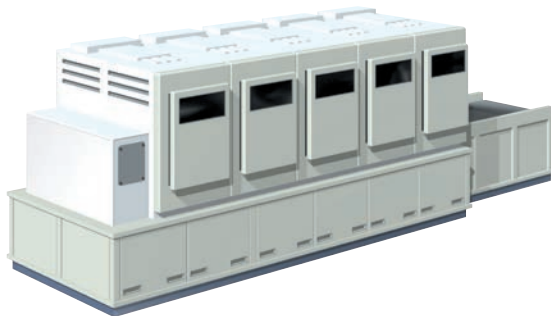

Molding Machines

Independently set heating/cooling PID control improves control of molding machines. OMRON's unique optimum cycle control improves the power factor and reduces energy consumption.

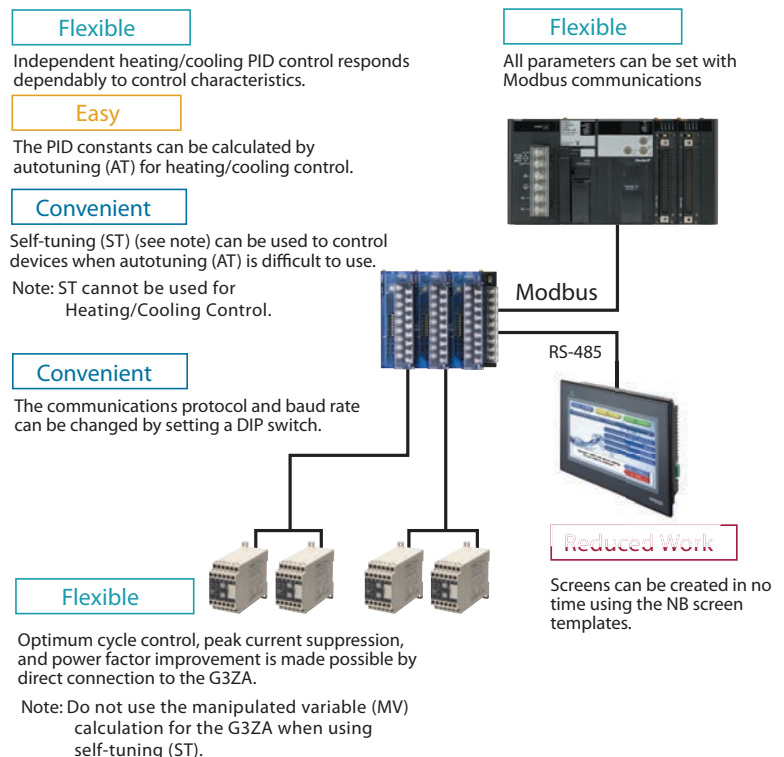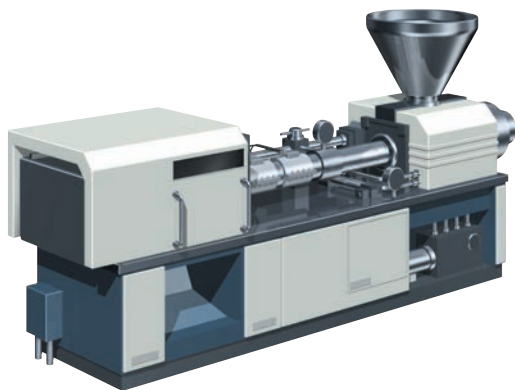

The above application examples are provided for reference only. Always confirm devices, equipment functions, and safety before using the EJ1 in any specific application. When using the EJ1 in applications requiring special attention to safety, be sure there is sufficient margin in ratings and performance and take suitable safety measures, such as installing failsafe measures. Also, consult with your OMRON representative and confirm specifications and other related documents.

Ordering Information

Temperature Controller

Standard Control Models

Name	Power supply voltage	No. of control points	Control outputs 1 and 2	Control outputs 3 and 4	Auxiliary outputs	Functions		Communications functions	Input type	Terminal	Model
						Heater burnout alarm	Event inputs				
Basic Unit (temperature control) (See note 1.) Ver.1.2	24 VDC supplied from the End Unit	2	Voltage output: 2 points (for SSR drive) (See note 2.)	Transistor output: 2 points (sinking)	None	2 (See note 3.)	2	G3ZA connection port: RS-485 From End Unit: Port A or port B: RS-485	Thermocouple, platinum resistance thermometer, analog voltage, and analog current selectable for each channel.	M3 terminal	EJ1N-TC2A-QNHB
		4		Voltage output: 2 points (for SSR drive) (See note 2.)			None			Screw-less clamp	EJ1N-TC2B-QNHB
										M3 terminal	EJ1N-TC4A-QQ
										Screw-less clamp	EJ1N-TC4B-QQ
HFU with Programless Communications (See note 1.) Ver.1.2	24 VDC	2	Current output: 2 points	Transistor output: 2 points (sinking)	None		2	Port C: RS-485 or RS-232C selectable. From End Unit: Port A: RS-485 Port C: RS-422 From End Unit: Port A: RS-485	No input	M3 terminal	EJ1N-TC2A-CNB
										Screw-less clamp	EJ1N-TC2B-CNB
										M3 terminal	EJ1N-HFUA-NFLK
										Screw-less clamp	EJ1N-HFUB-NFLK
HFU with DeviceNet Communications (See note 1.)	24 VDC	None	None	None	Transistor output: 4 points (sinking)		4	DeviceNet communications	No input	M3 terminal	EJ1N-HFUA-NFL2
										Screw-less clamp	EJ1N-HFUB-NFL2
										M3 terminal	EJ1N-HFUA-NFL2
										Screw-less clamp	EJ1N-HFUB-NFL2
End Unit (See note 1.)	24 VDC				None		None	Port A or B: RS-485 Connector: Port A	No input	Screw-less clamp	EJ1N-HFUB-DRT
										Screw-less clamp	EJ1N-HFUB-DRT
End Unit (See note 1.)	24 VDC				Transistor output: 2 points (sinking)		None	Port A or B: RS-485 Connector: Port A	No input	M3 terminal	EJ1C-EDUA-NFLK
										Detachable connector	EJ1C-EDUC-NFLK

Note 1: An End Unit is always required for connection to a Basic Unit or an HFU. An HFU cannot operate without a Basic Unit. External communications cannot be performed when using a Basic Unit only.

Note 2: For heating/cooling control applications, control outputs 3 and 4 on the 2-point models are used for the cooling or heating control outputs.

On the 4-point models, heating/cooling control is performed for the two input points.

Note 3: When using the heater burnout alarm, purchase a Current Transformer (E54-CT1 or E54-CT3) separately.

Accessories (Order Separately)

Current Transformer (CT)

Diameter	Model
5.8 dia.	E54-CT1
12.0 dia.	E54-CT3

CX-Thermo Support Software Ver. 4.1

Model
EST2-2C-MV4

G3ZA Connecting Cable

Cable length	Model
5 m	EJ1C-CBLA050

USB-Serial Conversion Cable

Model
E58-CIFQ1

Rail Mounting Equipment

Name	Model
Mounting Rail	PFP-100N
	PFP-50N

OMRON AUTOMATION AND SAFETY • THE AMERICAS HEADQUARTERS • Chicago, IL USA • 847.843.7900 • 800.556.6766 • www.omron247.com

OMRON CANADA, INC. • HEAD OFFICE

Toronto, ON, Canada • 416.286.6465 • 866.986.6766 • www.omron247.com

OMRON ELECTRONICS DE MEXICO • HEAD OFFICE

México DF • 52.55.59.01.43.00 • 01-800-226-6766 • mela@omron.com

OMRON ELECTRONICS DE MEXICO • SALES OFFICE

Apodaca, N.L. • 52.81.11.56.99.20 • 01-800-226-6766 • mela@omron.com

OMRON ELETRÔNICA DO BRASIL LTDA • HEAD OFFICE

São Paulo, SP, Brasil • 55.11.2101.6300 • www.omron.com.br

OMRON ARGENTINA • SALES OFFICE

Cono Sur • 54.11.4783.5300

OMRON CHILE • SALES OFFICE

Santiago • 56.9.9917.3920

OTHER OMRON LATIN AMERICA SALES

54.11.4783.5300

OMRON EUROPE B.V. • Wegalaan 67-69, NL-2132 JD, Hoofddorp, The Netherlands. • +31 (0) 23 568 13 00 • www.industrial.omron.eu