


FOR APPROVAL - NOT FOR CONSTRUCTION

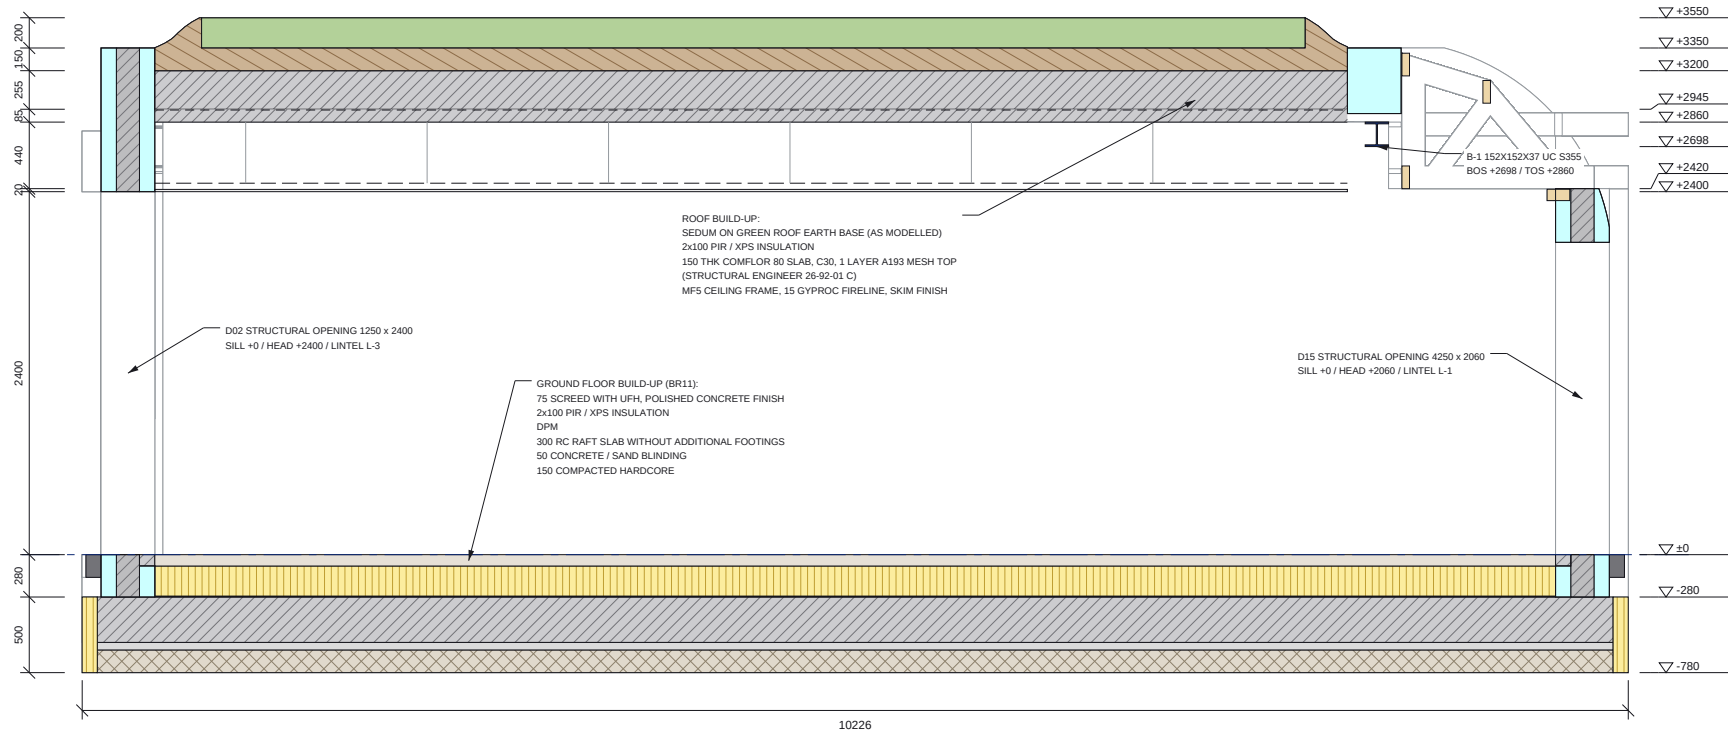

SECTION B-B

Scale 1:50 @ A3 | Looking north; levels above GF FFL

ICF EPS (cut)	Insulation (PIR / XPS, perimeter)	Masonry wall (cut)
ICF concrete core / RC (cut)	Blinding / hardcore	Suspended ceiling (MF5 + 15 Fireline)
Steel (cut)	Roof earth	Comflor 80 deck (profile line)
Screed	Sedum	Beyond the cut (line work)



SECTION B-B SCHEDULES


LEVELS ON THIS SECTION

Level	FFL	AOD
underside of hardcore	-780	142.970
underside of ICF / top of RC raft	-280	143.470
GF FFL	0	143.750
underside of suspended ceiling	+2400	146.150
top of ICF	+2420	146.170
B-1 BOS	+2698	146.448
underside of Comflor deck	+2860	146.610
roof slab soffit	+2945	146.695
top of roof slab	+3200	146.950
top of ICF	+3350	147.100
top of roof build-up	+3550	147.300

STEEL CUT BY THIS SECTION

Mark	Section (engineer)	BOS	TOS
B-1	152x152x37 UC S355 with 10mm top plate	+2698	+2860

SECTION KEY

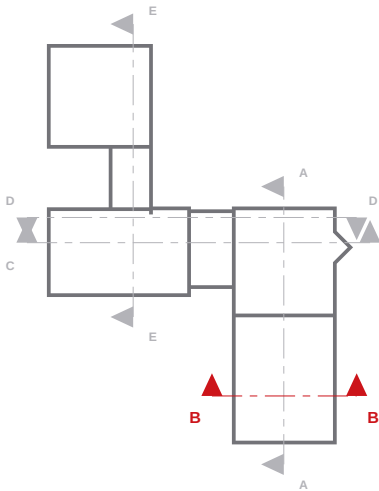

NOTES

- Section B-B on the line of the architect's section (BR12). Cut elements hatched / filled; the model beyond the cut in line work.
- Levels above GF FFL (143.750 AOD); the level table gives AOD.
- ICF: Nudura 6" XR35, 101.6 EPS + 152.4 C30 core + 101.6 EPS = 355.6. EXT ICF150: 150mm core ICF walls, concrete grade C30, 10mm aggregate; polypropylene fibre reinforcement, dosage 2.5kg/m³; H16 dowel bars between lifts @ max 450mm c/c, 800mm long with 200mm embedment, resin fixed.
- Ground floor (BR11): 75 screed with UFH / 200 PIR-XPS / DPM / 300 RC raft slab without additional footings / 50 blinding / 150 compacted hardcore; 100 perimeter insulation outside the ICF. Thresholds: ICF cut to -75 under the screed, concrete infill, ACO drain (size assumed 100x150).
- Roof: 150 thk Comflor 80 slab, C30, 1 layer A193 mesh top (26-92-01 C); green roof build-up (earth + sedum) as modelled; waterproofing to specialist design. Timber roof over the east wall to specialist supplier design. Comflor 80 deck drawn to the architect's profile (80 deep, 300 pitch) on the bearing steel / walls; MF5 suspended ceiling, 15 Gyproc Fireline, FFL to underside 2400 (BR11-13), drawn only.
- Steel marks, BOS / TOS: Carb Zero 26-92-01 rev C. See UKPCS-002-GA-01 / EL-01 / EL-02.

REVISIONS

REV	DATE	DESCRIPTION
P01	14.09.26	Approval issue



CLIENT	PROJECT
Mr A Kirkpatrick	11767 Horrobin Farm, Turton

DRAWING TITLE			
SECTION B-B			
ICF section with levels and build-ups			

SCALE	SIZE	DATE	DRAWN
1:50	A3	14.09.26	TS

STATUS	DRAWING No.	REV
FOR APPROVAL	UKPCS-002-SE-02	P01