

THRESHOLD DETAIL - EXTERNAL SCHEDULE

OPENINGS WITH THIS THRESHOLD

| Ref             | Width | Sill | Head  | Lintel |
|-----------------|-------|------|-------|--------|
| CW04            | 1338  | -20  | +2120 | L-2    |
| CW05            | 3899  | 0    | +2400 | L-17   |
| CW08            | 3250  | 0    | +2400 | L-14   |
| CW09            | 2200  | 0    | +2400 | L-15   |
| CW10            | 2200  | 0    | +2200 | L-15   |
| CW13            | 2875  | 0    | +2400 | L-10   |
| CW14            | 2875  | 0    | +2400 | L-10   |
| CW01, D01, CW02 | 3898  | 0    | +2400 | L-16   |
| D02             | 1250  | 0    | +2400 | L-3    |
| D1              | 5575  | 0    | +2400 | -      |
| D15             | 4250  | 0    | +2060 | L-1    |
| D2              | 5125  | 0    | +2400 | L-13   |
| D3              | 7855  | 0    | +2400 | L-7    |

Structural openings; sill and head above GF FFL. VOID = subtract cut in the ICF (no end caps).

LEVELS IN THIS DETAIL

| Level                                          | FFL  | AOD     |
|------------------------------------------------|------|---------|
| underside of hardcore                          | -780 | 142.970 |
| underside of blinding                          | -630 | 143.120 |
| underside of raft                              | -580 | 143.170 |
| underside of ICF / top of RC raft              | -280 | 143.470 |
| DPM / top of raft                              | -275 | 143.475 |
| underside of ACO                               | -150 | 143.600 |
| ICF cut / top of insulation / threshold infill | -75  | 143.675 |
| underside of bottom buck (external only)       | -63  | 143.687 |
| GF FFL / top of screed                         | 0    | 143.750 |

NOTES

- Threshold detail cut square to the wall through D02; applies to every opening listed (same threshold type).
- External floor-level threshold: internal EPS leaf of the ICF cut to -75 (under the 75 screed), concrete infill -75 to the sill, ACO drain against the external face (size not given on the drawings: 100x150 assumed, opening width + 300 each side).
- Architect's threshold note (BR11 / BR12 / BR13): "Rebated curtain wall framing to suit level of access. PPC aluminium flashing to threshold. Below FFL ICF block 200mm high." Door / curtain wall frame, flashing and finishes by others, not shown.
- Ground floor build-up BR11. Levels above GF FFL (143.750 AOD). ICF Nudura 6" XR35; BCDS bottom buck / end cap as modelled.

REVISIONS

| REV | DATE     | DESCRIPTION                                               |
|-----|----------|-----------------------------------------------------------|
| P01 | 14.09.26 | Approval issue                                            |
| P02 | 15.09.26 | CW13 lintel L-18 revised to L-10 (engineer, EQ-01 closed) |




|                  |                             |
|------------------|-----------------------------|
| CLIENT           | PROJECT                     |
| Mr A Kirkpatrick | 11767 Horrobin Farm, Turton |

|                             |
|-----------------------------|
| DRAWING TITLE               |
| THRESHOLD DETAIL - EXTERNAL |

ICF threshold detail

|       |      |          |       |
|-------|------|----------|-------|
| SCALE | SIZE | DATE     | DRAWN |
| 1:10  | A3   | 15.09.26 | TS    |

|              |                 |     |
|--------------|-----------------|-----|
| STATUS       | DRAWING No.     | REV |
| FOR APPROVAL | UKPCS-002-DT-01 | P02 |

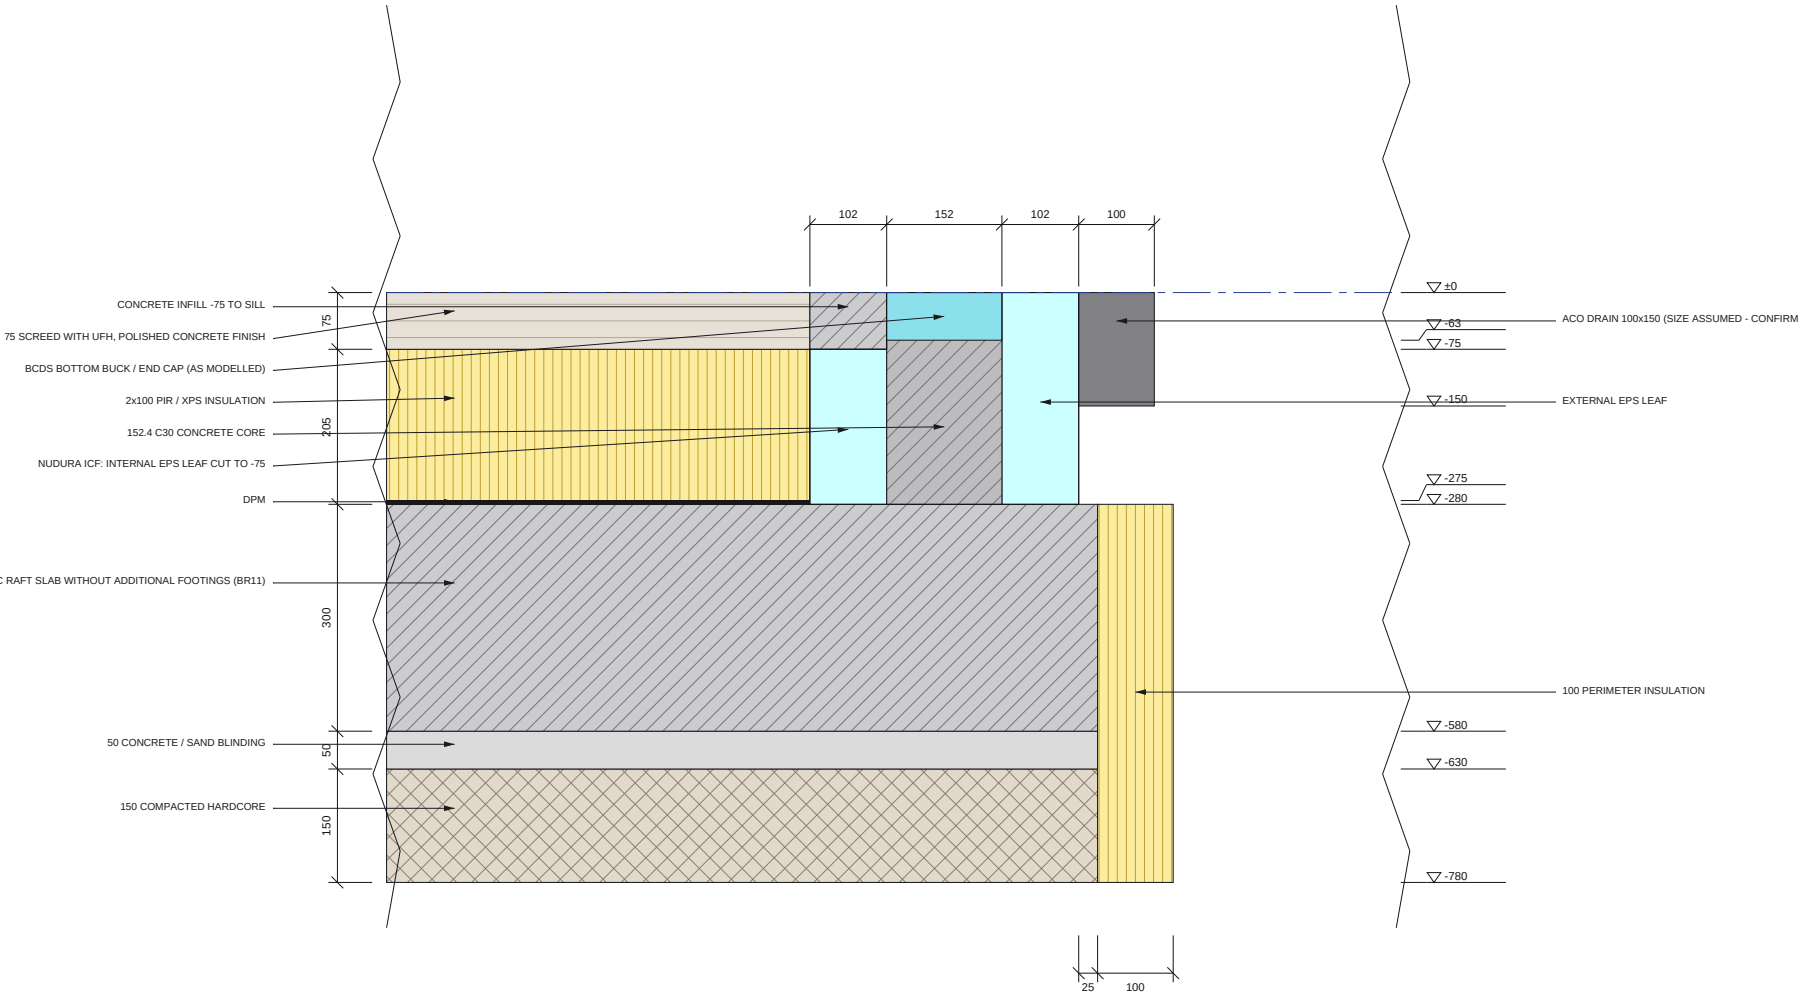

THRESHOLD DETAIL - EXTERNAL (AT D02)

Scale 1:10 @ A3 | Section square to the wall through the opening; external side to the right

