



FOR APPROVAL - NOT FOR CONSTRUCTION

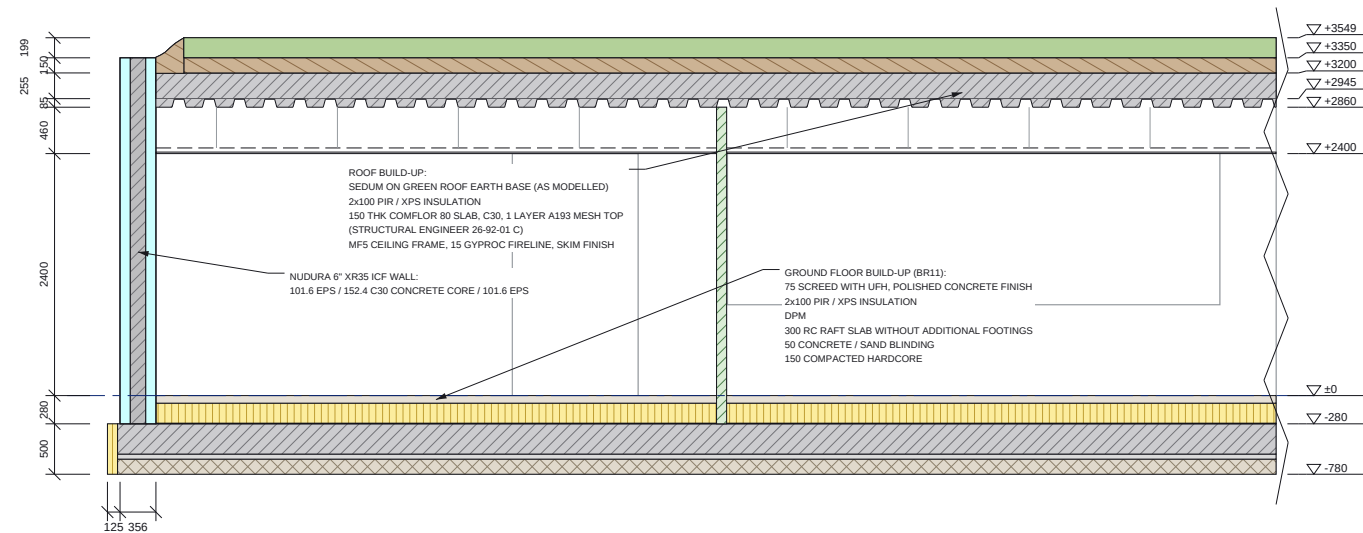


SECTION A-A (PART 1 OF 2)

Scale 1:75 @ A3 | Looking west; levels above GF FFL

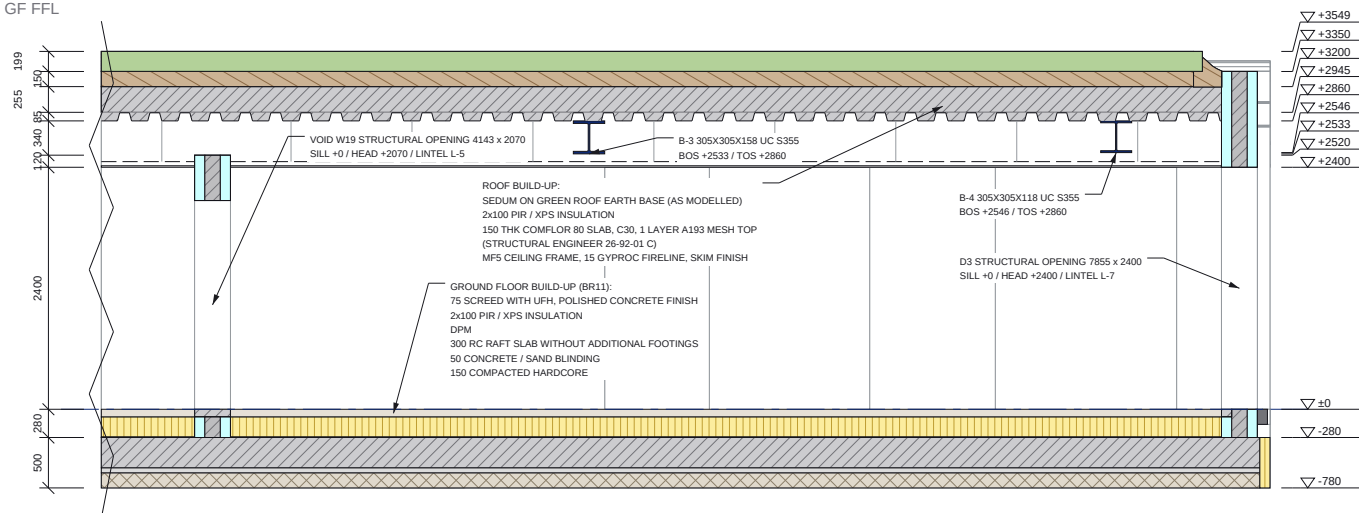

SECTION A-A (PART 2 OF 2)

Scale 1:75 @ A3 | Looking west; levels above GF FFL



SECTION A-A SCHEDULES


LEVELS ON THIS SECTION

Level	FFL	AOD
underside of hardcore	-780	142.970
underside of ICF / top of RC raft	-280	143.470
GF FFL	0	143.750
underside of suspended ceiling	+2400	146.150
top of ICF	+2520	146.270
B-3 BOS	+2533	146.283
B-4 BOS	+2546	146.296
underside of Comflor deck	+2860	146.610
roof slab soffit	+2945	146.695
top of roof slab	+3200	146.950
top of ICF	+3350	147.100
top of roof build-up	+3549	147.299

STEEL CUT BY THIS SECTION

Mark	Section (engineer)	BOS	TOS
B-3	305x305x158 UC S355 with 200x100x10 ledger angles both sides	+2533	+2860
B-4	305x305x118 UC S355 with 200x100x10 ledger angles both sides	+2546	+2860

SECTION KEY

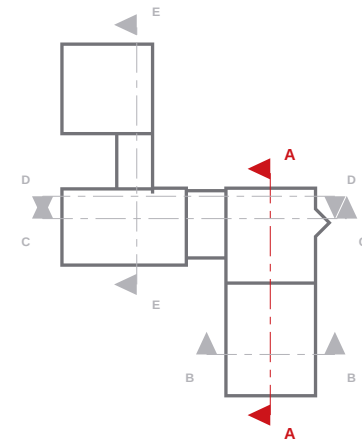

NOTES

1. Section A-A on the line of the architect's section (BR11). Cut elements hatched / filled; the model beyond the cut in line work.
2. Levels above GF FFL (143.750 AOD); the level table gives AOD.
3. ICF: Nudura 6" XR35, 101.6 EPS + 152.4 C30 core + 101.6 EPS = 355.6. EXT ICF150: 150mm core ICF walls, concrete grade C30, 10mm aggregate; polypropylene fibre reinforcement, dosage 2.5kg/m³; H16 dowel bars between lifts @ max 450mm c/c, 800mm long with 200mm embedment, resin fixed.
4. Ground floor (BR11): 75 screed with UFM / 200 PIR-XPS / DPM / 300 RC raft slab without additional footings / 50 blinding / 150 compacted hardcore; 100 perimeter insulation outside the ICF. Thresholds: ICF cut to -75 under the screed, concrete infill, ACO drain (size assumed 100x150).
5. Roof: 150 thk Comfor 80 slab, C30, 1 layer A193 mesh top (26-92-01 C); green roof build-up (earth + sedum) as modelled; waterproofing to specialist design. Timber roof over the east wall to specialist supplier design. Comfor 80 deck drawn to the architect's profile (80 deep, 300 pitch) on the bearing steel / walls; MF5 suspended ceiling, 15 Gyproc Fireline, FFL to underside 2400 (BR11-13), drawn only.
6. Steel marks, BOS / TOS: Carb Zero 26-92-01 rev C. See UKPCS-002-GA-01 / EL-01 / EL-02.

REVISIONS

REV	DATE	DESCRIPTION
P01	14.09.26	Approval issue



CLIENT	PROJECT
Mr A Kirkpatrick	11767 Horrobin Farm, Turton

DRAWING TITLE

ICF section with levels and build-ups

SCALE	SIZE	DATE	DRAWN
1:75	A3	14.09.26	TS

STATUS	DRAWING No.	REV
FOR APPROVAL	UKPCS-002-SE-01	P01