



EQ-02 D1: steel B-6 as the head of the 5575 opening (confirm interpretation)

Status: Open | see GA-01

Engineer Carb Zero 26-92-01 rev C

ICF model (GA-01)

Section at D1 (model)

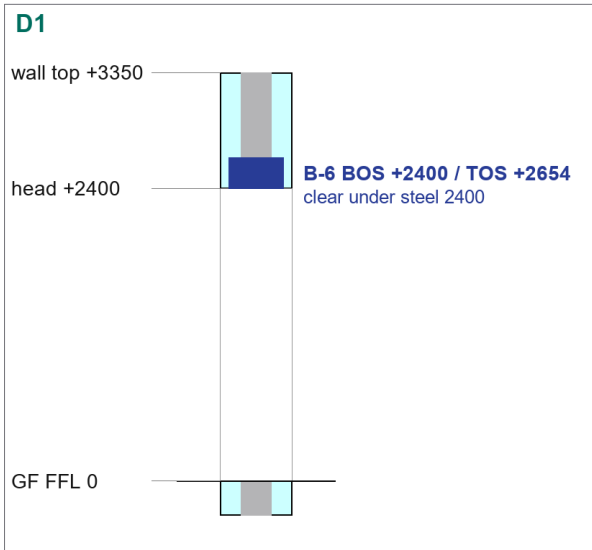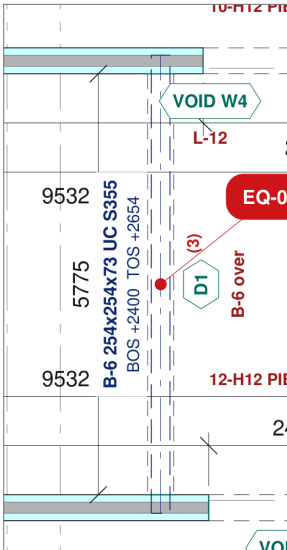

ISSUE D1 is the 5775 wide full-length opening in the ICF wall between the conservatory and the room to its east (Wall 21). Your drawing gives it no lintel mark and shows B-6 254x254x73 UC S355 (with 200x100x10 ledger angle one side) along that line. We have modelled B-6 at BOS +2400 / TOS +2654 as the head of the opening, with the structural opening in the ICF up to +2654 and ICF over the steel to the wall top at +3350, giving 2400 clear under the steel.

QUESTION Please confirm that B-6 forms the head of D1 as described (clear opening 2400 under B-6, ICF bearing on the steel above), or advise the intended arrangement.

ENGINEER'S RESPONSE



Name / date:

EQ-03 Option B: steel lengths and bearings with the external ICF moved 100mm in

Status: Open | see GA-01

Engineer Carb Zero 26-92-01 rev C

ICF model (GA-01)

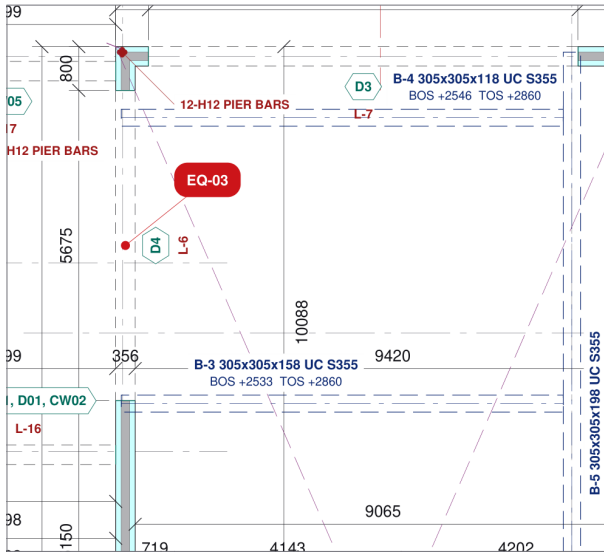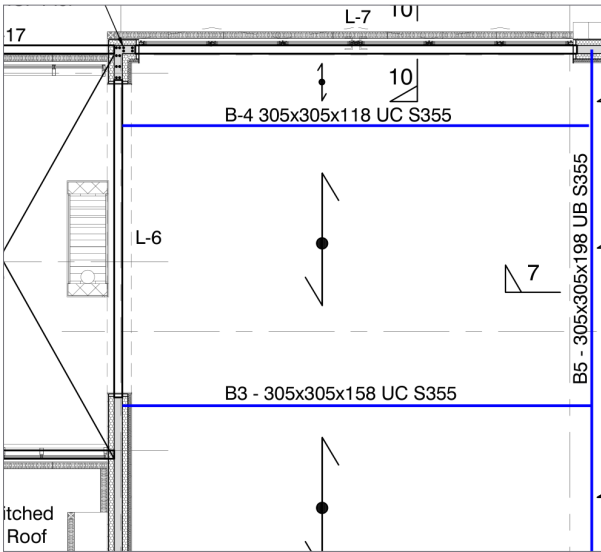

ISSUE In Option B every external ICF wall moves 100mm in from the RC raft edge. Steels have been adjusted to keep their bearing into the ICF: B-3, B-4 (west ends) and B-5 (north end), B-1 (south end) and B-7 (east end) are 100mm shorter; B-9 (south end) and the tie (west end) are 100mm longer; B-6 moves 100mm east and is 200mm longer (D1 5775). B-2, B-8 and C-1 are unchanged. The engineer's pier bars and wall starters move with the ICF corners and junctions; lintel spans over VOID W4 / W7 reduce by 200mm, D1 / CW05 / CWO1 openings widen by 200mm.

QUESTION Please confirm the steel lengths / bearings, the 200mm longer B-6 and the relocated pier bars are acceptable for Option B, and whether the RC raft edge detail (ICF now ~125mm in from the slab edge) needs revising.

ENGINEER'S RESPONSE

Name / date:

QUESTIONS REGISTER

QUERIES

Ref	Subject	Drawing	Status
EQ-02	D1: steel B-6 as the head of the 5575 opening (confirm interpretation)	GA-01	Open
EQ-03	Option B: steel lengths and bearings with the external ICF moved 100mm in	GA-01	Open

NOTES

- Questions raised on the ICF approval drawings against the structural engineer's drawing Carb Zero 26-92-01 rev C.
- Each panel shows the engineer's drawing beside the architect's drawing and/or the ICF model, cropped to the same area.
- Please answer in the response box of each question (or by email quoting the EQ reference); the approval drawings will be revised to suit.
- EQ tags on the GA drawings link to these panels.

REVISIONS

REV	DATE	DESCRIPTION
P01	15.09.26	Approval issue - Option B: external ICF 100mm in from slab edge



CLIENT	PROJECT
Mr A Kirkpatrick	11767 Horrobin Farm, Turton

DRAWING TITLE
QUESTIONS FOR THE ENGINEER

Structural queries on the ICF approval drawings - sheet 1 of 1

SCALE	SIZE	DATE	DRAWN
NTS	A3	15.09.26	TS

STATUS	DRAWING No.	REV
FOR APPROVAL	UKPCS-002-EQ-01B	P01