
PRICE SCOPE: only the Nudura ICF formwork and associated accessories are included in our price.
All other structure and information shown is supplied in good faith for coordination only and must be checked by the relevant professional.

QUOTATION - NOT FOR CONSTRUCTION

TRUSS TYPE T1 - MAIN ROOF

Scale 1:50


T1 FINK (W) TRUSS - 32 No.

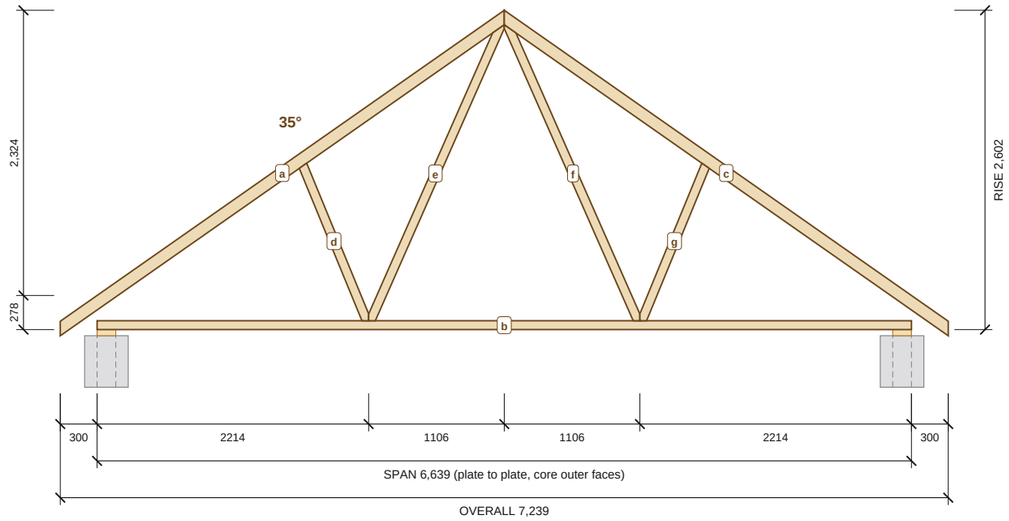

TRUSS TYPE M1 - PORCH LEAN-TO

Scale 1:25


M1 MONO - HUNG ON STEEL PS01 - 6 No.

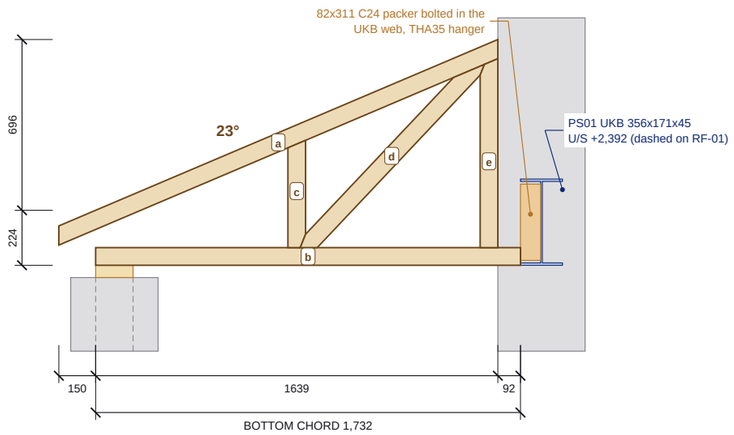

TRUSS TYPE M2 - PORCH LEAN-TO

Scale 1:25

M2 MONO - END TRUSS ON LEDGER - 2 No.

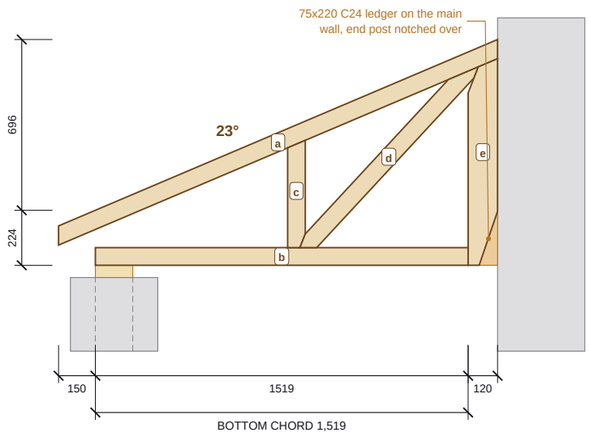

TRUSS TYPES

T1 FINK - 32 NO.

	Member	Section	Length
a	top chord	35x97 TR26	4,418
b	bottom chord	35x72 TR26	6,639
c	top chord	35x97 TR26	4,418
d	web	35x72 TR26	1,454
e	web	35x72 TR26	2,740
f	web	35x72 TR26	2,740
g	web	35x72 TR26	1,454

Span 6,639, overall 7,239, pitch 35 deg, rise 2,602, heel 278 (plate top to top of top chord over the core outer face), eaves overhang 300 past the core face, plumb-cut tails. Plate top +5,300, apex +7,902.

M1 MONO - 6 NO.

	Member	Section	Length
a	top chord	35x72 TR26	1,944
b	bottom chord	35x72 TR26	1,732
c	vertical	35x72 TR26	497
d	diagonal	35x72 TR26	1,141
e	end post	35x72 TR26	830

Pitch 23 deg, heel 224, overall 1,882 (low end on the 50 porch wall plate, top +2,392; high end bottom chord in a THA35 hanger on the packer in PS01).

M2 MONO - 2 NO.

	Member	Section	Length
a	top chord	35x72 TR26	1,944
b	bottom chord	35x72 TR26	1,519
c	vertical	35x72 TR26	497
d	diagonal	35x72 TR26	1,117
e	end post	35x120 TR26	842

Pitch 23 deg, heel 224, overall 1,789 (low end on the 50 porch wall plate, top +2,392; high end end post notched over the 75x220 ledger).

NOTES

1. FOR SUPPLIER QUOTES ONLY. The trussed rafter manufacturer designs the final trusses (members, joints, nail plates, bracing) to BS EN 1995-1-1 for the stated loads and confirms all sizes before manufacture.
2. Profiles drawn to scale from the quotation model member geometry: TR26 strength class, 35 wide members, nail-plated joints. Member marks a, b, c ... refer to the member tables.
3. Design brief: concrete interlocking tiles on battens and breathable membrane, plasterboard ceiling, loft not habitable (to be confirmed), snow zone 2, site altitude 47 m, basic wind 24.5 m/s, exposed site.
4. Main roofs bear on 50 deep wall plates on the ICF core of the front and rear walls (plate top +5,300); porch monos bear on the porch wall plate (+2,392) and hang from steel PS01 / sit on the end ledgers.
5. Gable ladders, binders, bracing, clips and hangers are listed on ES26-081-RF-01.

REVISIONS

REV	DATE	DESCRIPTION
Q01	16.10.26	First issue

Nudura™ BuildEase

CLIENT	PROJECT
Beech Developments	Lon Eilian, Caernarfon

DRAWING TITLE
TRUSS PROFILES

Trussed rafter profiles for supplier quotation

SCALE	SIZE	DATE
1:50 / 1:25	A3	16.10.26
DRAWN	CHECKED	APPROVED
TS		

STATUS	DRAWING No.	REV
QUOTATION	ES26-081-RF-02	Q01

Do not scale. All dimensions in mm. Check all dimensions on site.