

Pre-shipment Inspection Report

Report #: PSI20260601-R26052612857

General Information:	
Client name	JFA Medical Ltd
Product name	Tool
Item	Refer to section 1
PO#	N/A
Ordered quantity (Lot size)	18160PCS
Inspection Date	June 1, 2026
Arrival time	8:50
Departure time	16:28
Supplier name	NINGBO LIKESGREEN INDUSTRIAL CO.,LTD
Factory name	NINGBO LIKESGREEN INDUSTRIAL CO.,LTD
Inspection location	Yuyao, Ningbo, Zhejiang Province



Inspection Summary					
Inspection Sections	Conform?	Remarks			
1. Product quantity check	Fail	Remark 1.1,1.2			
2. Workmanship appearance/ Function inspection	Within AQL		Cr	Ma	Mi
		Found	0	0	0
		Max Allowed	0	/	/
		Sample Size	204	204	204
		Most serious defects found: /			
3. Test checking/Special check points	Pass				
4. Packing/Packaging	Pending	Remark 4.1			
5. Shipping marks/Label/Marking	Fail	Remark 5.1,5.2			
6. Product conformity/Measurement	Pending	Remark 6.1			

Conclusion	Fail (Client has the final decision to Reject or Approve)
-------------------	---

AQI Remark	
1	Quantity Check
1.1.	Upon the arrival, all products were 87.84%(15952pcs) finished and 87.84% packed into cartons.
1.2.	For item JF1098: No products were found in the factory.
2	Workmanship
2.1.	Selected 204pcs samples for inspection, found 0pcs major defects and 0pcs minor defects.

3	Testing and special check points
3.1.	On site testing was passed.
4.	Packing Check
4.1.	For item JF1153: About 10.5 cm of extra space was found on top of carton.
5.	Shipping marks inspection/Marking/Label
5.1	For items JF1092&JF1411: the product stickers do not match the client's specifications.
5.2	Some outer box shipping marks and stickers/barcode, the guest did not provide any information. Please see actual found.
6	Product conformity inspection
6.1	No approval sample was provided for comparison during the inspection.

Pictures of remarks

Remark #4.1: For item JF1153: About 10.5 cm of extra space was found on top of carton.



Remark #5.1 For item JF1092&JF1411: the product stickers do not match the client's specifications.



JF1092 (all colors)

Spec

	
JF1411	Spec

Manufacturer Signature	IVY	AQI Inspector	Carl	AQI Report Approver	Helen
---------------------------	-----	---------------	------	------------------------	-------

Inspection Method Applied:

Inspection type	Pre-Shipment Inspection					
Inspection Standard	ANSI/ASQ Z1.4 (ISO2859-1)					
Sampling plan	Single, normal					
Inspection level	Fixed					
AQL:	Cri.	0	Maj.:	-	Min.:	-
Sample size inspected	204pcs					
Total number of AVAILABLE cartons:	341ctns					
Quantity for selected cartons	4ctns					
Carton # of the selected cartons	N/A					

1. Product Quantity Inspection:

Item No.	Description	Ordered Qty.(Pcs)	Available Qty.(Pcs)	Packed Cartons	Unpacked Cartons	Not finished QTY	Sample Size	
							Pieces	Cartons
JF0170	Tool	5504	5504	172	0	0	32	1
JF1092		3808	3808	119	0	0	32	1
JF1411		1600	1600	8	0	0	20	1
JF1098		2208	0	0	0	2208	0	0
JF1153		5040	5040	42	0	0	120	1
Total		18160	15952	341	0	2208	204	4

2. Workmanship Appearance / Function inspection

#	Description	Cri.	Maj.	Min.	Remarks
/	No defect was found	/	/	/	Rework
Total Defects		0	0	0	Within AQL
Maximum allowed Defects		0	/	/	
Sample size		204	204	204	
Pictures of defects					
/		/			

3. Reliability Tests/Special Check Points

#	Testing Description	Sample Size	Result	Remark
3.1	Barcode scanning test	S-2	Pass	
	Barcode should be read easily and correctly			
3.2	Uniformity check	All samples	Pass	
	Size and Shape Consistency among mass products			
3.3	Softness test	S-2	Pass	
	Color coding aligns with resistance			
3.4	Color shade check	S-2	Pass	
	Color check among inspected samples			
3.5	Smell check	All samples	Pass	
	No strong or irritative smell is allowed on the product.			
3.6	Unit packaging quantity check	S-2	Pass	
	Consistent with the spec			
3.7	Functional tests	S-2	Pass	
	Normal function should be OK			
3.8	Post-Inspection Sample Handling check	-	Pass	Destroy
	Retain or Destroy			
3.9	Documentation check	1 pc/item	Pass	
	Check health indicator reports and ingredient reports			

Pictures of Tests



Barcode scanning test



Barcode scanning test





Color shade check



Color shade check



Smell check




Smell check





Functional tests

Functional tests

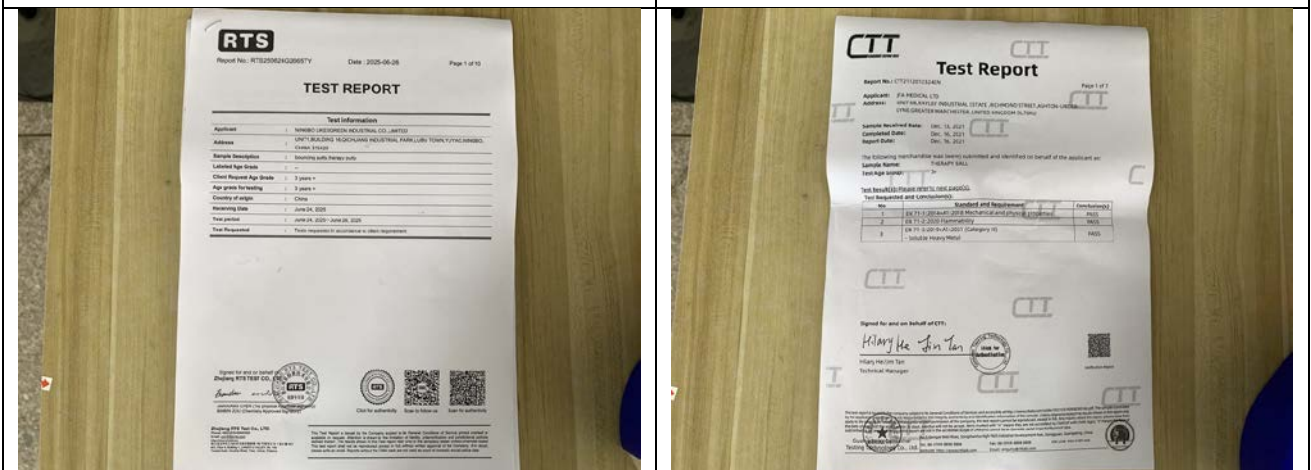

Documentation check	Documentation check
---------------------	---------------------

4. Packing/Packaging Inspection

#	Check Points	Result	Remarks
4.1.	Packing Method	Pass	Please see actual found
4.2.	Packing Quantity	Pass	Please see actual found
4.3.	Metal staples on carton	N/A	
4.4.	Polybag with warning clause/Polybag with Air holes	N/A	Sealing
			Warning text
			Punch holes
			☐ Yes
			☐ Yes
			☐ Yes
			☐ No
			☐ No
			☐ None
4.5.	Desiccant	N/A	
4.6.	Tissue paper	N/A	
4.7.	Carton filling has no over-packed, no gap, no crash are allowed	Pending	Remark 4.1
4.8.	No found mixed sizes cartons	Pass	
4.9.	If the packaging check conform to client's documents	Pass	
4.10.	Carton size/weight	Pending	Please see below

Item#	Qty (Pcs)		Carton size(cm)		Carton weight(Kg)	
	Inner box	Outer carton	Spec	Actual	Spec	Actual
JF0170	5	32	35*35*31.5	35*35.5*32	12.5	12.4
JF1092	5	32	35*35*31.5	35*35.8*32	12.5	12.45
JF1411	/	200	35.5*35.5*19.7	36*35.5*20	14.2	14.2
JF1153	30	120	51*42*48	50.7*42*48	8.5	8.85

5. Shipping Marks /Label/Marking Inspection

#	Check points	Result	Remarks
5.1	Shipping mark	Pending	Remark 5.2
5.2	Barcode Verification	Pass	Barcode on Shipping package: Y Barcode on Retail packaging / Product: Y
5.3	Care/composition label	N/A	
5.4	Country origin label	Pass	
5.5	Poly bag printing / label	N/A	
5.6	Inner box printing / label	N/A	
5.7	Other label or marking	Fail	Remark 5.1

6. Product Conformity / Measurement Inspection:

#	Check Points	Result	Remarks
6.1	Product Overview	Pass	
	Requirement:		

6.2	Sample Comparison	Pending	No approval sample for reference
	Requirement:		
6.3	Product size/Weight	Pending	Please see blew
	Requirement:		
6.4	Other size or measurement	N/A	
	Requirement:		


Client's requirement:

Item#	Product size on spec	Sample 1	Sample 2	Sample 3
JF0170	/	15*8.5CM	15*8.5CM	15*8.5CM
JF1092	/	15*8.5CM	15*8.5CM	15*8.5CM
JF1411	/	6.9*2.8CM	6.9*2.8CM	6.9*2.8CM
JF1153	/	18*13*2.5CM	18*13*2.5CM	18*13*2.5CM
Item#	Product Weight on spec	Sample 1	Sample 2	Sample 3
JF0170	/	370.1g	371.2g	370.8g
JF1092	/	369.8g	370.7g	371.8g
JF1411	57	55.9g	56g	56.1g
JF1153	/	65.5g	65.6g	65.8g

Pictures for packing, shipping marks and product checking


01 JF0170







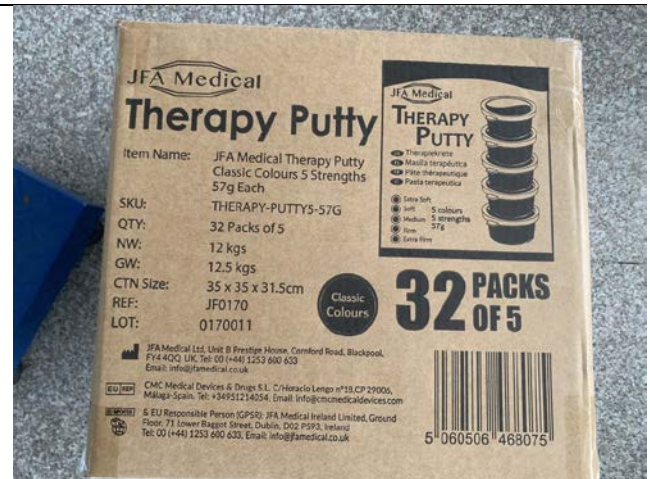





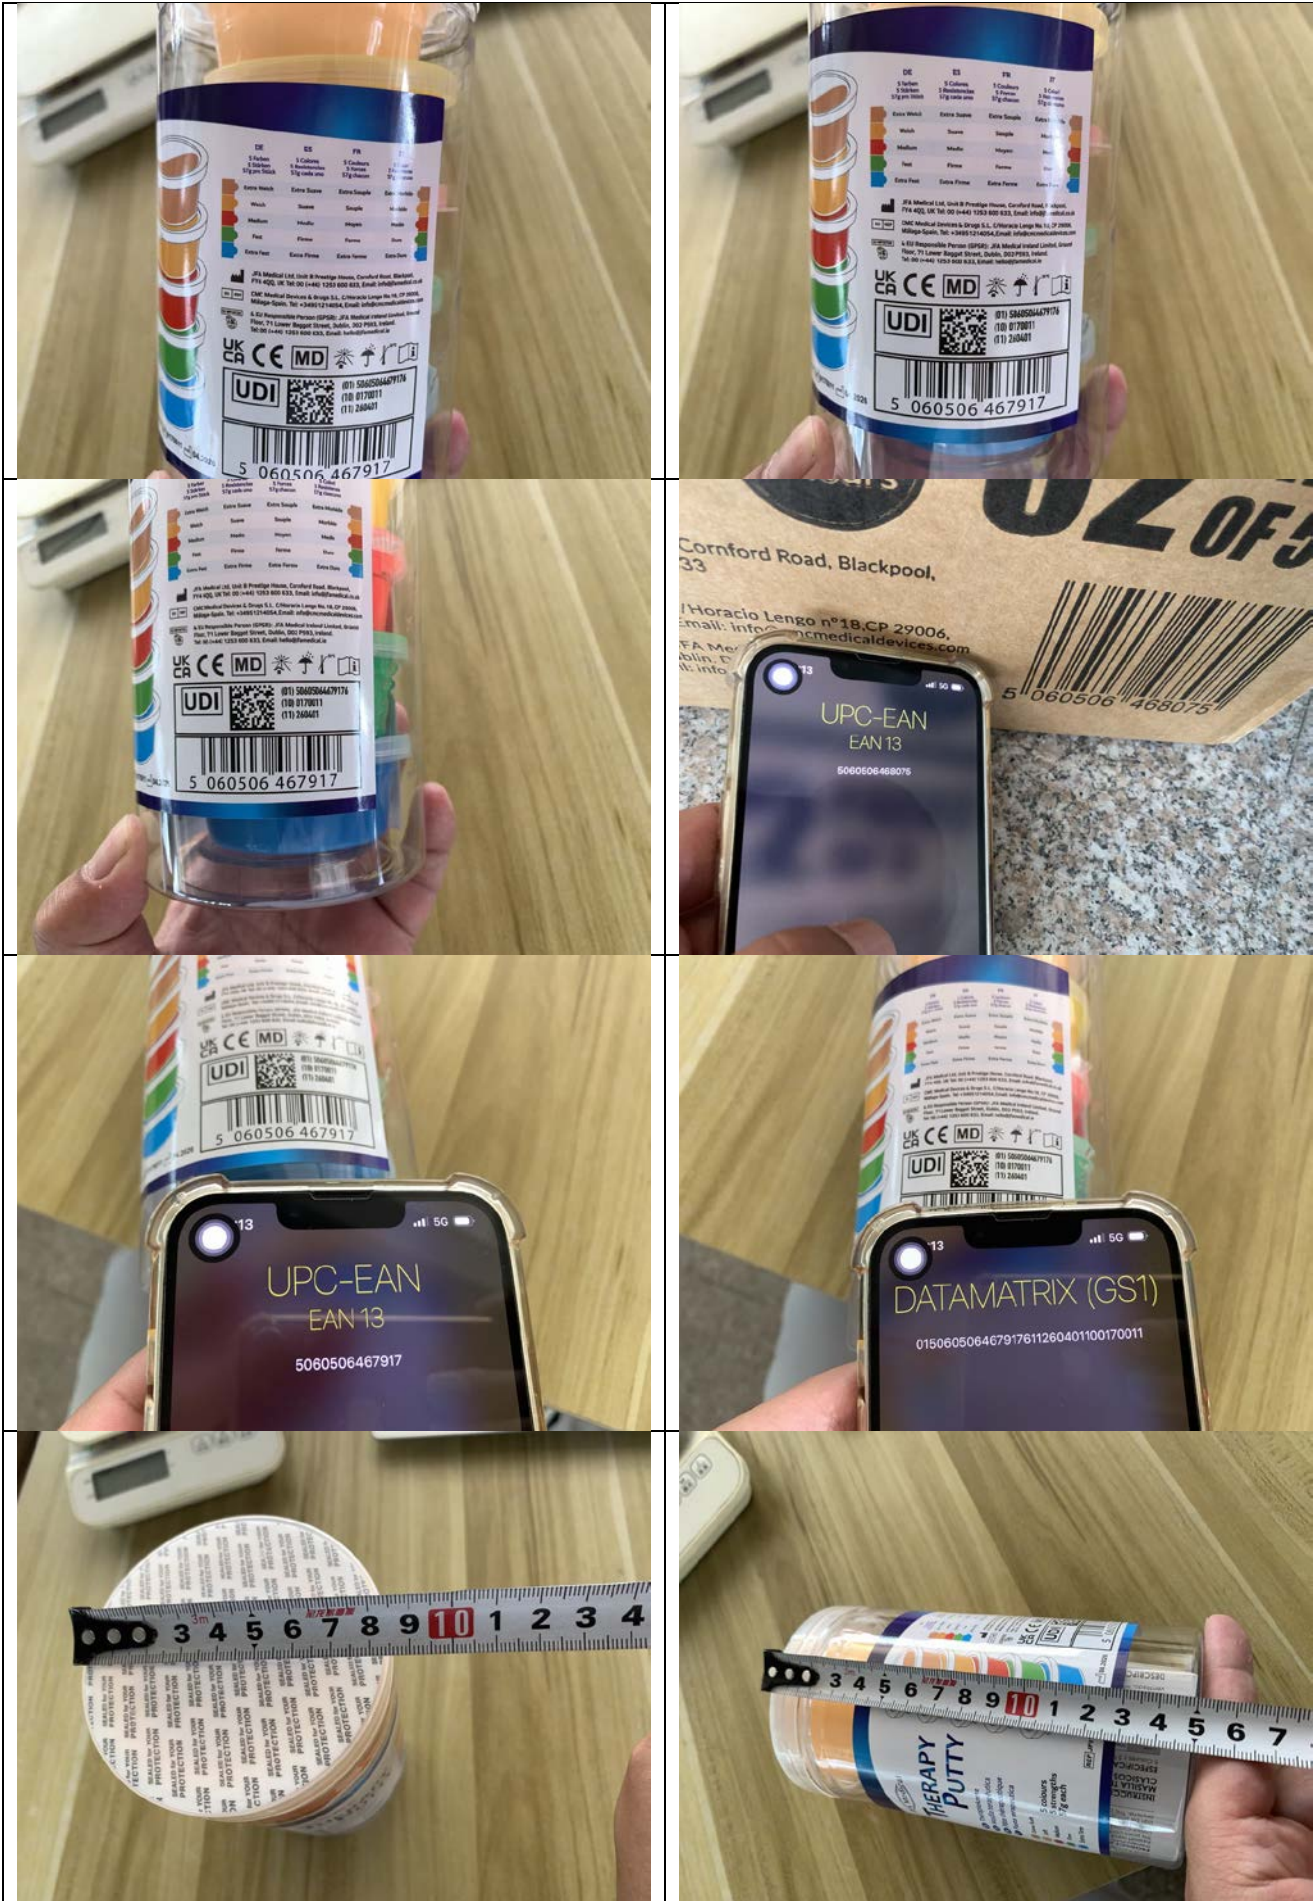

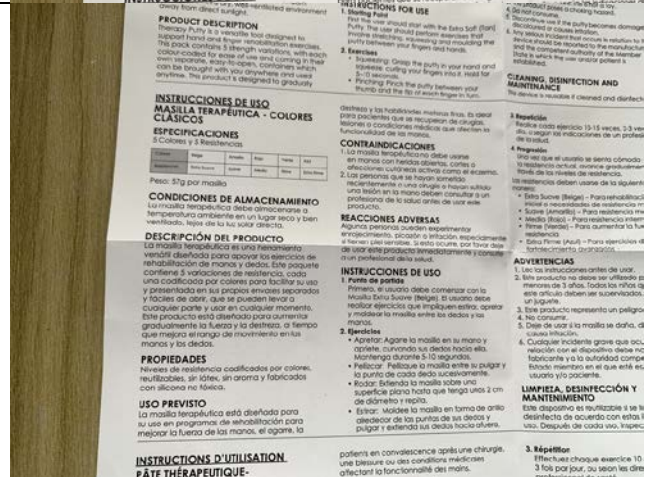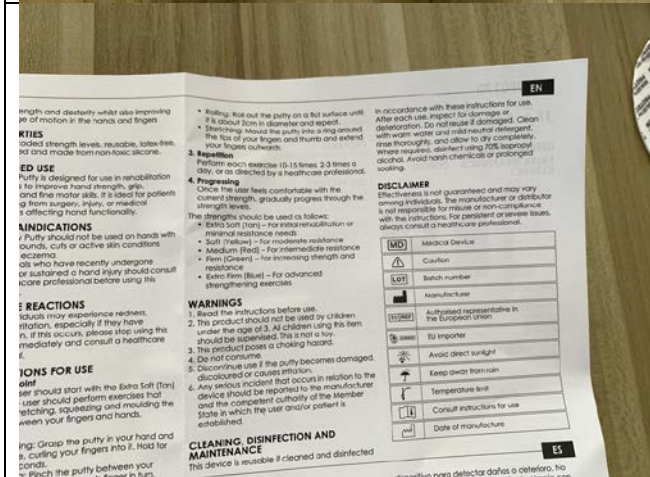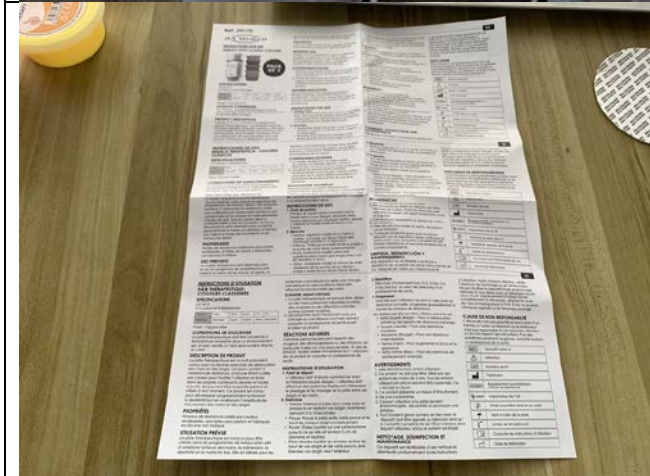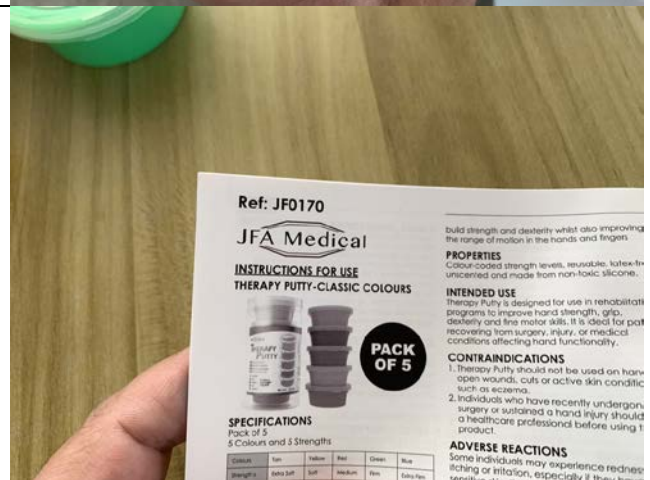

[illegible]

PROPRIETES

Le produit est spécialement formulé pour les soins de la peau sensible.

USO PREVISTO

Le produit est destiné à être utilisé sur la peau sensible.

ISTRUZIONI D'UTILIZZO

PATÉ THÉRAPEUTIQUE

COLORS CLASSIQUES

RECOMENDAZIONI

1. Appliquer le produit sur la peau sensible.

CONDIZIONI DI STOCCAGGIO

Le produit doit être conservé à l'abri de la lumière et de l'humidité.

DESCRIPTION DU PRODUIT

Le produit est une pâte thérapeutique à base de couleurs classiques.

PROPRIETES

Le produit est spécialement formulé pour les soins de la peau sensible.

UTILISATION PRÉVUE

Le produit est destiné à être utilisé sur la peau sensible.

CONTRAINDICATIONS

Le produit ne doit pas être utilisé sur la peau irritée.

CAUTIONS ADVISORY

Le produit doit être utilisé avec précaution.

ISTRUZIONI D'UTILIZZO

1. Note de l'utilisateur

Le produit est destiné à être utilisé sur la peau sensible.

2. Précautions

Le produit doit être utilisé avec précaution.

3. Précautions

Le produit doit être utilisé avec précaution.

4. Précautions

Le produit doit être utilisé avec précaution.

5. Précautions

Le produit doit être utilisé avec précaution.

CONTRAINDICATIONS

Le produit ne doit pas être utilisé sur la peau irritée.

CAUTIONS ADVISORY

Le produit doit être utilisé avec précaution.

ISTRUZIONI D'UTILIZZO

1. Note de l'utilisateur

Le produit est destiné à être utilisé sur la peau sensible.

2. Précautions

Le produit doit être utilisé avec précaution.

3. Précautions

Le produit doit être utilisé avec précaution.

4. Précautions

Le produit doit être utilisé avec précaution.

5. Précautions

Le produit doit être utilisé avec précaution.

CONTRAINDICATIONS

Le produit ne doit pas être utilisé sur la peau irritée.

CAUTIONS ADVISORY

Le produit doit être utilisé avec précaution.

ISTRUZIONI D'UTILIZZO

1. Note de l'utilisateur

Le produit est destiné à être utilisé sur la peau sensible.

2. Précautions

Le produit doit être utilisé avec précaution.

3. Précautions

Le produit doit être utilisé avec précaution.

4. Précautions

Le produit doit être utilisé avec précaution.

5. Précautions

Le produit doit être utilisé avec précaution.

Version 01
Date de sortie: 01/2001

Produit de la gamme Pâte Thérapeutique Colors Classiques.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.



Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

Le produit est spécialement formulé pour les soins de la peau sensible.

Le produit est destiné à être utilisé sur la peau sensible.

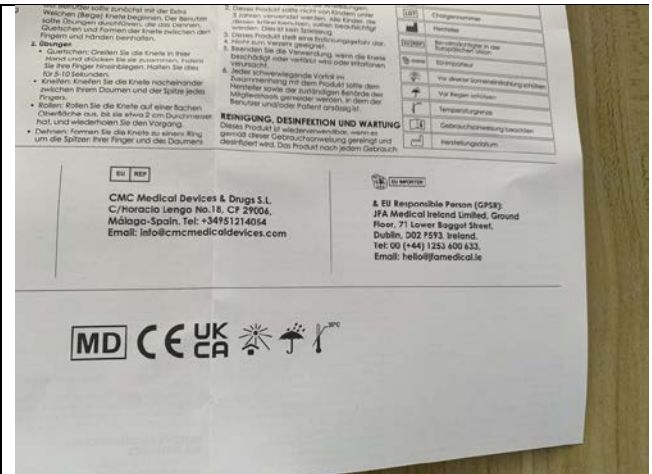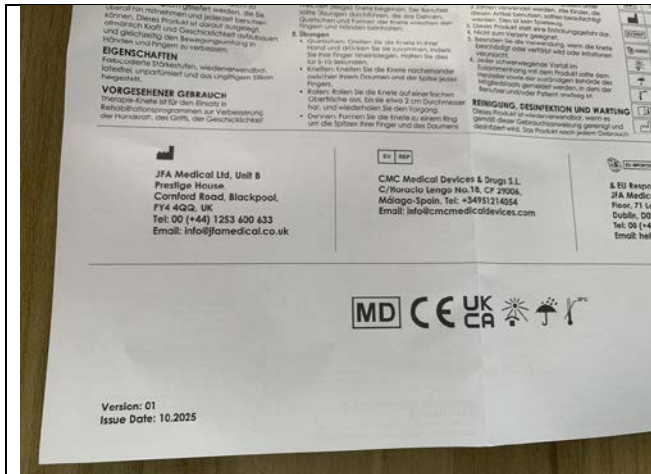









02 JF1092







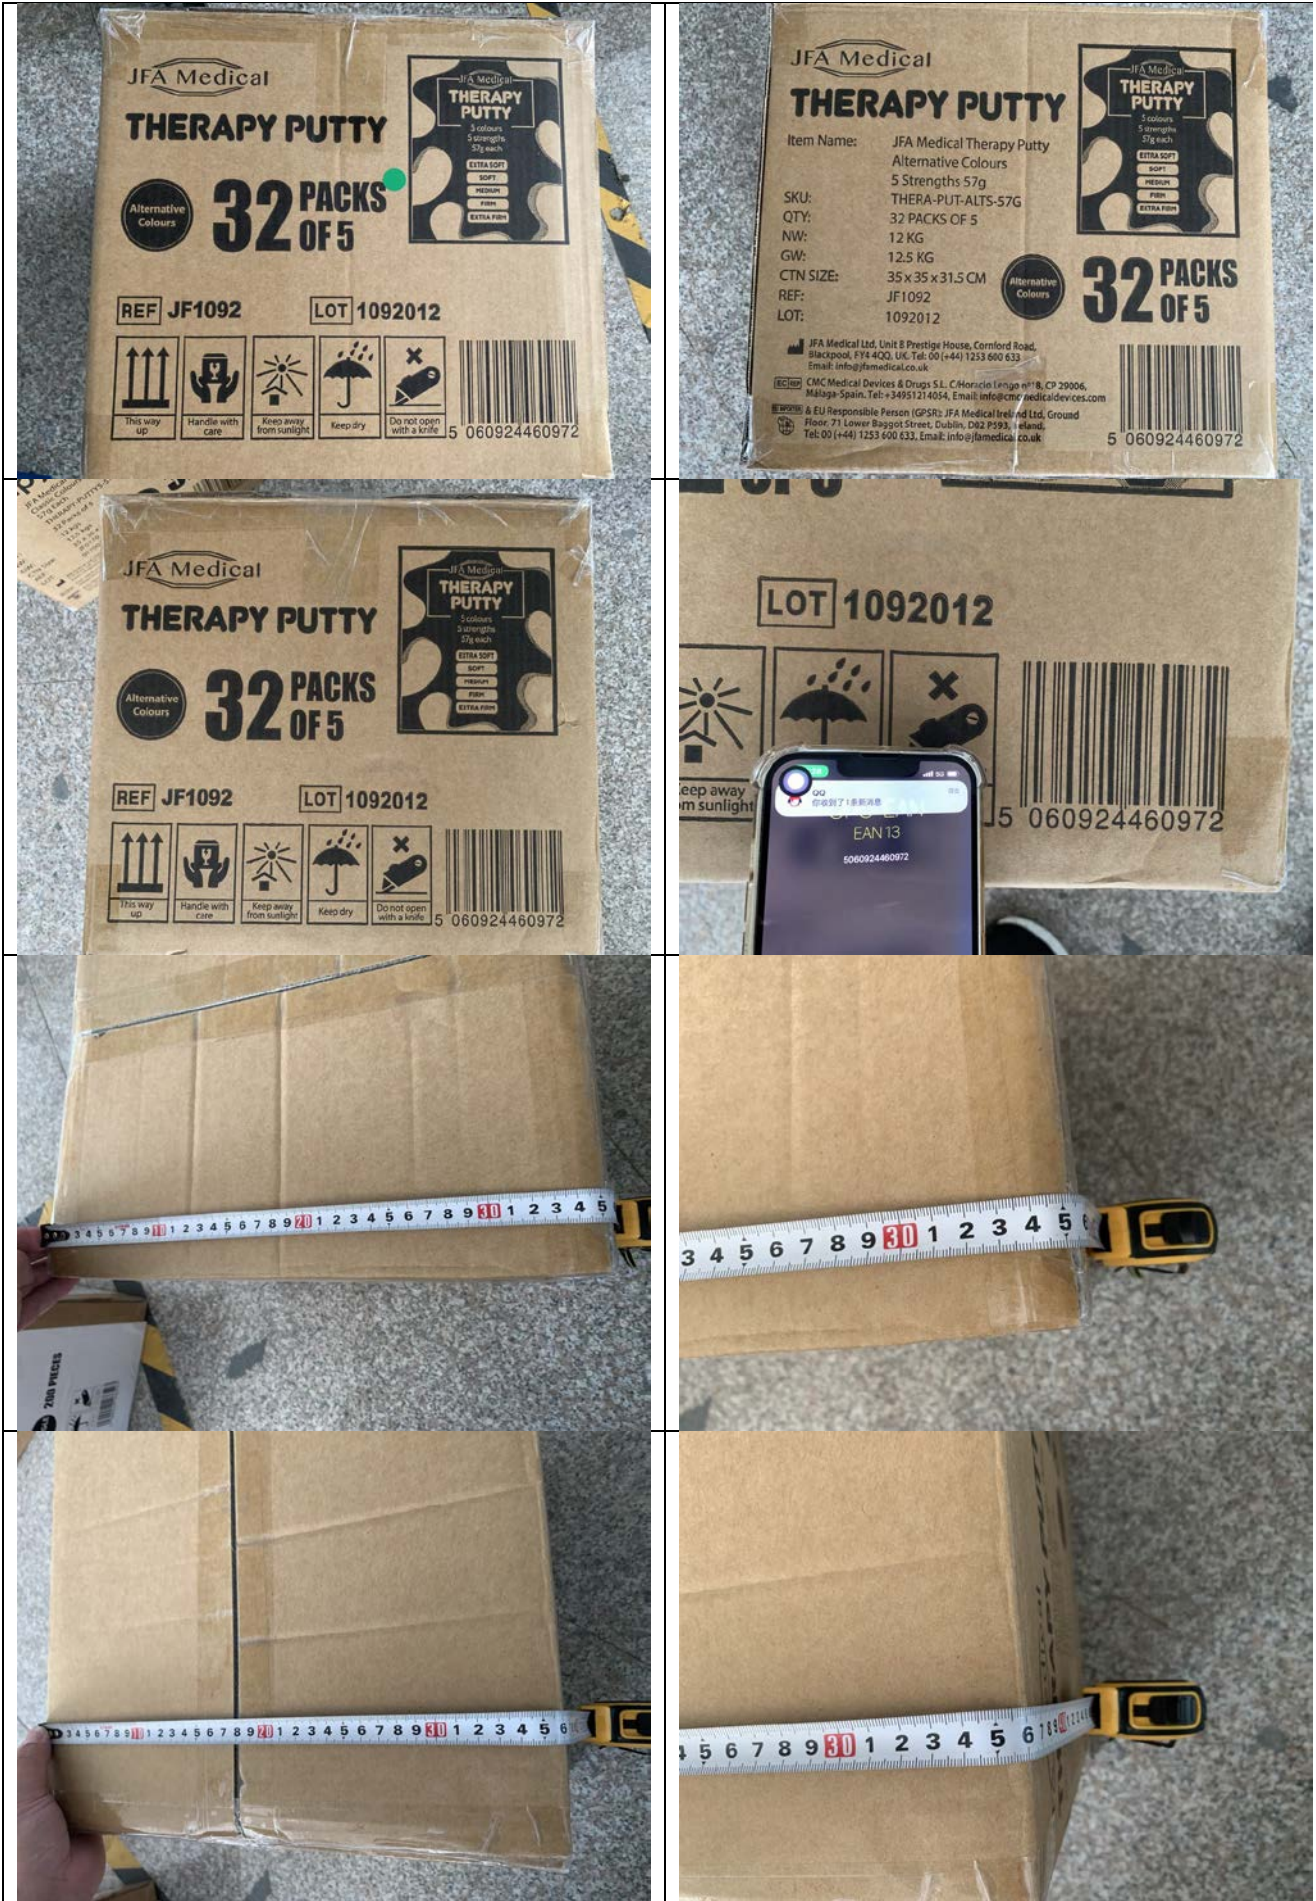


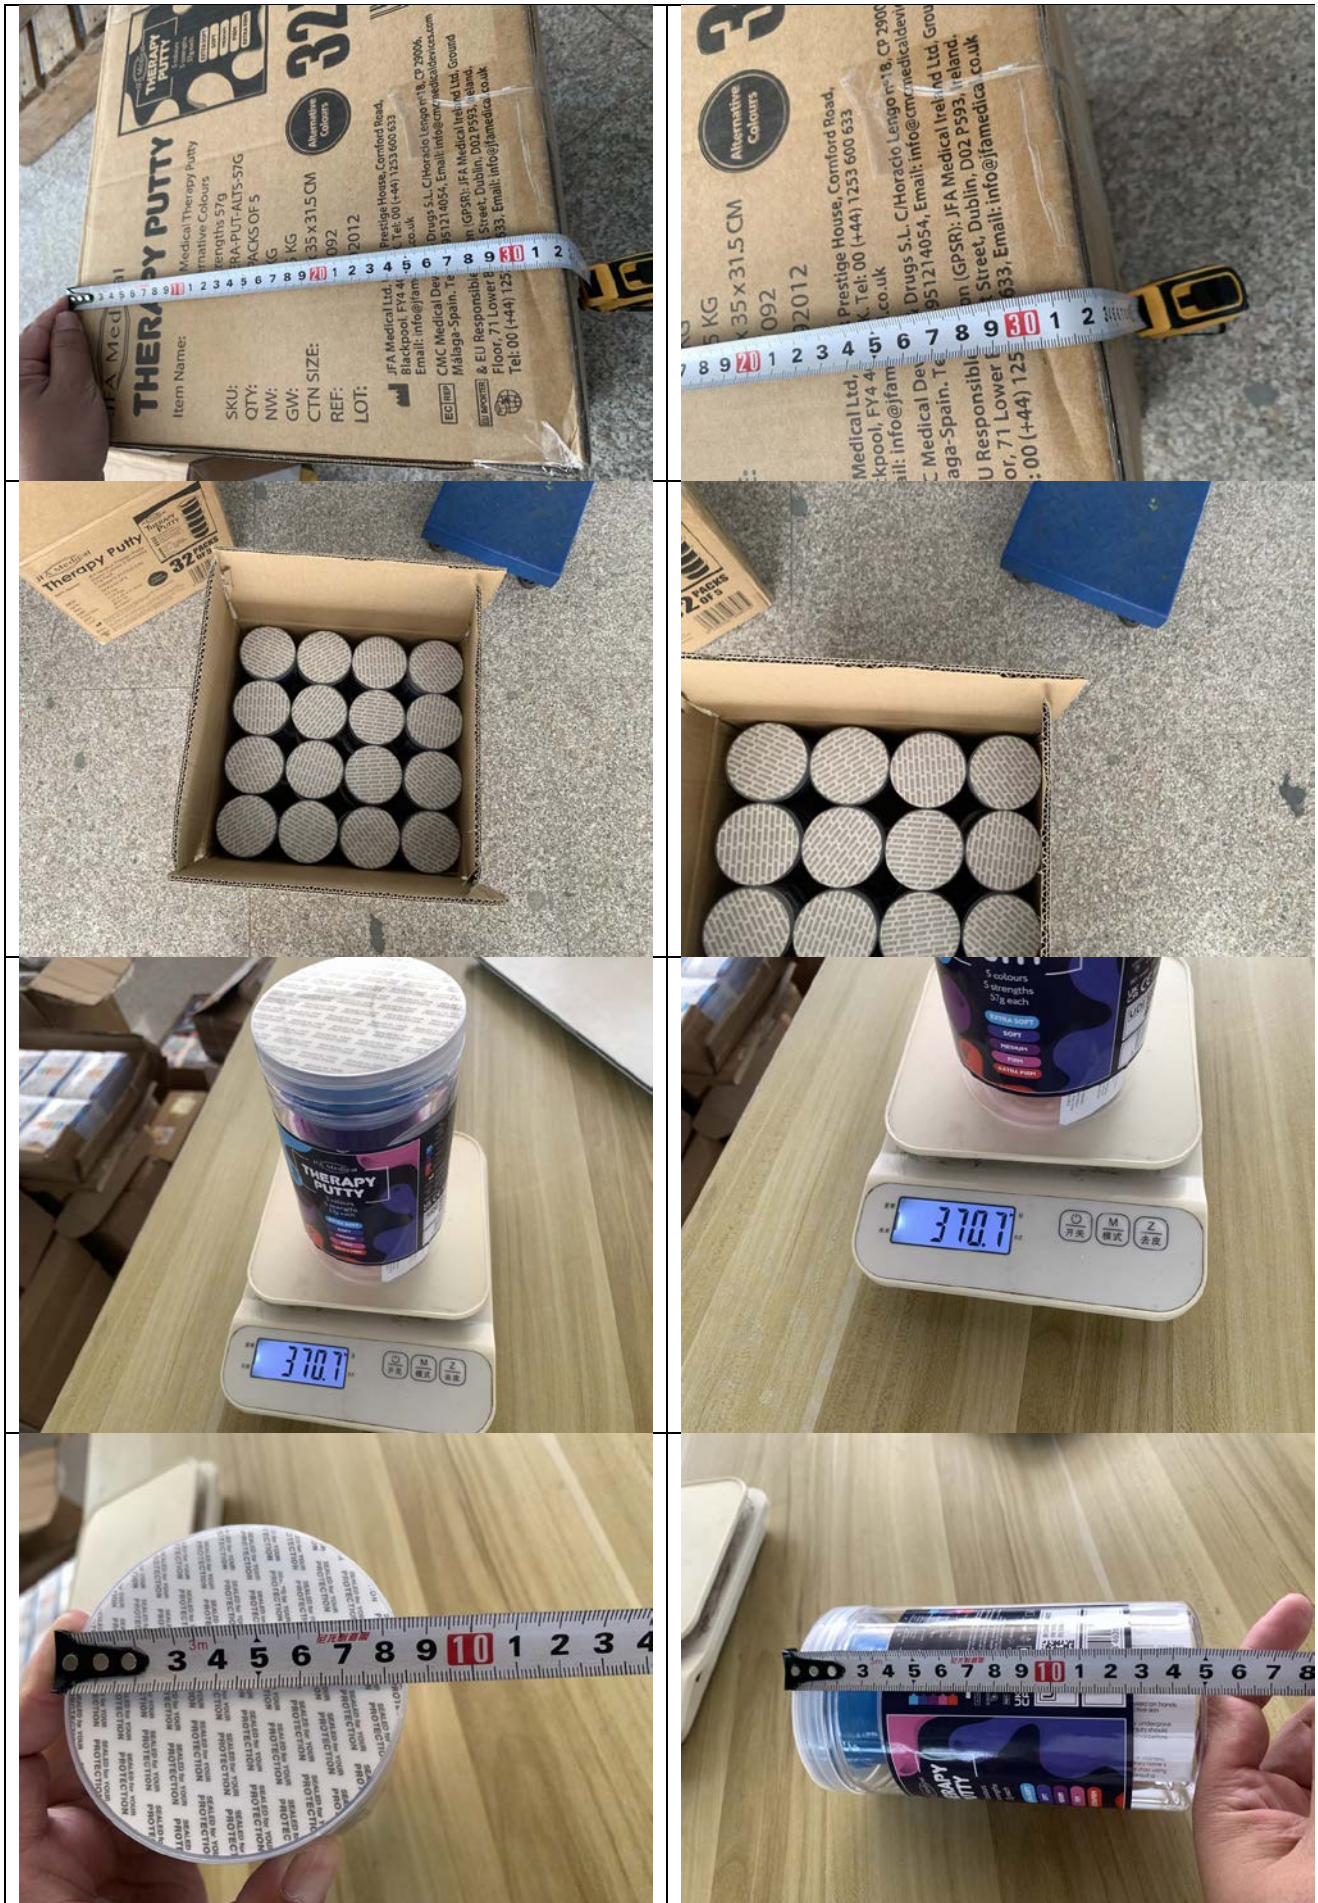





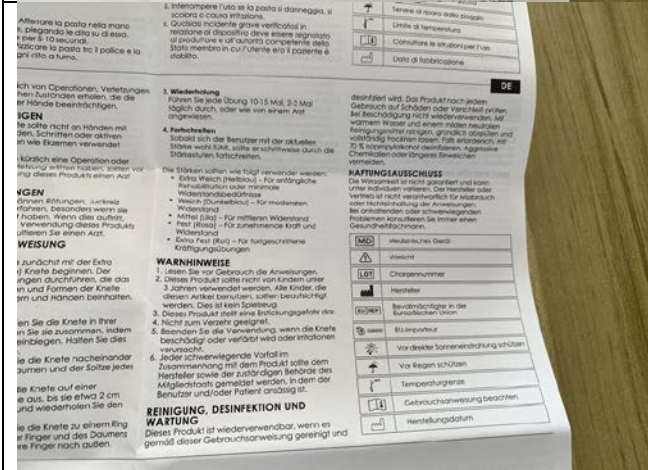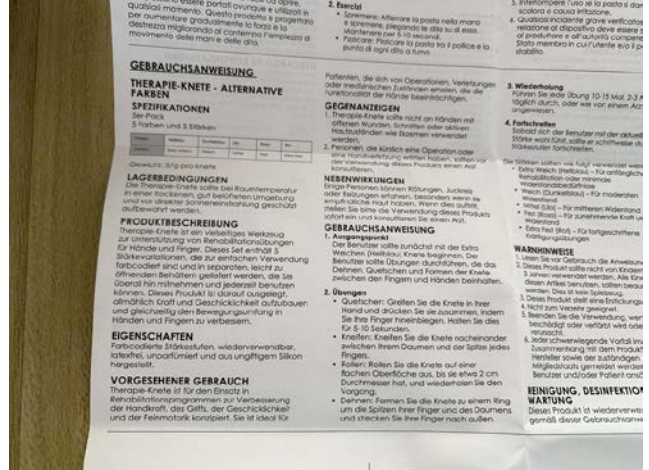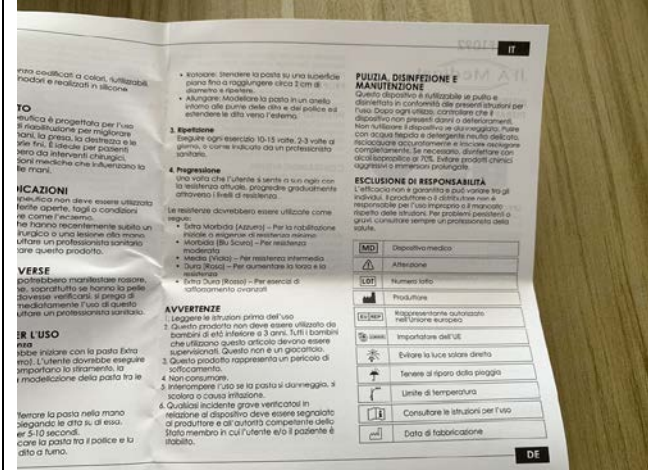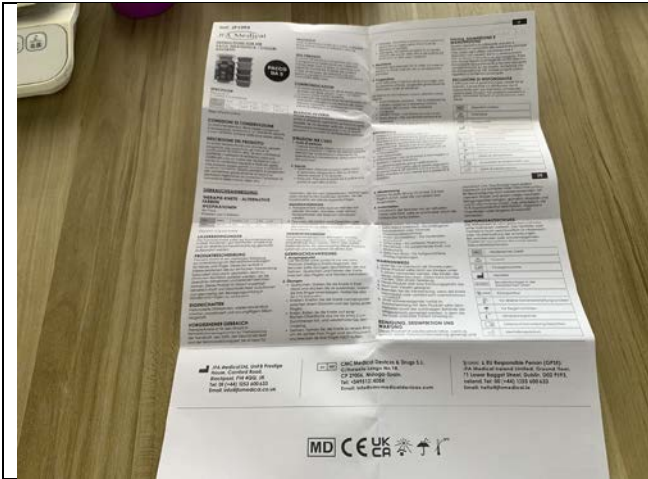










03 JF1411









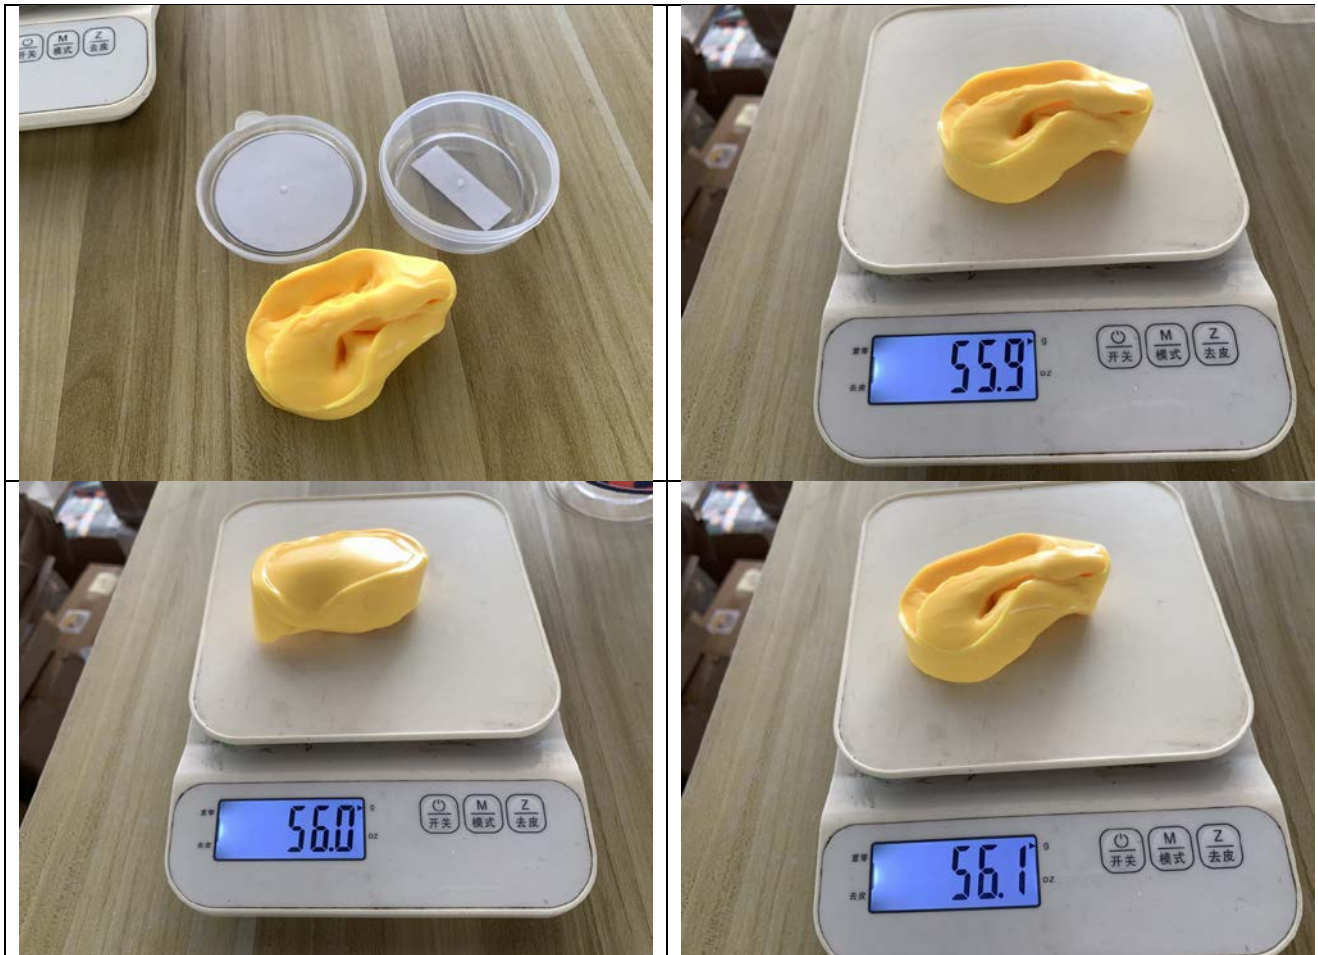

04 JF1153
















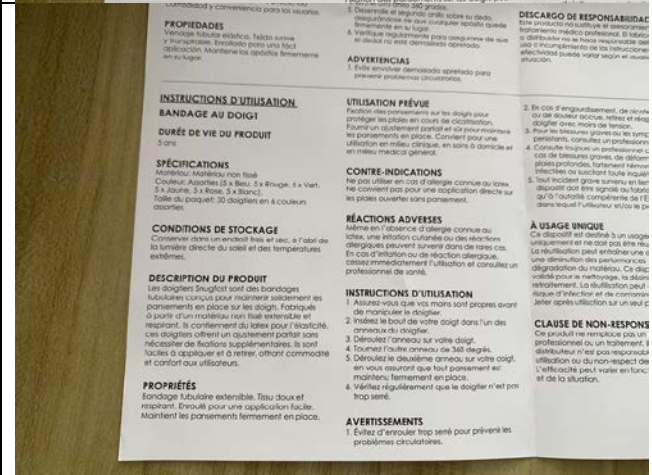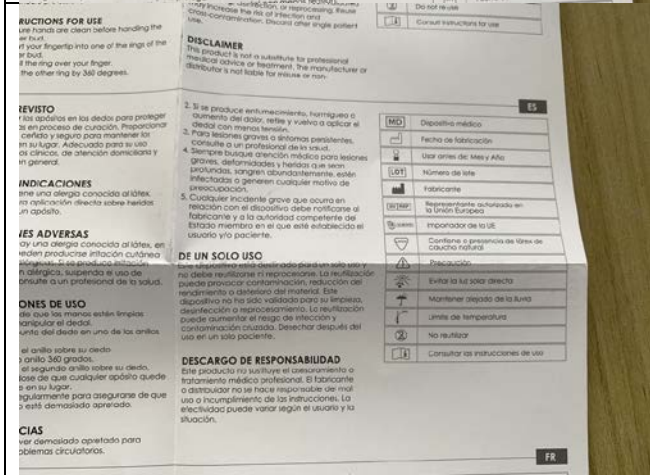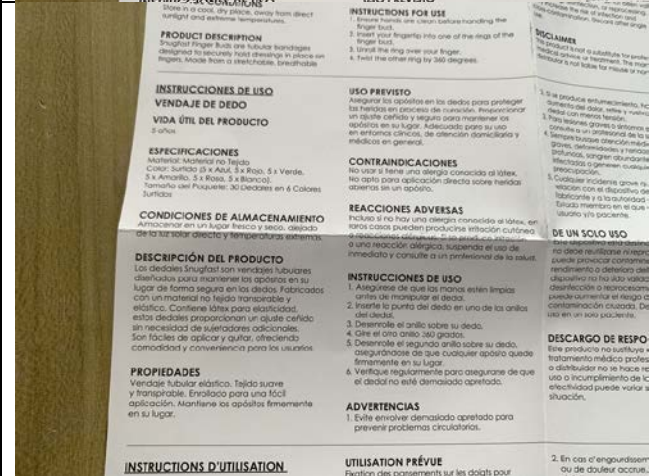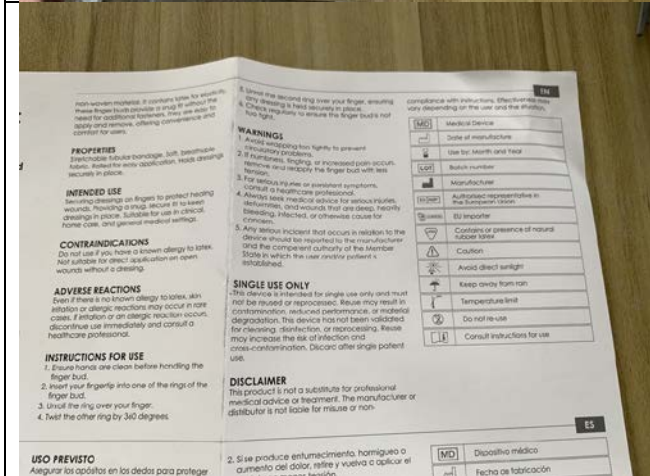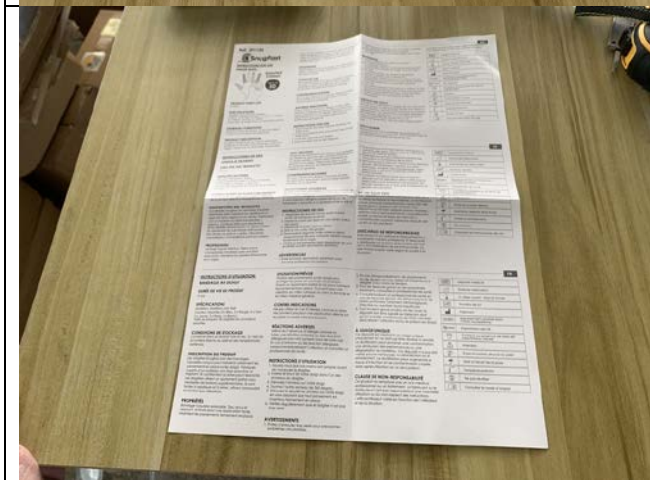

DISCARO DE RESPONSABILIDAD

Este producto no es un medicamento y no debe utilizarse como tal. El fabricante no se responsabiliza de los daños o lesiones causados por el uso indebido o no conforme de este producto. El fabricante no se responsabiliza de los daños o lesiones causados por el uso indebido o no conforme de este producto. El fabricante no se responsabiliza de los daños o lesiones causados por el uso indebido o no conforme de este producto.

Consultar las instrucciones de uso

Consultar las instrucciones de uso para obtener información sobre el uso correcto del producto. El fabricante no se responsabiliza de los daños o lesiones causados por el uso indebido o no conforme de este producto.

À USAGE UNIQUE

Ce produit est destiné à un usage unique. Il ne doit pas être réutilisé. La réutilisation peut entraîner une contamination, une diminution des performances ou une dégradation du matériel. Ce dispositif n'a pas été conçu pour être réutilisé. La réutilisation peut entraîner une contamination, une diminution des performances ou une dégradation du matériel. Ce dispositif n'a pas été conçu pour être réutilisé.

Dispositif médical

Dispositif médical
Date de fabrication
A utiliser entre : Mois et Année
Nombre de lot
Fabricant
Représentant autorisé dans l'Union européenne
Importateur de l'UE
Conformité de présence de tous les composants
Attention
Enter la lumière directe du soleil
Tenir à l'écart de la pluie
Température limite
Ne pas humidifier
Consultez le mode d'emploi

CLAUDE DE NON-RESPONSABILITÉ

Ce produit est destiné à un usage unique. Il ne doit pas être réutilisé. La réutilisation peut entraîner une contamination, une diminution des performances ou une dégradation du matériel. Ce dispositif n'a pas été conçu pour être réutilisé. La réutilisation peut entraîner une contamination, une diminution des performances ou une dégradation du matériel. Ce dispositif n'a pas été conçu pour être réutilisé.

AVVERTENZE

Non utilizzare il prodotto per scopi non previsti. L'uso improprio può causare danni o lesioni. Consultare le istruzioni per l'uso. Il produttore non si assume alcuna responsabilità per danni o lesioni causati dall'uso improprio del prodotto.

Ref. JF1153

Snugfast

INDICAZIONE PER L'USO

BENDE PER IL DITA

Colori Assortiti

Max 30

DURATA DI CONSERVAZIONE DEL PRODOTTO

3 anni


SPECIFICHE

Materiali: Polietilene non tessuto
Cassa: Aluminio 2x10x10, 3x10x10, 4x10x10, 5x10x10, 6x10x10, 7x10x10, 8x10x10, 9x10x10, 10x10x10, 11x10x10, 12x10x10, 13x10x10, 14x10x10, 15x10x10, 16x10x10, 17x10x10, 18x10x10, 19x10x10, 20x10x10, 21x10x10, 22x10x10, 23x10x10, 24x10x10, 25x10x10, 26x10x10, 27x10x10, 28x10x10, 29x10x10, 30x10x10, 31x10x10, 32x10x10, 33x10x10, 34x10x10, 35x10x10, 36x10x10, 37x10x10, 38x10x10, 39x10x10, 40x10x10, 41x10x10, 42x10x10, 43x10x10, 44x10x10, 45x10x10, 46x10x10, 47x10x10, 48x10x10, 49x10x10, 50x10x10, 51x10x10, 52x10x10, 53x10x10, 54x10x10, 55x10x10, 56x10x10, 57x10x10, 58x10x10, 59x10x10, 60x10x10, 61x10x10, 62x10x10, 63x10x10, 64x10x10, 65x10x10, 66x10x10, 67x10x10, 68x10x10, 69x10x10, 70x10x10, 71x10x10, 72x10x10, 73x10x10, 74x10x10, 75x10x10, 76x10x10, 77x10x10, 78x10x10, 79x10x10, 80x10x10, 81x10x10, 82x10x10, 83x10x10, 84x10x10, 85x10x10, 86x10x10, 87x10x10, 88x10x10, 89x10x10, 90x10x10, 91x10x10, 92x10x10, 93x10x10, 94x10x10, 95x10x10, 96x10x10, 97x10x10, 98x10x10, 99x10x10, 100x10x10, 101x10x10, 102x10x10, 103x10x10, 104x10x10, 105x10x10, 106x10x10, 107x10x10, 108x10x10, 109x10x10, 110x10x10, 111x10x10, 112x10x10, 113x10x10, 114x10x10, 115x10x10, 116x10x10, 117x10x10, 118x10x10, 119x10x10, 120x10x10, 121x10x10, 122x10x10, 123x10x10, 124x10x10, 125x10x10, 126x10x10, 127x10x10, 128x10x10, 129x10x10, 130x10x10, 131x10x10, 132x10x10, 133x10x10, 134x10x10, 135x10x10, 136x10x10, 137x10x10, 138x10x10, 139x10x10, 140x10x10, 141x10x10, 142x10x10, 143x10x10, 144x10x10, 145x10x10, 146x10x10, 147x10x10, 148x10x10, 149x10x10, 150x10x10, 151x10x10, 152x10x10, 153x10x10, 154x10x10, 155x10x10, 156x10x10, 157x10x10, 158x10x10, 159x10x10, 160x10x10, 161x10x10, 162x10x10, 163x10x10, 164x10x10, 165x10x10, 166x10x10, 167x10x10, 168x10x10, 169x10x10, 170x10x10, 171x10x10, 172x10x10, 173x10x10, 174x10x10, 175x10x10, 176x10x10, 177x10x10, 178x10x10, 179x10x10, 180x10x10, 181x10x10, 182x10x10, 183x10x10, 184x10x10, 185x10x10, 186x10x10, 187x10x10, 188x10x10, 189x10x10, 190x10x10, 191x10x10, 192x10x10, 193x10x10, 194x10x10, 195x10x10, 196x10x10, 197x10x10, 198x10x10, 199x10x10, 200x10x10, 201x10x10, 202x10x10, 203x10x10, 204x10x10, 205x10x10, 206x10x10, 207x10x10, 208x10x10, 209x10x10, 210x10x10, 211x10x10, 212x10x10, 213x10x10, 214x10x10, 215x10x10, 216x10x10, 217x10x10, 218x10x10, 219x10x10, 220x10x10, 221x10x10, 222x10x10, 223x10x10, 224x10x10, 225x10x10, 226x10x10, 227x10x10, 228x10x10, 229x10x10, 230x10x10, 231x10x10, 232x10x10, 233x10x10, 234x10x10, 235x10x10, 236x10x10, 237x10x10, 238x10x10, 239x10x10, 240x10x10, 241x10x10, 242x10x10, 243x10x10, 244x10x10, 245x10x10, 246x10x10, 247x10x10, 248x10x10, 249x10x10, 250x10x10, 251x10x10, 252x10x10, 253x10x10, 254x10x10, 255x10x10, 256x10x10, 257x10x10, 258x10x10, 259x10x10, 260x10x10, 261x10x10, 262x10x10, 263x10x10, 264x10x10, 265x10x10, 266x10x10, 267x10x10, 268x10x10, 269x10x10, 270x10x10, 271x10x10, 272x10x10, 273x10x10, 274x10x10, 275x10x10, 276x10x10, 277x10x10, 278x10x10, 279x10x10, 280x10x10, 281x10x10, 282x10x10, 283x10x10, 284x10x10, 285x10x10, 286x10x10, 287x10x10, 288x10x10, 289x10x10, 290x10x10, 291x10x10, 292x10x10, 293x10x10, 294x10x10, 295x10x10, 296x10x10, 297x10x10, 298x10x10, 299x10x10, 300x10

CMC Medical Devices & Drugs S.L.
c/o Hospital Lengua No.18, CP 20064
Málaga-Spain Tel.: +34951214054
Email: info@cmcmedicaldevices.com

EU Responsible Person (GPIR) JFA Medical
Island 1st, Ground Floor, 71 Lower Gaggard Street,
Dukin, DO2 P193, Ireland Tel: 00 (+44) 1253 400 813
Email: info@jamedical.co.uk



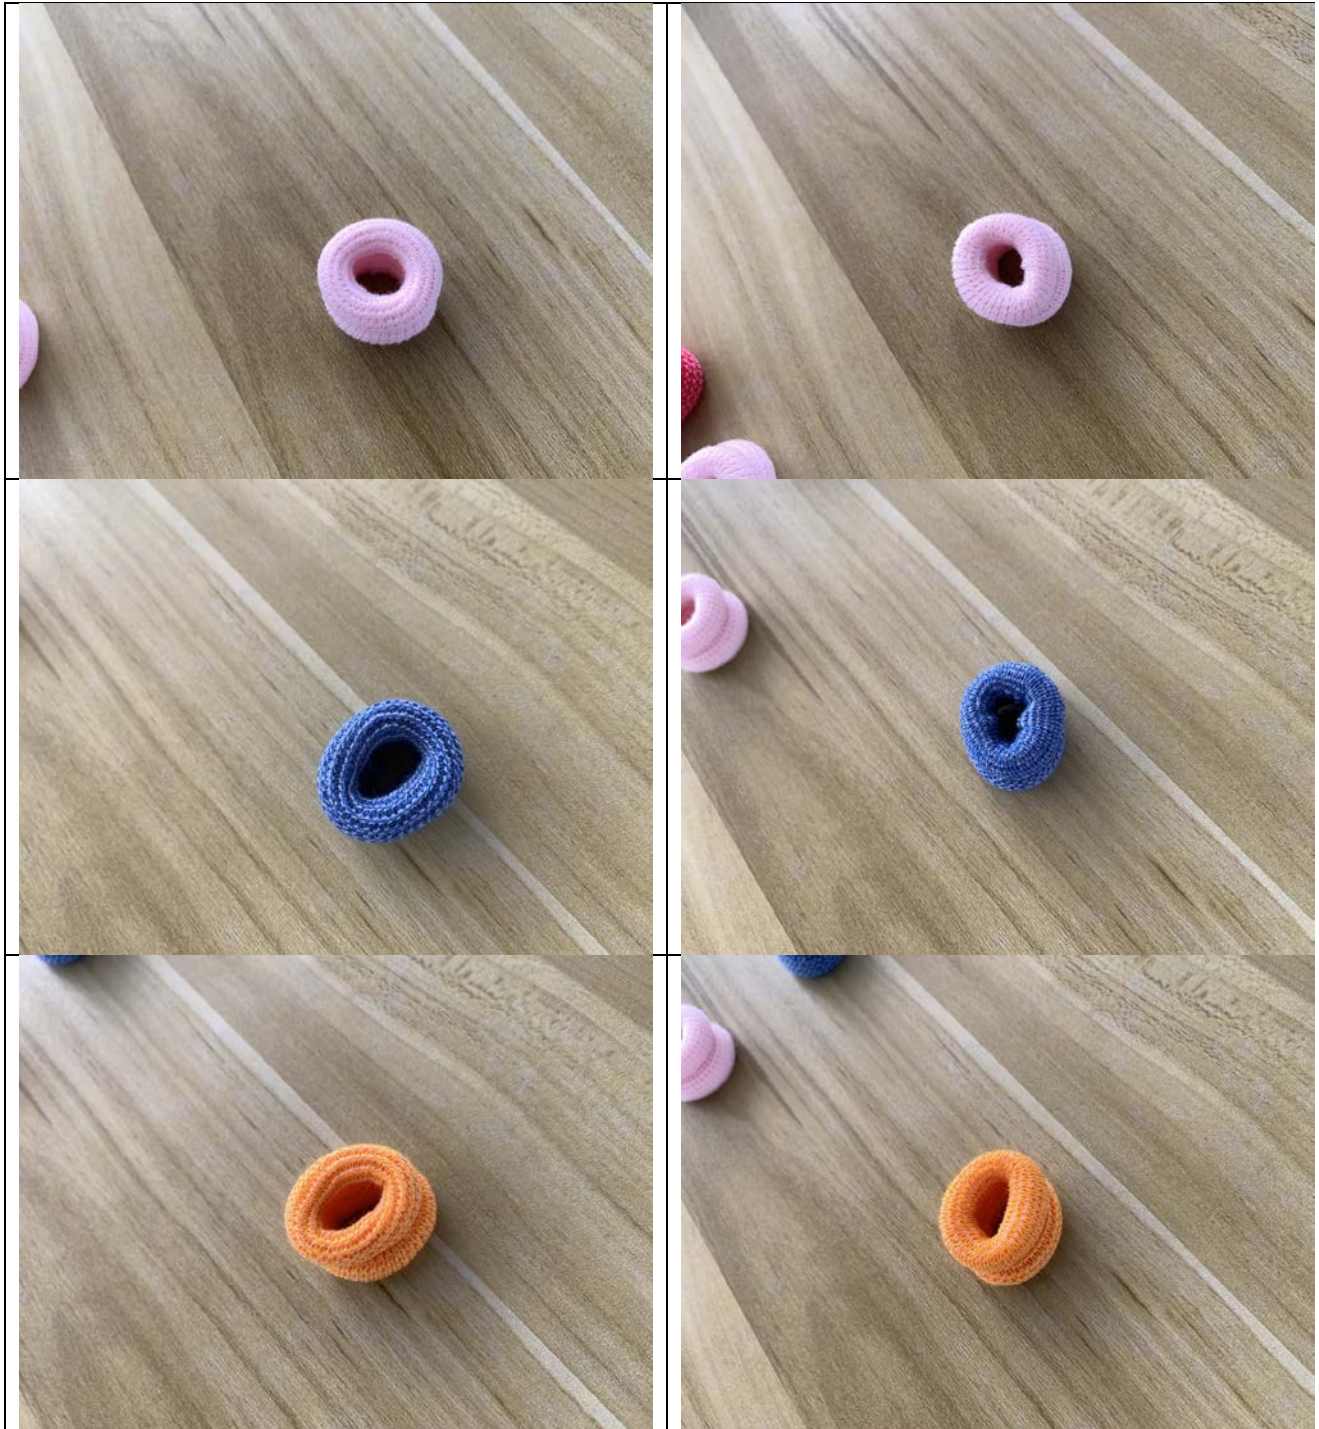

7. Factory General Outlook

Is the factory/workshop location Same as booked by client?	Factory/Workshop cooperation	Factory/Workshop organization
Yes	Average	Average
Warehouse Cleanliness	Inspection Room Lighting Conditions	Inspection Room Conditions Cleanliness
Average	Bright	Clean
Factory Name	Warehouse	Inspected cartons



8. Draft Report

AQI		Draft Report		
General Information:		DOCUMENT #: AQI-DOC-Draft Report		
Client name:	JFA Medical Ltd	Supplier name:	NINGBO LIKESGREEN INDUSTRIAL CO.,LTD	
Product name:	Tool	Inspection Date:	June 1, 2026	
Item #:	5 Items	PO#	/	
Ordered quantity:	18160PCS	Inspection location	NINGBO	
Inspection type	PSI/G-II	AQL Level	Cri: 0 Maj: 2.5 Min.: 4.0	
Sample size inspected	204PCS	Qty. for selected cartons	4CTNS	
Defective list		Critical	Major	Minor
/		/	/	/
Total Defectives		0	0	0
Maximum allowed:		0	/	/
Sample Size		204	204	204
Conclusion:		Pending		
AQI Remark :				
1. For item JF1098:Not found 2. The approval sample was not available for reference on site. 3. Selected 204pcs samples for inspection, found 0pcs major defects and 0pcs minor defects, 4. For item JF1153:The outer carton is too large. 5. For item JF1092&JF1411:The stickers do not match the information. 6. Some packaging information was not provided.				
Manufacturer Signature		AQI Inspector		
/		/		
Remark: 1. 本报告对产品供应商没有免责效力。任何情况下，供应商都须承担该批商品的质量、产品安全等方面的责任。The conclusions contained within this report do not absolve the product supplier of liability under any circumstances. The supplier is responsible for all aspects of quality and safety for the batch of products concerned. 2. 产品供应商须修理或更换现场检出的所有缺陷产品，并重新包装好所有拆开检查的产品。The supplier must repair or replace all defective products identified during the onsite inspection and repackaging all inspected products that were opened. 3. 由于时间限制，本报告为草稿报告。经审核后的正式报告，可能与草稿报告有所差异。最后结果以正式报告为准。Due to time constraints, this document is a draft report. The finalized report, which will undergo a thorough review, may vary from this draft. Decisions should be based on the finalized report. 4. 检验员不是产品能否出货的决定人，本报告亦不作为同意出货的依据。能否出货应由客户做出决定。The inspector does not have the authority to decide whether products can be shipped; nor does this report constitute an approval for shipment. The decision to ship products should be made by the customer. 5. 工厂现场签字人有责任将本次检验发现的问题和结果通知供应商的相关人员，以便工厂做出及时跟踪或响应。It is the responsibility of the person who signs off on this inspection at the factory site to communicate any issues and results found during the inspection to the relevant personnel of the supplier, to ensure prompt and appropriate follow-up actions. 6. 本检验结果只对样本（抽样）负责 The results of this inspection are only applicable to the samples taken. 7. 本报告为完整内容，不得部分复制本报告 This report is complete and may not be partially reproduced.				

IMPORTANT NOTES

THE ABOVE RESULT(S) REFLECT(S) AQI QUALITY INSPECTION FINDINGS AT THE TIME AND PLACE OF INSPECTION. THIS REPORT DOES NOT RELEASE THE BUYER OR SELLER FROM CONTRACTUAL RESPONSIBILITIES, NOR DOES IT PREJUDICE THE BUYER'S RIGHT OF CLAIM TOWARD THE SELLER/SUPPLIER FOR COMPENSATION FOR ANY APPARENT AND/OR HIDDEN DEFECTS NOT DETECTED DURING INSPECTION OR OCCURRING ANYTIME THEREAFTER.

End of the Report