

The Development of a Matlab-Based Fuzzy PID Controller and The Simulation

Yunus Bakhtiar Arafat

Automotive Industry Engineering Technology, Politeknik Digital
Boash Indonesia, Indonesia

HU Weiwei

School of Mechatronics Engineering and Automation, Shanghai
University, China

Abstract: Fuzzy PID control is a process control technique combining the advantages of fuzzy logic and PID control. It maintains precise control over processes by combining fuzzy logic and proportional-integral-derivative (PID) controllers. With this method, it is possible to achieve higher levels of accuracy and stability in controlling process variables such as temperature, pressure, flow rate, and position. This makes Fuzzy PID control an ideal cordial application requiring precise process control. Fuzzy PID control uses the PID parameter tuning experience to make the fuzzy controller automatically tune its parameters, giving PID control a better control effect. In this paper, a fuzzy PID controller is designed to control the temperature of an electric boiler. The control effects of PID control, fuzzy control, and fuzzy PID control are compared by simulation analysis. The simulation results show that the unclear PID control effect is ideal and has a good application prospect.

Keywords: PID Control, Fuzzy Control, Fuzzy PID Controller, Simulation in Matlab

Introduction

Fuzzy controllers are automated control systems that use fuzzy logic to make decisions and take action. They are employed in several tasks, from robotics to business operations. One of the most prevalent fuzzy controllers is the **Proportional Integral Derivative (PID) controller**. It can adjust the output based on changes in the input variable. Another type of fuzzy controller, Type 1 Fuzzy Logic Controller (FLC), is used for more complex applications such as process optimization and nonlinear control systems ([Kafle, 2020](#)). It combines both rule-based data-driven approaches to make decisions and take ([Muškinja et al., 2023](#)). Fuzzy PID control is a powerful tool for controlling complex systems. It uses fuzzy logic to adjust the parameters of the PID algorithm in ortomize system performance ([Li-guo, 2012](#)).

This technique offers a more robust and efficient way to tune a control loop, allowing for better accuracy and faster convergence. The controller can better accommodate different situations and environments with fuzzy logic, improving control quality and stability. Fuzzy logic controllers are becoming increasingly popular in various industries due to their ability to make decisions based on unclear input data ([Valášková et al., 2014](#)). Fuzzy PID control is a widely used method of controlling the behaviour of a process. It combines the advantages of the PID controller and fuzzy logic to provide an effective and efficient solution for controlling complex systems ([Yong-juan, 2009](#)).

PID control is widely used as a classical control system, and it can achieve satisfactory results in systems with precise mathematical models. However, in practical applications, when the mathematical model of the controlled object changes, it is difficult to adjust the PID parameters in real-time, and the mechanism of a large number of controlled processes is complex, the establishment of the mathematical model of the controlled object is complicated. The control effect is not ideal ([Jinyu & Tao, 2015](#); [Zhou, 2022](#)). Fuzzy control has the characteristics of intelligence. It does not depend on the mathematical model of the object and has specific adaptability to the time-delay, nonlinear, and time-varying controlled object ([Weiwen, 2006](#)). However, the control rules limit the accuracy of fuzzy control, and there is always a steady-state error. Fuzzy PID control utilizes the experience of adjusting PID parameters to design a fuzzy controller to automatically adjust the PID controller's parameters to find the most suitable parameters for the PID controller ([Zhang, 2014](#)). In this paper, a fuzzy PID controller based on Matlab is used to control the temperature of an electric boiler. The results of traditional PID control, fuzzy logic control, and fuzzy PID control are compared through experimental simulation ([Morilla, 2012](#)).

Research Method

Controlled Object and Control Strategy

Analysis of Controlled Object

The electric boiler is an energy conversion device that directly converts electrical energy into heat energy ([Jiantao et al., 2020](#)). Its working principle is similar to that of the traditional boiler. The control object in this paper is a direct-heated hot water boiler, which is heated by resistance. The working pressure is 0.4 MPa, and the maximum water temperature in the boiler is 95°C.

In the production process, there are various electric boilers. The theoretical analysis and experimental results show that an electric heating device is a self-balancing object, which the

pure delay link of the second-order system can describe. The second-order system can be reduced to the first-order model by parameter identification. Therefore, the temperature control system of an electric boiler can generally be described by a first-order inertial lag system. The model's transfer function can be described by Equation 1.

$$G(S) = \frac{Ke^{-\tau S}}{TS + 1} \quad (1)$$

According to the reference (Wang, 2014), the transfer function of the control system in this paper is defined as Equation 2.

$$G(S) = \frac{0.9e^{-6s}}{75s + 1} \quad (2)$$

Research of Control Strategy

The applicable research scheme is determined by studying the structure and system of the electric boiler. The first control scheme that can be adopted is PID control, the most typical control method in classical control theory. Most linear time-invariant systems in industrial production use the classical control method, which is easy to implement and eliminates steady-state error. In most cases, the traditional PID control can meet the performance requirements (Zhou, 2022).

The second available solution is fuzzy control because it is an intelligent control technology based on prior knowledge and expert experience as the control rule. It can simulate the human reasoning and decision-making process and realize a good control effect without knowing the mathematical model of the controlled object. Moreover, the response time of fuzzy control is short, and the system overshoot is low.

When the PID control and fuzzy logic control are combined, another kind of control can be realized: fuzzy PID control. Fuzzy PID control uses fuzzy logic to optimize PID parameters in real time according to certain fuzzy rules to overcome the shortcomings of traditional PID parameters that cannot adjust PID parameters in real time. It has both advantages of PID control and fuzzy logic control.

PID Control

PID control is a widely used control method in the production process (Live et al., 2017). It is a proportional, integral, and differential parallel controller. The conventional PID control system block diagram is shown in Figure 2.1.

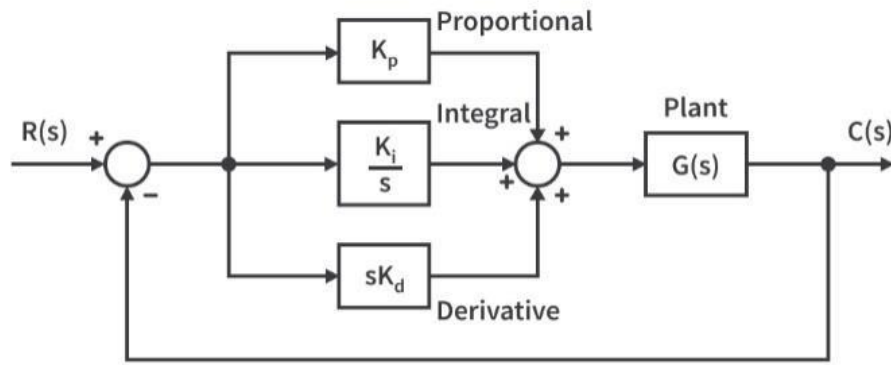


Figure 1 The Principle Drawing of The PID Control System

The ideal PID controller is based on the control deviation $e(t)$ formed by the given value $r(t)$ and the actual output value $c(t)$.

$$e(t) = r(t) - c(t) \quad (3)$$

The PID controller algorithm involves three separate constant parameters and is accordingly sometimes called three-term control: Proportional (P), Integral (I), and Derivative (D). The proportional, integral, and derivative terms are summed to calculate the output of the PID controller. Defining as the controller output, the final form of the PID algorithm is:

$$u(t) = K_p e(t) + K_i \int_0^t e(\tau) d\tau + K_d \frac{de(t)}{dt} \quad (4)$$

Where $u(t)$ is the output of the controller, $e(t)$ is the input of the controller, $K_p e(t)$ is the proportional term, K_p is termed the proportional gain, $K_i \int_0^t e(\tau) d\tau$ is the integral term, K_i is termed the integral gain, $K_d \frac{de(t)}{dt}$ is the derivative term, and K_d is termed the derivative gain.

A PID controller relies only on the measured process variable, not on the knowledge of the underlying process, making it a broadly useful controller. The controller can provide control action designed for specific process requirements by tuning the three parameters in the PID controller algorithm. The tuning of the three parameters of the PID controller is the key to achieving satisfactory control effects and also the most difficult part of PID control. The controller's response can be described in terms of the controller's responsiveness to an error, the degree to which the controller overshoots the set point, and the degree of system oscillation. Note that using the PID algorithm for control does not guarantee optimal control of the system or system stability. Some applications may require only one or two actions to provide the appropriate system control. This is achieved by setting the other parameters to zero. A PID controller will be called a PI, PD, P, or I controller without the respective control

actions. PI controllers are fairly common, since derivative action is sensitive to measurement noise, whereas the absence of an integral term may prevent the system from reaching its target value due to the control action

Fuzzy Logic Control

Fuzzy control is an important aspect of fuzzy set theory. It is a computer numerical control based on the fuzzy set, fuzzy language variables, and fuzzy logic reasoning. Fuzzy control is a kind of nonlinear control from the aspect of the linear or nonlinear control system. From the intelligence of the controller, fuzzy control belongs to the category of intelligent control.

Fuzzy control is a control method based on the fuzziness of human thinking. Fuzzy logic control technology imitates human thinking, accepts inaccurate and incomplete information for logical reasoning, and works with intuitive experience and heuristic thinking. It can cover Model-based systems techniques. It does not need to use precise formulas to express transfer functions or state equations but uses fuzzy language control rules to describe the control process. Control rules are usually obtained based on the experience of experts, so the basic idea of fuzzy control is to use computers to realize human control experience.

The major components of the fuzzy logic control are Fuzzifier, Fuzzy Knowledge Base, Fuzzy Rule Base, Inference Engine, and Defuzzifier. The role of the fuzzifier is to convert the crisp input values into fuzzy values, while the defuzzifier is to convert the fuzzy values into crisp values getting from the fuzzy inference engine. The fuzzy knowledge base stores the knowledge of all the input-output fuzzy relationships. It also has the membership function, which defines the input variables to the fuzzy rule base and the output variables to the plant under control ([Xie et al., 2022](#)).

The knowledge about the operation of the process of a domain is stored by the fuzzy rule base. The inference engine acts as a kernel of any fuzzy logic controller ([Guo et al., 1996](#)). It simulates human decisions by performing approximate reasoning. Fig 2.2 shows the architecture of fuzzy logic control.

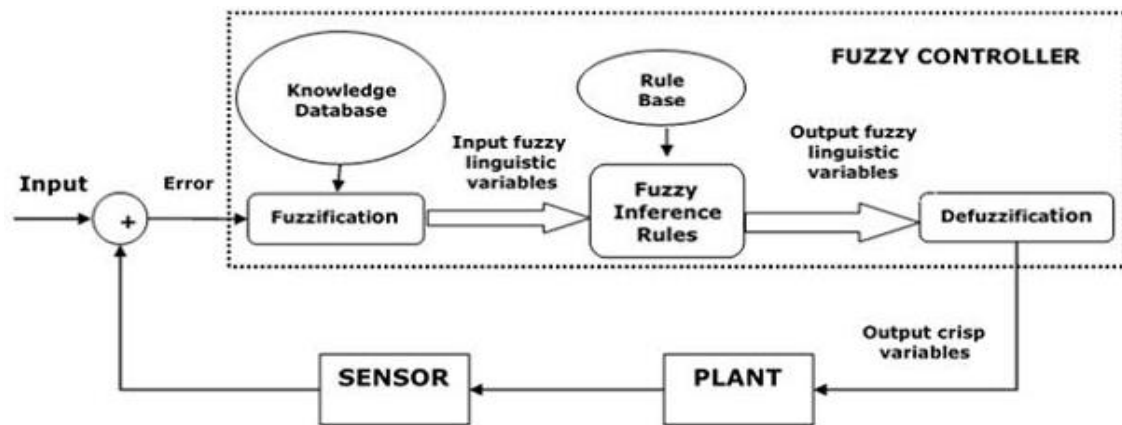


Figure 2 Fuzzy Logic Control System

Fuzzy PID Control

To achieve an ideal control effect, fuzzy PID control uses a fuzzy logic algorithm to optimize the proportion, integral and differential coefficients of PID control in real time according to certain fuzzy rules. Fuzzy PID control includes parameter fuzzification, fuzzy rule reasoning, parameter defuzzification, PID controller, etc (Du et al., 2011). The computer calculates the deviation e between the actual and theoretical positions. The current deviation changes it according to the set input and feedback signals and performs fuzzy reasoning according to the fuzzy rules. Finally, the fuzzy parameters are defuzzified, and the proportional, integral, and differential coefficients of the PID controller are output.

Fuzzy PID Controller Design

The structure of the adaptive fuzzy PID controller is shown in Figure 2. It is based on conventional PID control and adopts the idea of fuzzy reasoning. The deviation e and deviation change rate ec of the controlled valuable are used as the input variables of the two-dimensional fuzzy controller, while the values of K_p , K_i , and K_d After tuning is used as the output, the parameters of PID are adjusted online using the fuzzy control law. The fuzzy control part includes fuzzification, fuzzy reasoning calculation, and defuzzification.

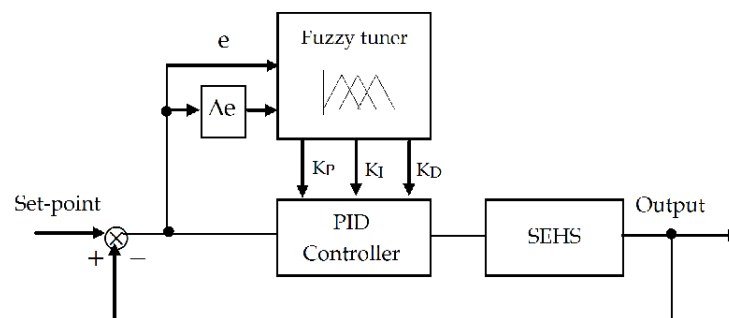


Figure 3 Fuzzy PID Controller Structure

In the electric boiler temperature control system, the fuzzy controller adopts the two-dimensional Mamdani controller with Max-Min for fuzzy control decision-making and the center of gravity method for defuzzification (Hu et al., 2023; Tan et al., 2004).

Determine The Input and Output Variables

The input of the fuzzy controller are deviation e and deviation change rate ec , and the output are three parameters used in the PID controller after fuzzy controller tuning: K_p , K_i , and K_d (Live et al., 2017). The tuning equation is:

$$\begin{cases} K_p = K'_p + \{e, ec\}K_p = K'_p + \Delta K_p \\ K_i = K'_i + \{e, ec\}K_i = K'_i + \Delta K_i \\ K_d = K'_d + \{e, ec\}K_d = K'_d + \Delta K_d \end{cases} \quad (5)$$

In Equation 5, K'_p, K'_i, K'_d are initial parameters of the PID controller, which are obtained by a conventional methods. Set {NB, NM, NS, ZO, PS, PM, PB} as the fuzzy subset of input variables and output variables. The domains of input variables e and I are both $[-6, 6]$, while the domains of output variables are all $[-3, 3]$. The triangular function is evenly distributed in the domain of discourse, and its sensitivity is high, so it is selected as the membership function of the system.

Create Fuzzy Control Rules

Based on expert experience and adjustment through simulation experiments, the table of fuzzy control rules can be summarized as shown in Table 1, Table 2, and Table 3.

Table. 1 Fuzzy control rule for Kp tuning

$\begin{matrix} EC \\ E \end{matrix}$	ΔK_p	PB	PM	PS	ZO	NS	NM	NB
PB		NB	NB	NM	NM	NM	ZO	ZO
PM		NB	NM	NM	NM	PS	ZO	PS
PS		NM	NM	NS	NS	ZO	PS	PS
ZO		NM	NM	NS	ZO	PS	PM	PM
NS		NS	NS	ZO	PS	PM	PM	PN
NM		NS	ZO	PS	PS	PM	PB	PB
NB		ZO	ZO	PS	PM	PM	PB	PB

Table. 2 Fuzzy Control rule for Ki tuning

$\begin{matrix} EC \\ E \end{matrix}$	ΔK_i	PB	PM	PS	ZO	NS	NM	NB
PB		PB	PB	PM	PM	PS	ZO	ZO
PM		PB	PB	PM	PS	PS	ZO	ZO
PS		PB	PM	PS	PS	ZO	NS	NM
ZO		PM	PM	PS	ZO	NS	NM	NM
NS		PS	PS	ZO	NS	NS	NM	NB
NM		ZO	ZO	NS	NS	NM	NB	NB
NB		ZO	ZO	NS	NM	NM	NB	NB

Table. 3 Fuzzy control rule for K_d tuning

$E \backslash EC$ ΔK_d	PB	PM	PS	ZO	NS	NM	NB
PB	PB	PS	PS	PM	PM	PM	PB
PM	PB	PS	PS	PS	PS	ZO	PB
PS	ZO	ZO	ZO	ZO	ZO	ZO	ZO
ZO	ZO	NS	NS	NS	NS	NS	ZO
NS	ZO	NS	NS	NM	NM	NS	ZO
NM	ZO	NS	NM	NM	NB	NS	PS
NB	PS	NM	NB	NB	NB	NS	PS

Writing 49 Mamdani-type fuzzy control rules into "if...then..." language format is as follows:

Rule 1: if (e is NB) and (ec is NB), then (ΔK_p is PB)(ΔK_i is NB)(ΔK_d is P)

Rule 49: if (e is PB) and (ec is PB), then (ΔK_p is NB)(ΔK_i is PB)(ΔK_d is P)

During operation, the electric boiler temperature control system uses the above fuzzy control rules to complete the online self-calibration of the PID parameters, continuously detects e and ec , and finds out the fuzzy relationship between the three PID parameters and e and ec at the fastest speed. The online real-time adjustment makes the response speed, overshoot, and steady-state error of the fuzzy PID control system superior to single PID control or fuzzy control (Kafle, 2020).

Build the Fuzzy Reasoning System

Use the Fuzzy Inference System Editor and Membership Function Editor with an interactive graphical interface in the Matlab environment. According to the above results, select parameters such as the domain range of the input and output fuzzy variables, the shape of the membership function of each language variable, and the default center of gravity method for the defuzzification method. After the setting is completed, the interface is shown in Figure 2.

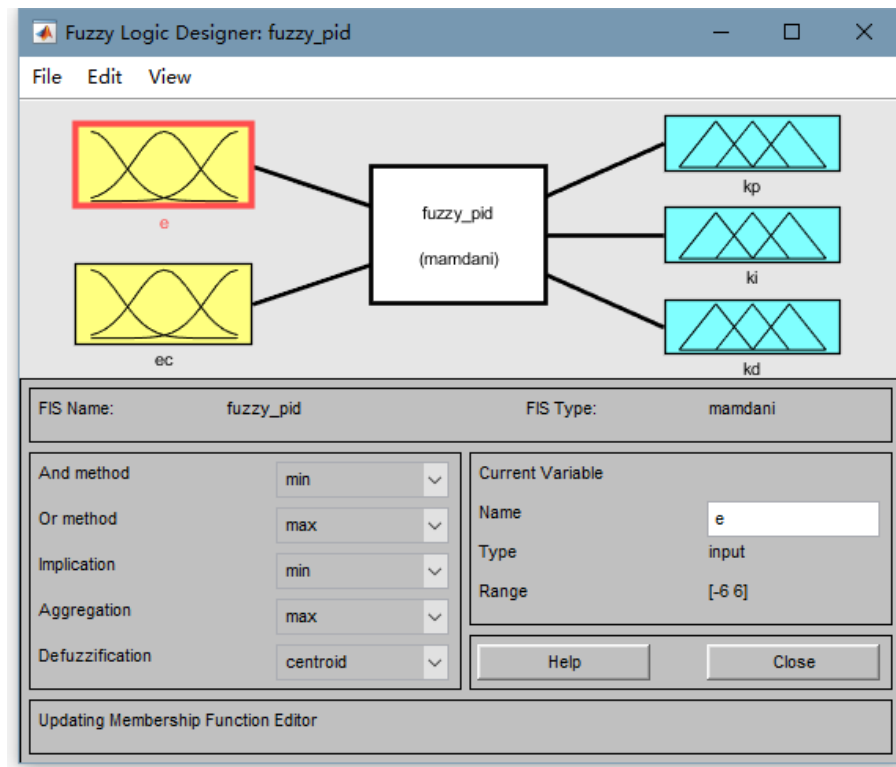


Figure 4 Fuzzy Reasoning System

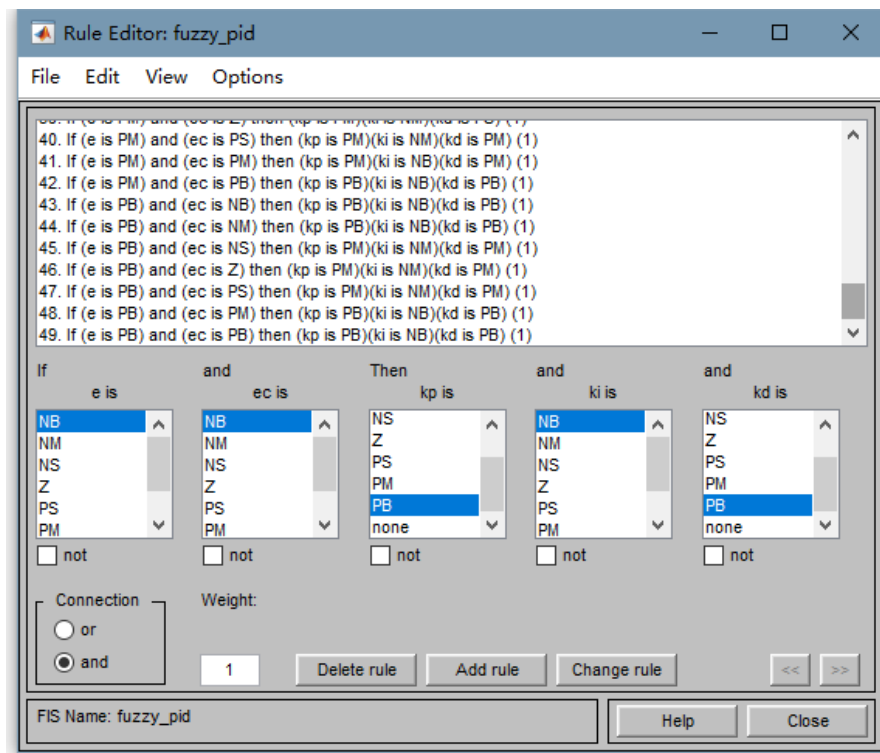


Figure 5 Determination and Modification of Fuzzy Rules

Enter the fuzzy control rules in the rule editor as shown in Table 1, Table 2, and Table 3. The interface of the fuzzy rule editor is shown in Figure 3 and Figure 4 after completion.

Result and Discussion

In this control system, the given value of the temperature is 85°C. The Fuzzy PID controller structure for simulation is shown in Figure 5. According to the experience and simulation, the initial values of PID controller parameters are $K_p = 3$, $K_i = 0.07$, $K_d = 0$. To better show the control effect of fuzzy PID control, the PID control and fuzzy control are added into this simulation, as shown in Figure 6.

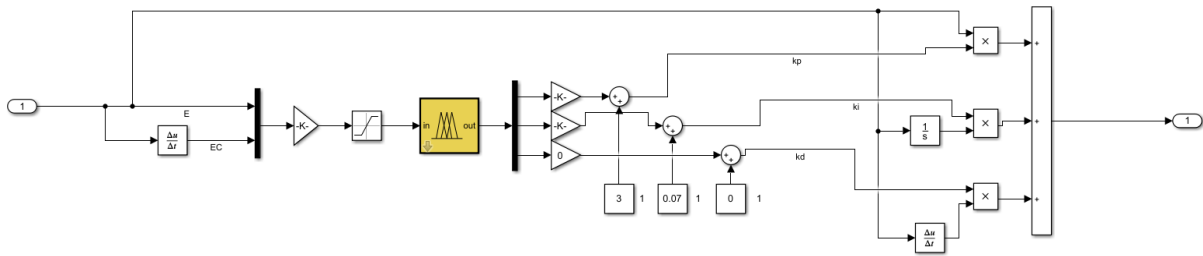


Figure 6 Fuzzy PID Controller

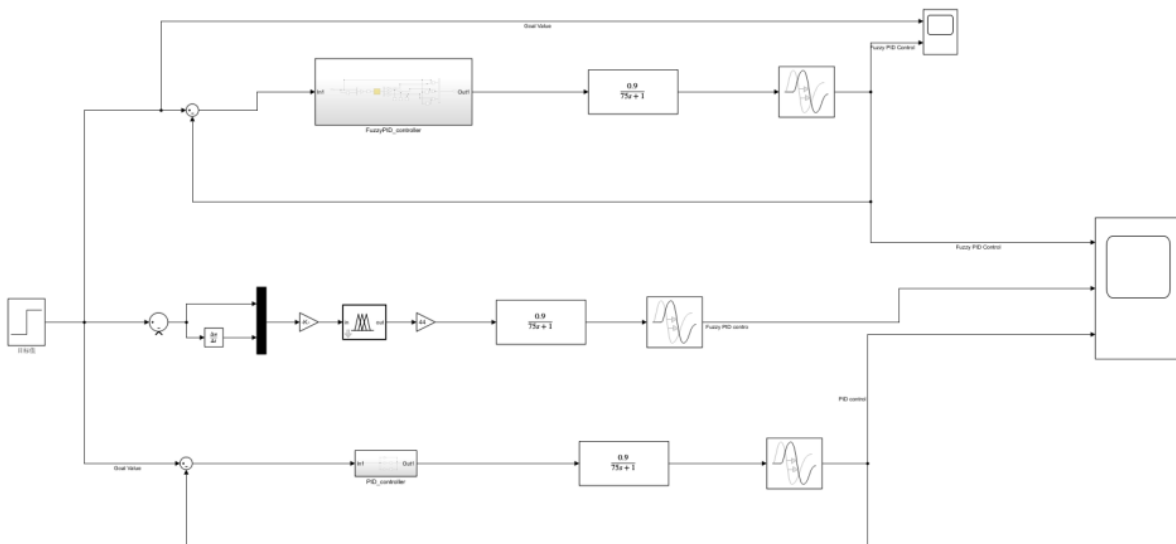


Figure 7 Simulation Chart for Electric Boiler Control System

The simulation time is 500 seconds, and these control systems' step response output curves are shown in Figure 7.

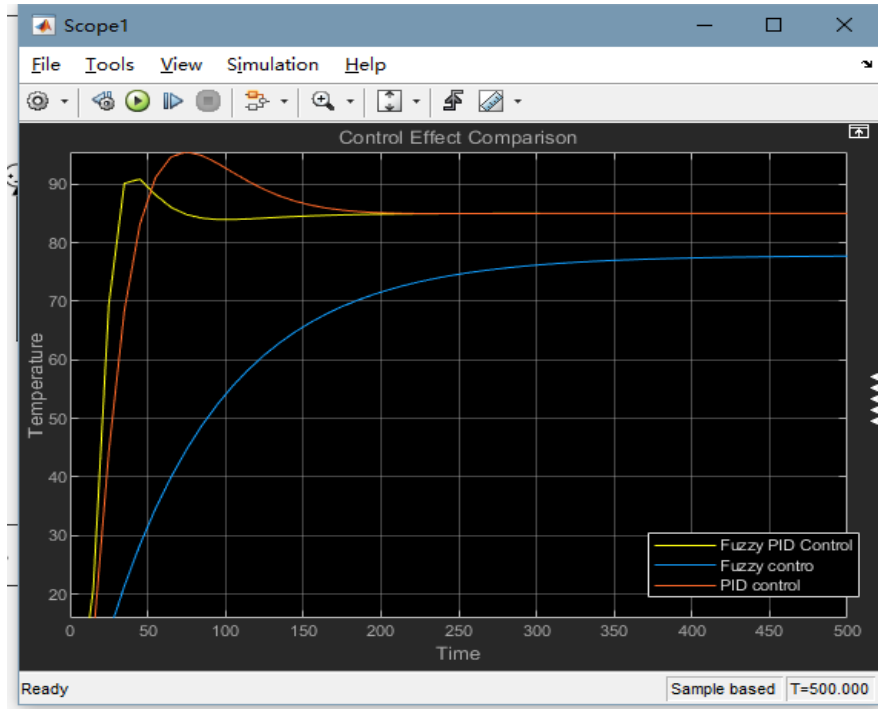


Figure 8 Step Response Output Curves of Different Control Systems

As shown in Figure 7, comparing the results of PID control, fuzzy control, and fuzzy PID control, it can be found that the response of the PID control system is prone to oscillation and overshoot. However, fuzzy control can reduce the oscillation of the system, there is a steady-state error, and the steady-state error is large. Fuzzy PID control overcomes the shortcomings of pure PID control and fuzzy control and realizes the ideal performance indicators of short system adjustment time, small overshoot, and small steady-state error.

Conclusions

Fuzzy PID control is based on the conventional PID algorithm by calculating the current system error e and the error change rate ec , using the fuzzy reasoning system, querying the fuzzy matrix table for parameter adjustment. This method is simple, convenient, and easy to use and greatly influences actual control. Using the method of fuzzy reasoning to change the parameters of PID in the dynamic process can play the advantages of the two control methods, overcome the shortcomings, and improve the control quality. The simulation results show that applying the fuzzy PID control method to control the electric boiler temperature control system has strong adaptability and good robustness, and a satisfactory control effect has been achieved.

References

- Du, C., Chen, S., & Liang, X. (2011). Application of Fuzzy Theory in Temperature Control System of Thermoforming Machine. *Procedia Engineering*, 15, 639-643. <https://doi.org/https://doi.org/10.1016/j.proeng.2011.08.119>
- Guo, S., Peters, L., & Surmann, H. (1996). Design and application of an analog fuzzy logic controller. *Fuzzy Systems, IEEE Transactions on*, 4, 429-438. <https://doi.org/10.1109/91.544303>
- Hu, D., Liu, H., Zhu, Y., Li, Q., Wang, J., Zhang, Z., Sun, J., Yang, L., Zhang, Z., & Yuan, J. (2023). A Temperature Control Method of Electric Heating Furnace Based on Fuzzy PID. *Journal of Physics: Conference Series*, 2503(1), 012101. <https://doi.org/10.1088/1742-6596/2503/1/012101>
- Jiantao, K., Shuquan, L., Kunpeng, Z., Yongli, W., Jianfeng, W., Fuhao, S., Danyang, Z., & Feifei, H. (2020). Operational Optimization of Integrated Energy System Based on Coordinated Complementary of Cold, Heat and Electricity Loads. *IOP Conference Series: Earth and Environmental Science*, 546(2), 022034. <https://doi.org/10.1088/1755-1315/546/2/022034>
- Jinyu, J., & Tao, K. (2015, 2015/08). Design and Simulation of fuzzy PID controller based on Simulink. Proceedings of the 3rd International Conference on Mechanical Engineering and Intelligent Systems (ICMEIS 2015),
- Kafle, B. (2020). *Comparison-between-PSO-and-Fuzzy-PID-Controller-for-Speed-Control-of-DC-Motor*. <https://doi.org/10.13140/RG.2.2.23802.72642>
- Li-guo, T. (2012). Design and simulation of Fuzzy-PID controller based on Matlab. *Journal of Tianjin University of Technology and Education*.
- Live, H. J., Wang, H. B., Zhu, X. M., Shen, Z. H., & Chen, J. Y. (2017, 19-21 Dec. 2017). Simulation Research of Fuzzy Auto-Tuning PID Controller Based on Matlab. 2017 International Conference on Computer Technology, Electronics and Communication (ICCTEC),
- Morilla, F. (2012). Benchmark for PID control based on the Boiler Control Problem. *IFAC Proceedings Volumes*, 45(3), 346-351. <https://doi.org/https://doi.org/10.3182/20120328-3-IT-3014.00059>
- Muškinja, N., Rižnar, M., & Golob, M. (2023). Optimized Fuzzy Logic Control System for Diver's Automatic Buoyancy Control Device. *Mathematics*, 11(1), 22. <https://www.mdpi.com/2227-7390/11/1/22>
- Tan, W., Liu, J., Fang, F., & Chen, Y. (2004). Tuning of PID controllers for boiler-turbine units. *ISA Transactions*, 43(4), 571-583. [https://doi.org/https://doi.org/10.1016/S0019-0578\(07\)60169-4](https://doi.org/https://doi.org/10.1016/S0019-0578(07)60169-4)
- Valášková, K., Klietík, T., & Mišanková, M. (2014). *The Role of Fuzzy Logic in Decision Making Process*. <https://doi.org/10.5729/lnms.vol44.143>
- Wang, H. (2014, 26-27 Aug. 2014). Main Steam Temperature Control System Based on Fuzzy Control Scheme. 2014 Sixth International Conference on Intelligent Human-Machine Systems and Cybernetics,
- Wei-wen, C. (2006). Fuzzy Self-adjusting PID Controller Design and its MATLAB Simulation. *Modular Machine Tool & Automatic Manufacturing Technique*.
- Xie, H., Yan, Y., & Zeng, T. (2022, 2022/). Simulations of Fuzzy PID Temperature Control System for Plant Factory. Proceeding of 2021 International Conference on Wireless Communications, Networking and Applications, Singapore.

- Yong-juan, Z. (2009). Design and Simulation of A Fuzzy PID Controller Based on Matlab. *Microcomputer Information*.
- Zhang, X. Y. (2014). Intelligent Information of TS Fuzzy PID Control System of BLDCM. *Advanced Materials Research*, 846-847, 313-316.
<https://doi.org/10.4028/www.scientific.net/AMR.846-847.313>
- Zhou, Y. (2022). A Summary of PID Control Algorithms Based on AI-Enabled Embedded Systems. *Security and Communication Networks*, 2022, 7156713.
<https://doi.org/10.1155/2022/7156713>