


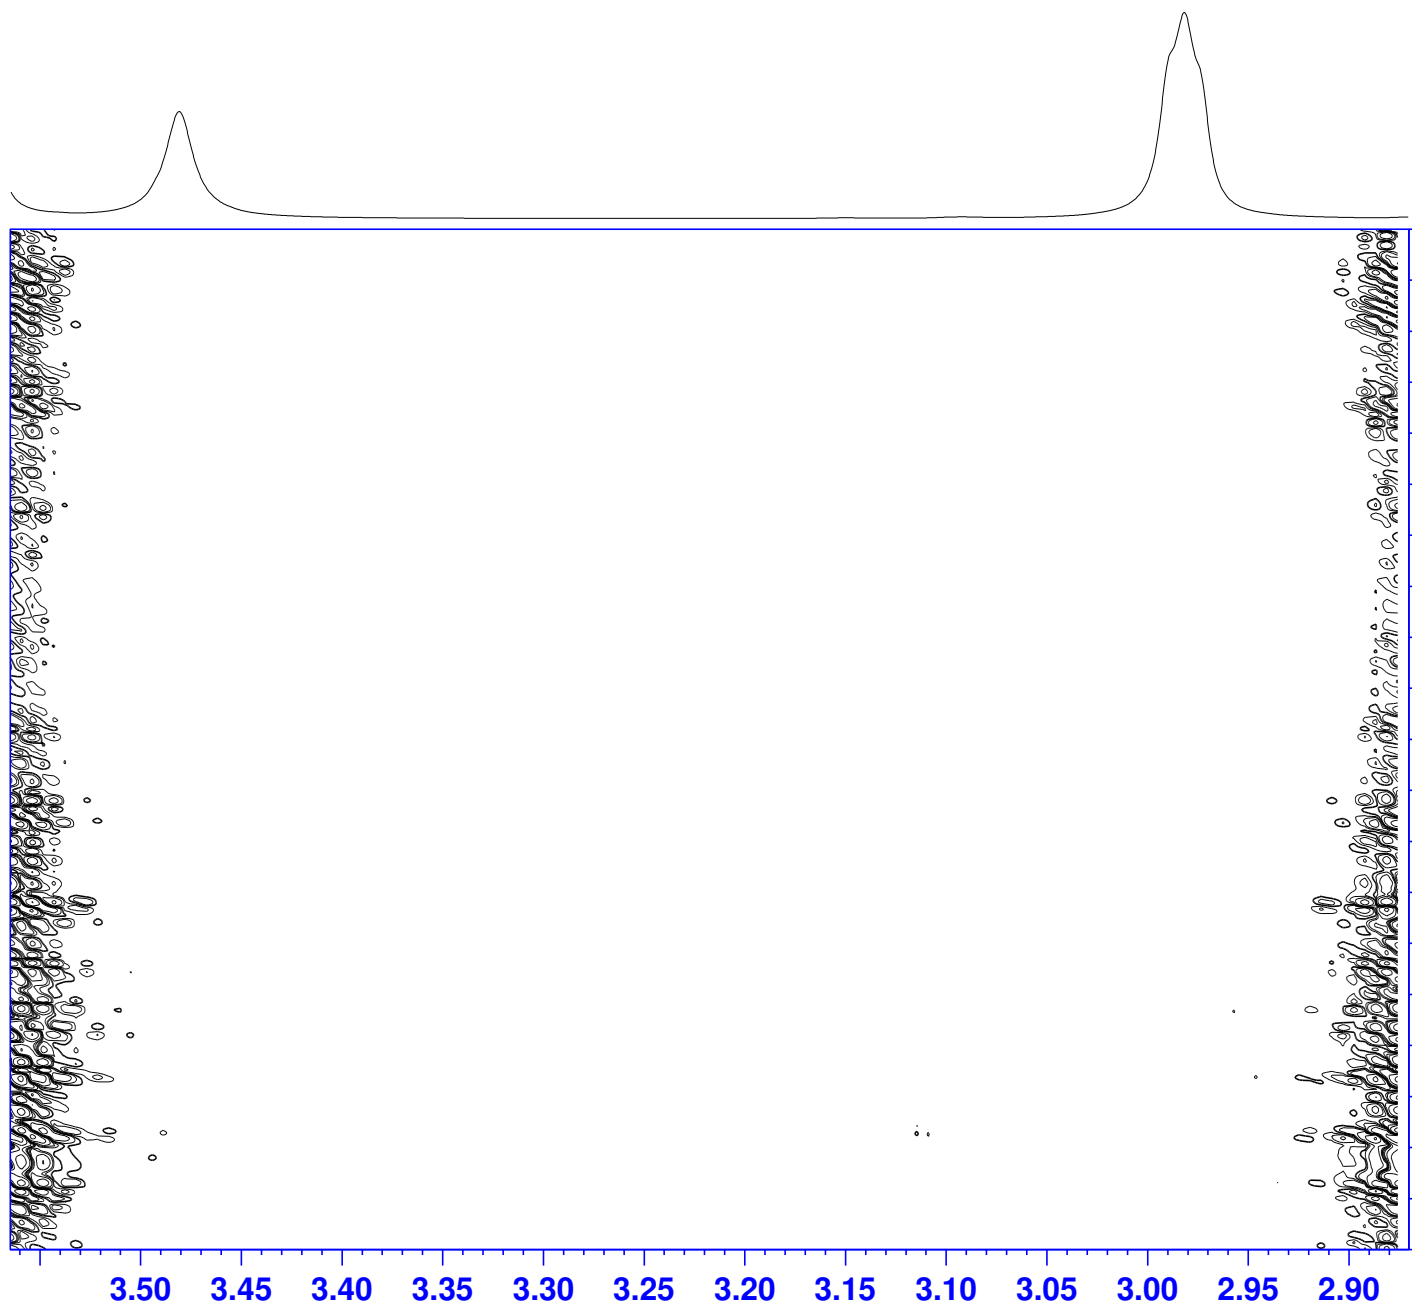

Current Data Parameters
NAME Reserpine
EXPNO 7
PROCNO 1

F2 - Acquisition Parameters
Date_ 20260429
Time 14.44 h
INSTRUM Avance
PROBHD Z181905_0001 (
PULPROG hsqcetgp
TD 104
SOLVENT CDC13
NS 16
DS 8
SWH 416.667 Hz
FIDRES 8.012820 Hz
AQ 0.1248000 sec
RG 101
DW 1200.000 usec
DE 22.00 usec
TE 298.0 K
CNST2 90.0000000
D0 0.0000300 sec
D1 1.00000000 sec
D4 0.00277779 sec
D11 0.03000000 sec
D16 0.00010000 sec
IN0 0.00004111 sec
SPARSELI 0
TDav 1
ZGPTNS
SFO1 600.0519307 MHz
NUC1 1H
P1 12.00 usec
P2 24.00 usec
PLW1 10.78600025 W
SFO2 60.8086187 MHz
NUC2 15N
CPDPRG[2] garp4
P3 35.00 usec
P4 70.00 usec
PCPD2 120.00 usec
PLW2 35.79899979 W
PLW12 3.06682396 W
GPNAM[1] SMSQ10.100
GPZ1 80.00 %
GPNAM[2] SMSQ10.100
GPZ2 8.10 %
P16 1000.00 usec

===== F1 INDIRECT DIMENSION =====
td1 128
sw_F1 200.000000

F1 - Acquisition parameters
TD 16
SFO1 60.80862 MHz
FIDRES 1520.215454 Hz
SW 200.000 ppm
FnMODE Echo-Antiecho

F2 - Processing parameters
SI 128
SF 600.0500000 MHz
WDW QSINE
SSB 2
LB 0 Hz
GB 0
PC 1.40

F1 - Processing parameters
SI 1024
MC2 echo-antiecho
SF 60.8025385 MHz
WDW SINE
SSB 2
LB 0 Hz
GB 0