Ammonia Benchmark Overview: BO as Optimum, DreamerV3 as Best RL Variant, PPO as Baseline

Evaluation Progress Relative to the BO Optimum

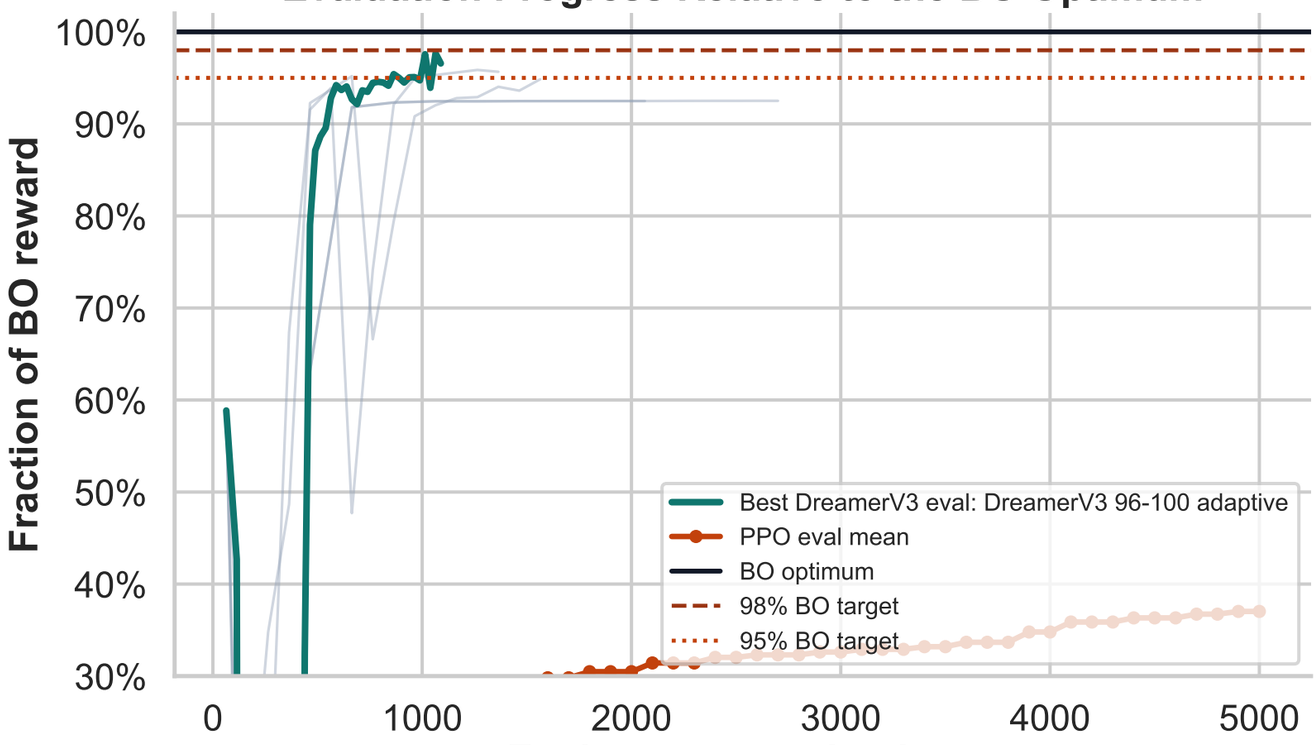

Benchmark Endpoint Comparison

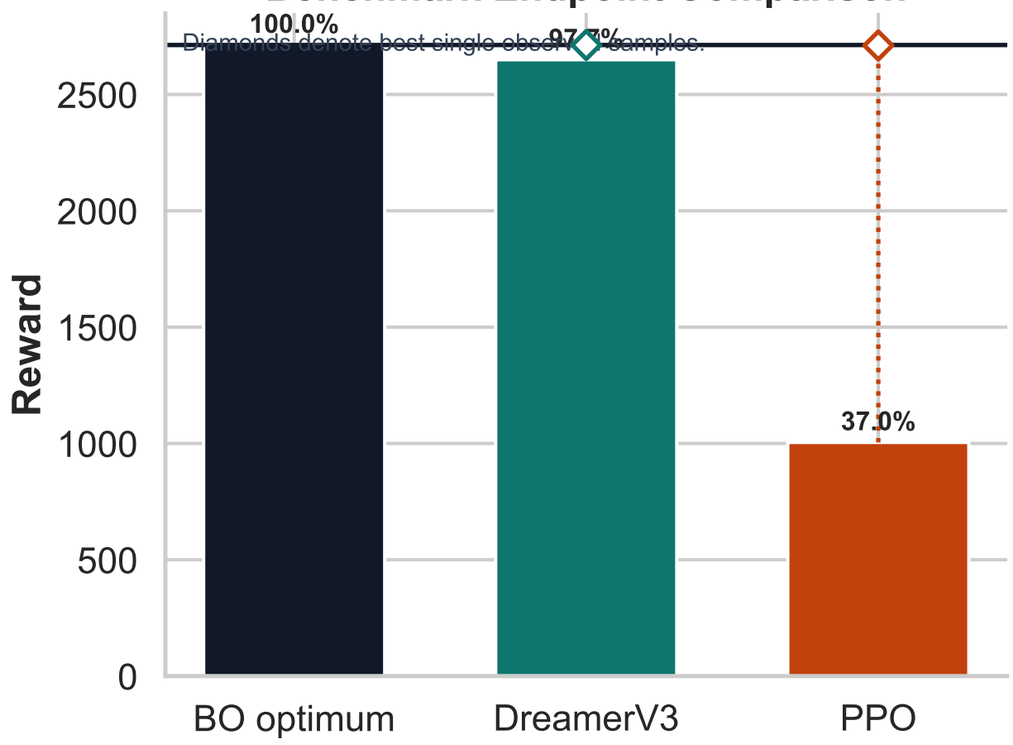

Operating-Point Alignment: BO Optimum vs Best DreamerV3 Single Sample

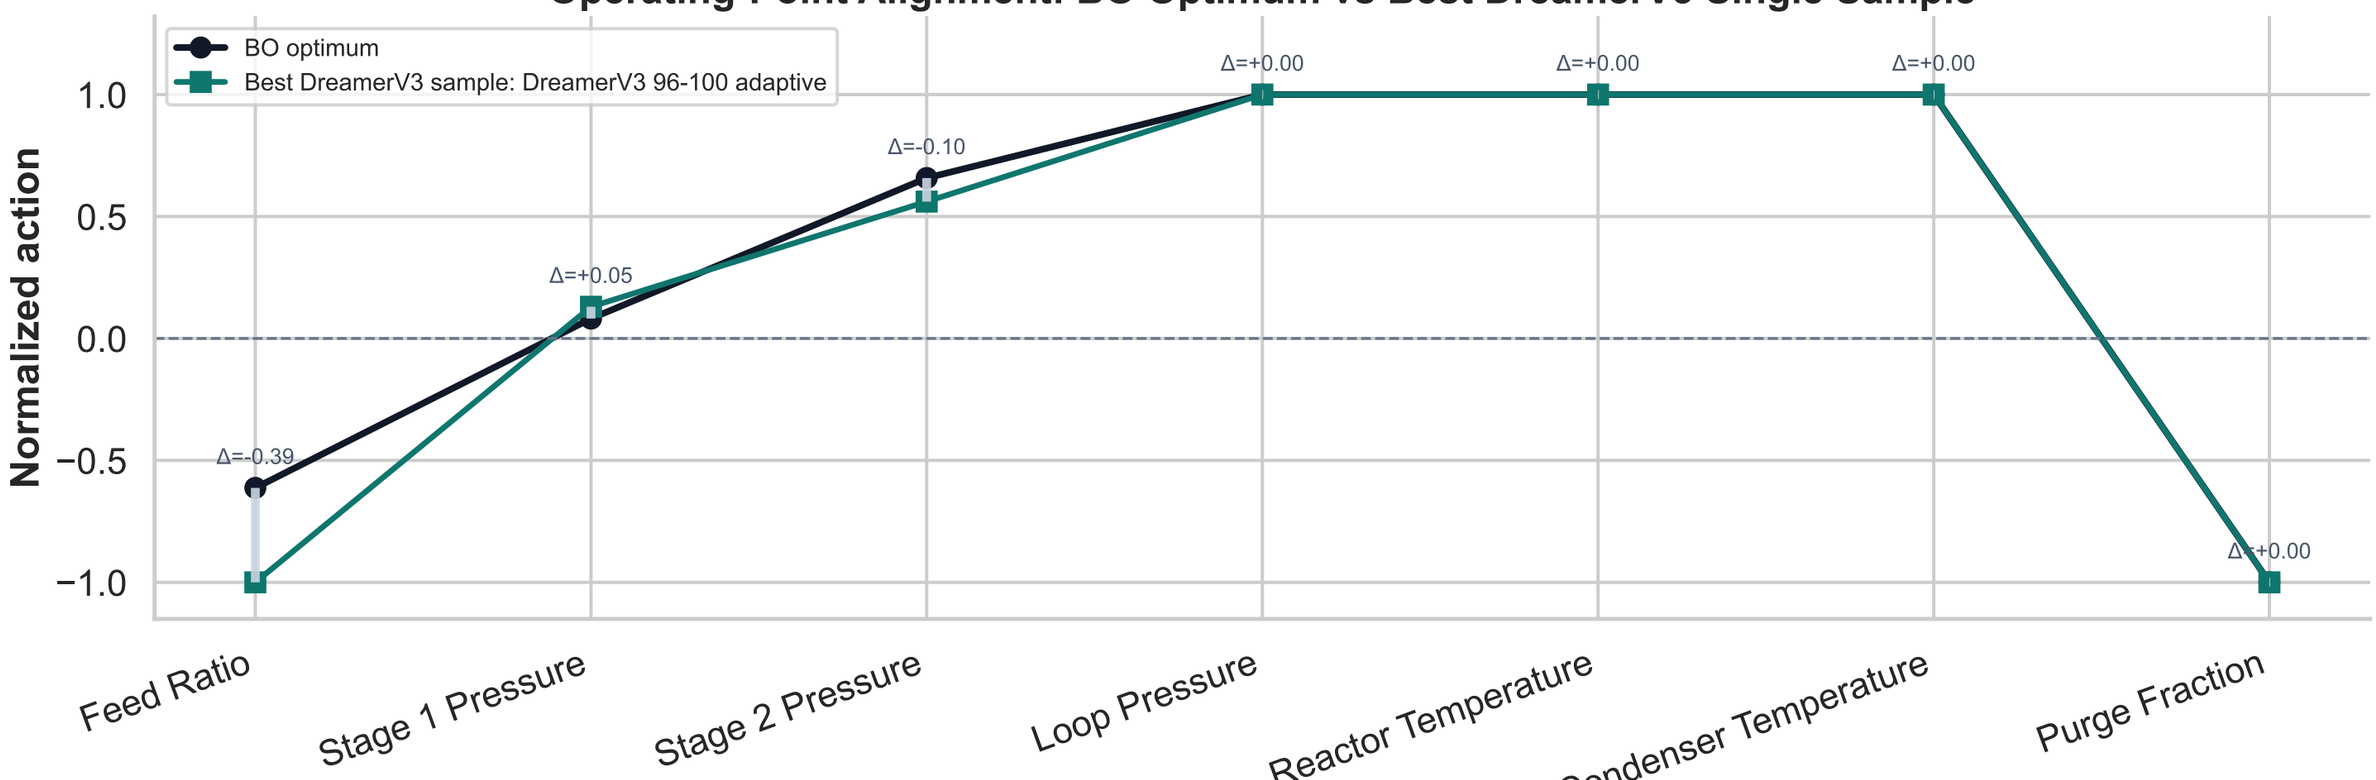

Best DreamerV3 evaluation reward = 2649.39 (97.67% of BO). PPO best evaluation reward = 1004.44 (37.03% of BO).