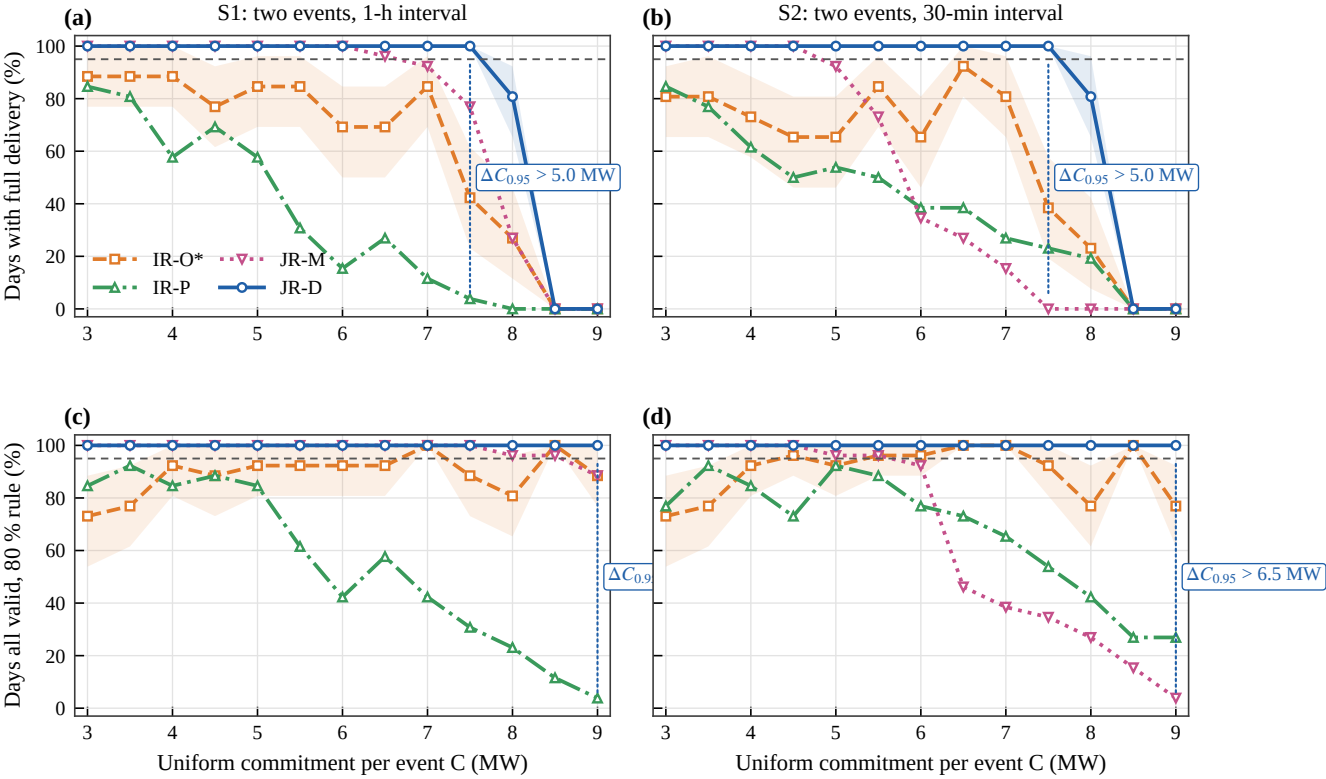
(a)
S1: two events, 1-h interval
(b)
S2: two events, 30-min interval
(c)
(d)
Days with full delivery (%)
Days all valid, 80 % rule (%)
IR-O*
IR-P
JR-M
JR-D
ΔC0.95 > 5.0 MW
ΔC0.95 > 6.5 MW
Uniform commitment per event C (MW)
Uniform commitment per event C (MW)