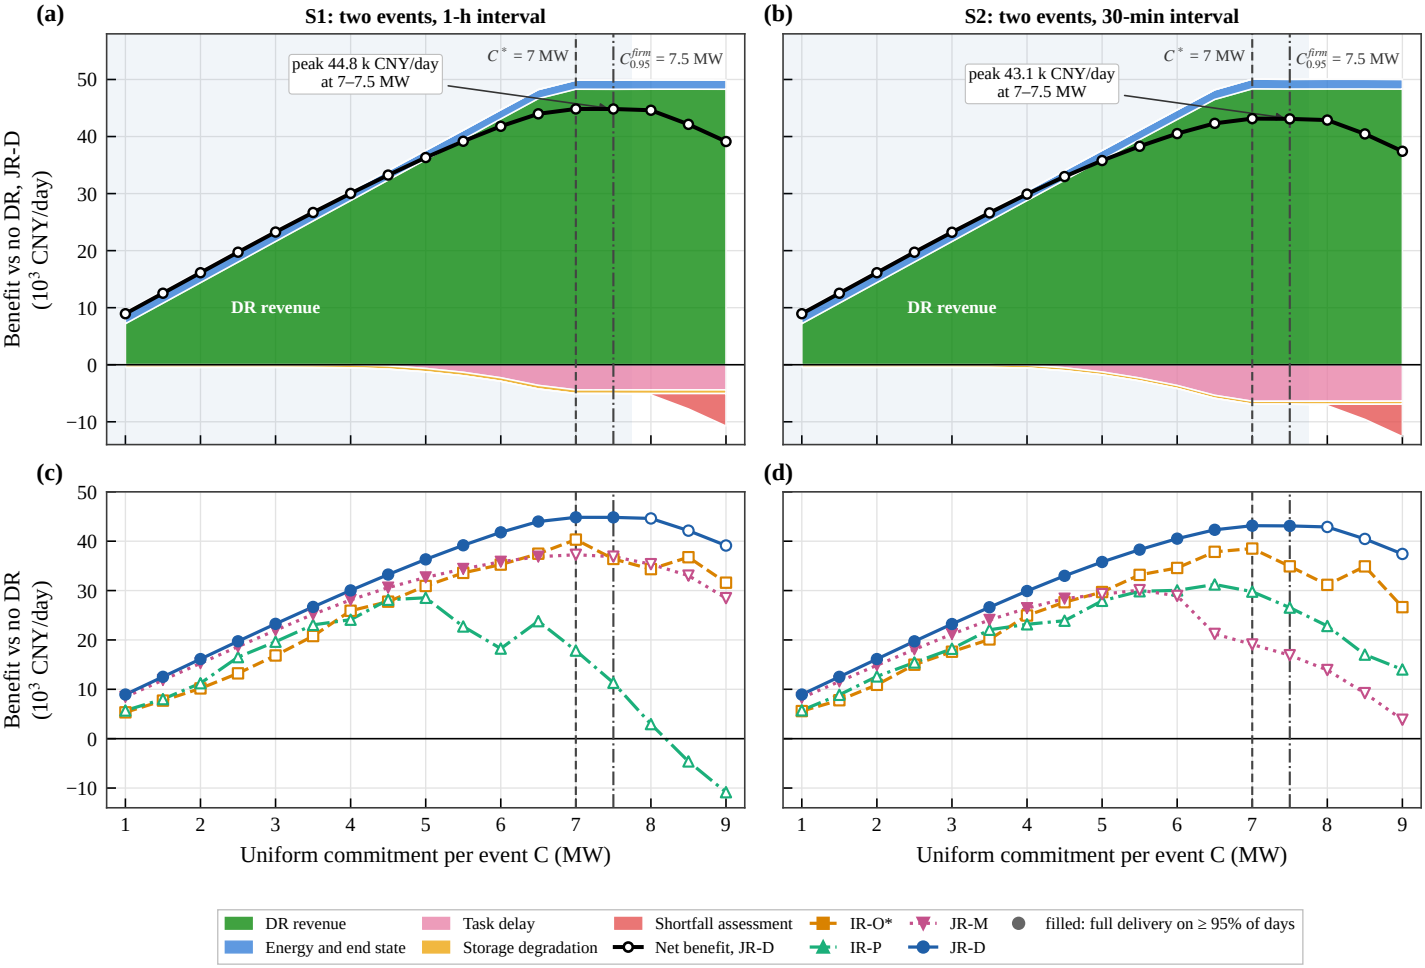
(a)
S1: two events, 1-h interval
peak 44.8 k CNY/day
at 7–7.5 MW
$C^* = 7$ MW
$C^{firm}_{0.95} = 7.5$ MW
DR revenue
Benefit vs no DR, JR-D
(10^3 CNY/day)
(b)
S2: two events, 30-min interval
peak 43.1 k CNY/day
at 7–7.5 MW
$C^* = 7$ MW
$C^{firm}_{0.95} = 7.5$ MW
DR revenue
(c)
Benefit vs no DR
(10^3 CNY/day)
Uniform commitment per event C (MW)
(d)
Uniform commitment per event C (MW)
DR revenue
Energy and end state
Task delay
Storage degradation
Shortfall assessment
Net benefit, JR-D
IR-O*
IR-P
JR-M
JR-D
filled: full delivery on ≥ 95% of days