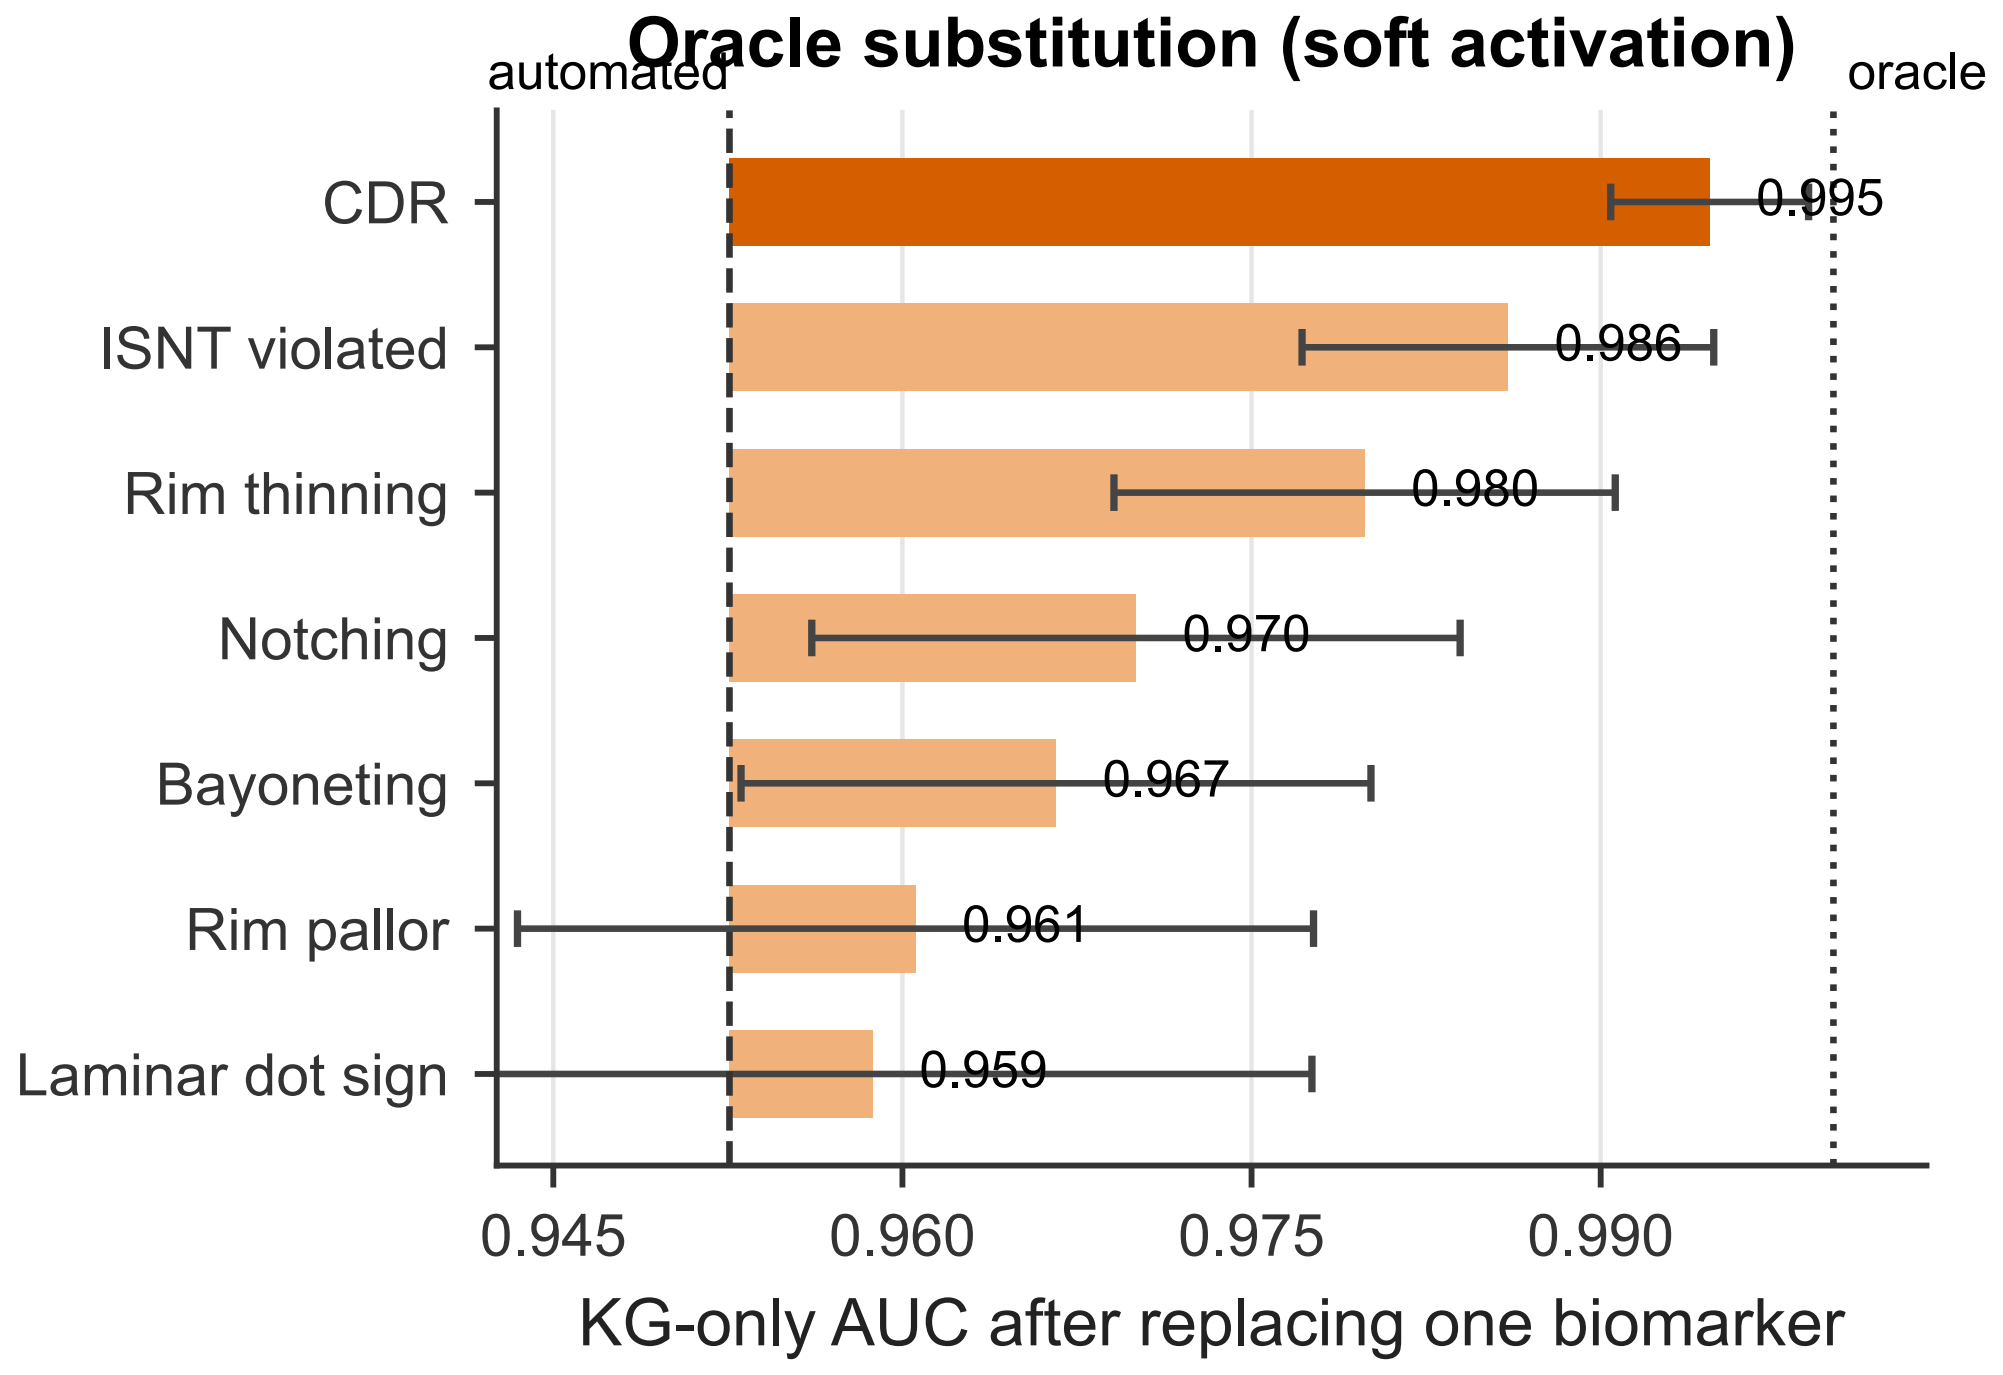
Oracle substitution (soft activation)
automated
oracle
CDR
ISNT violated
Rim thinning
Notching
Bayoneting
Rim pallor
Laminar dot sign
0.995
0.986
0.980
0.970
0.967
0.961
0.959
0.945
0.960
0.975
0.990
KG-only AUC after replacing one biomarker