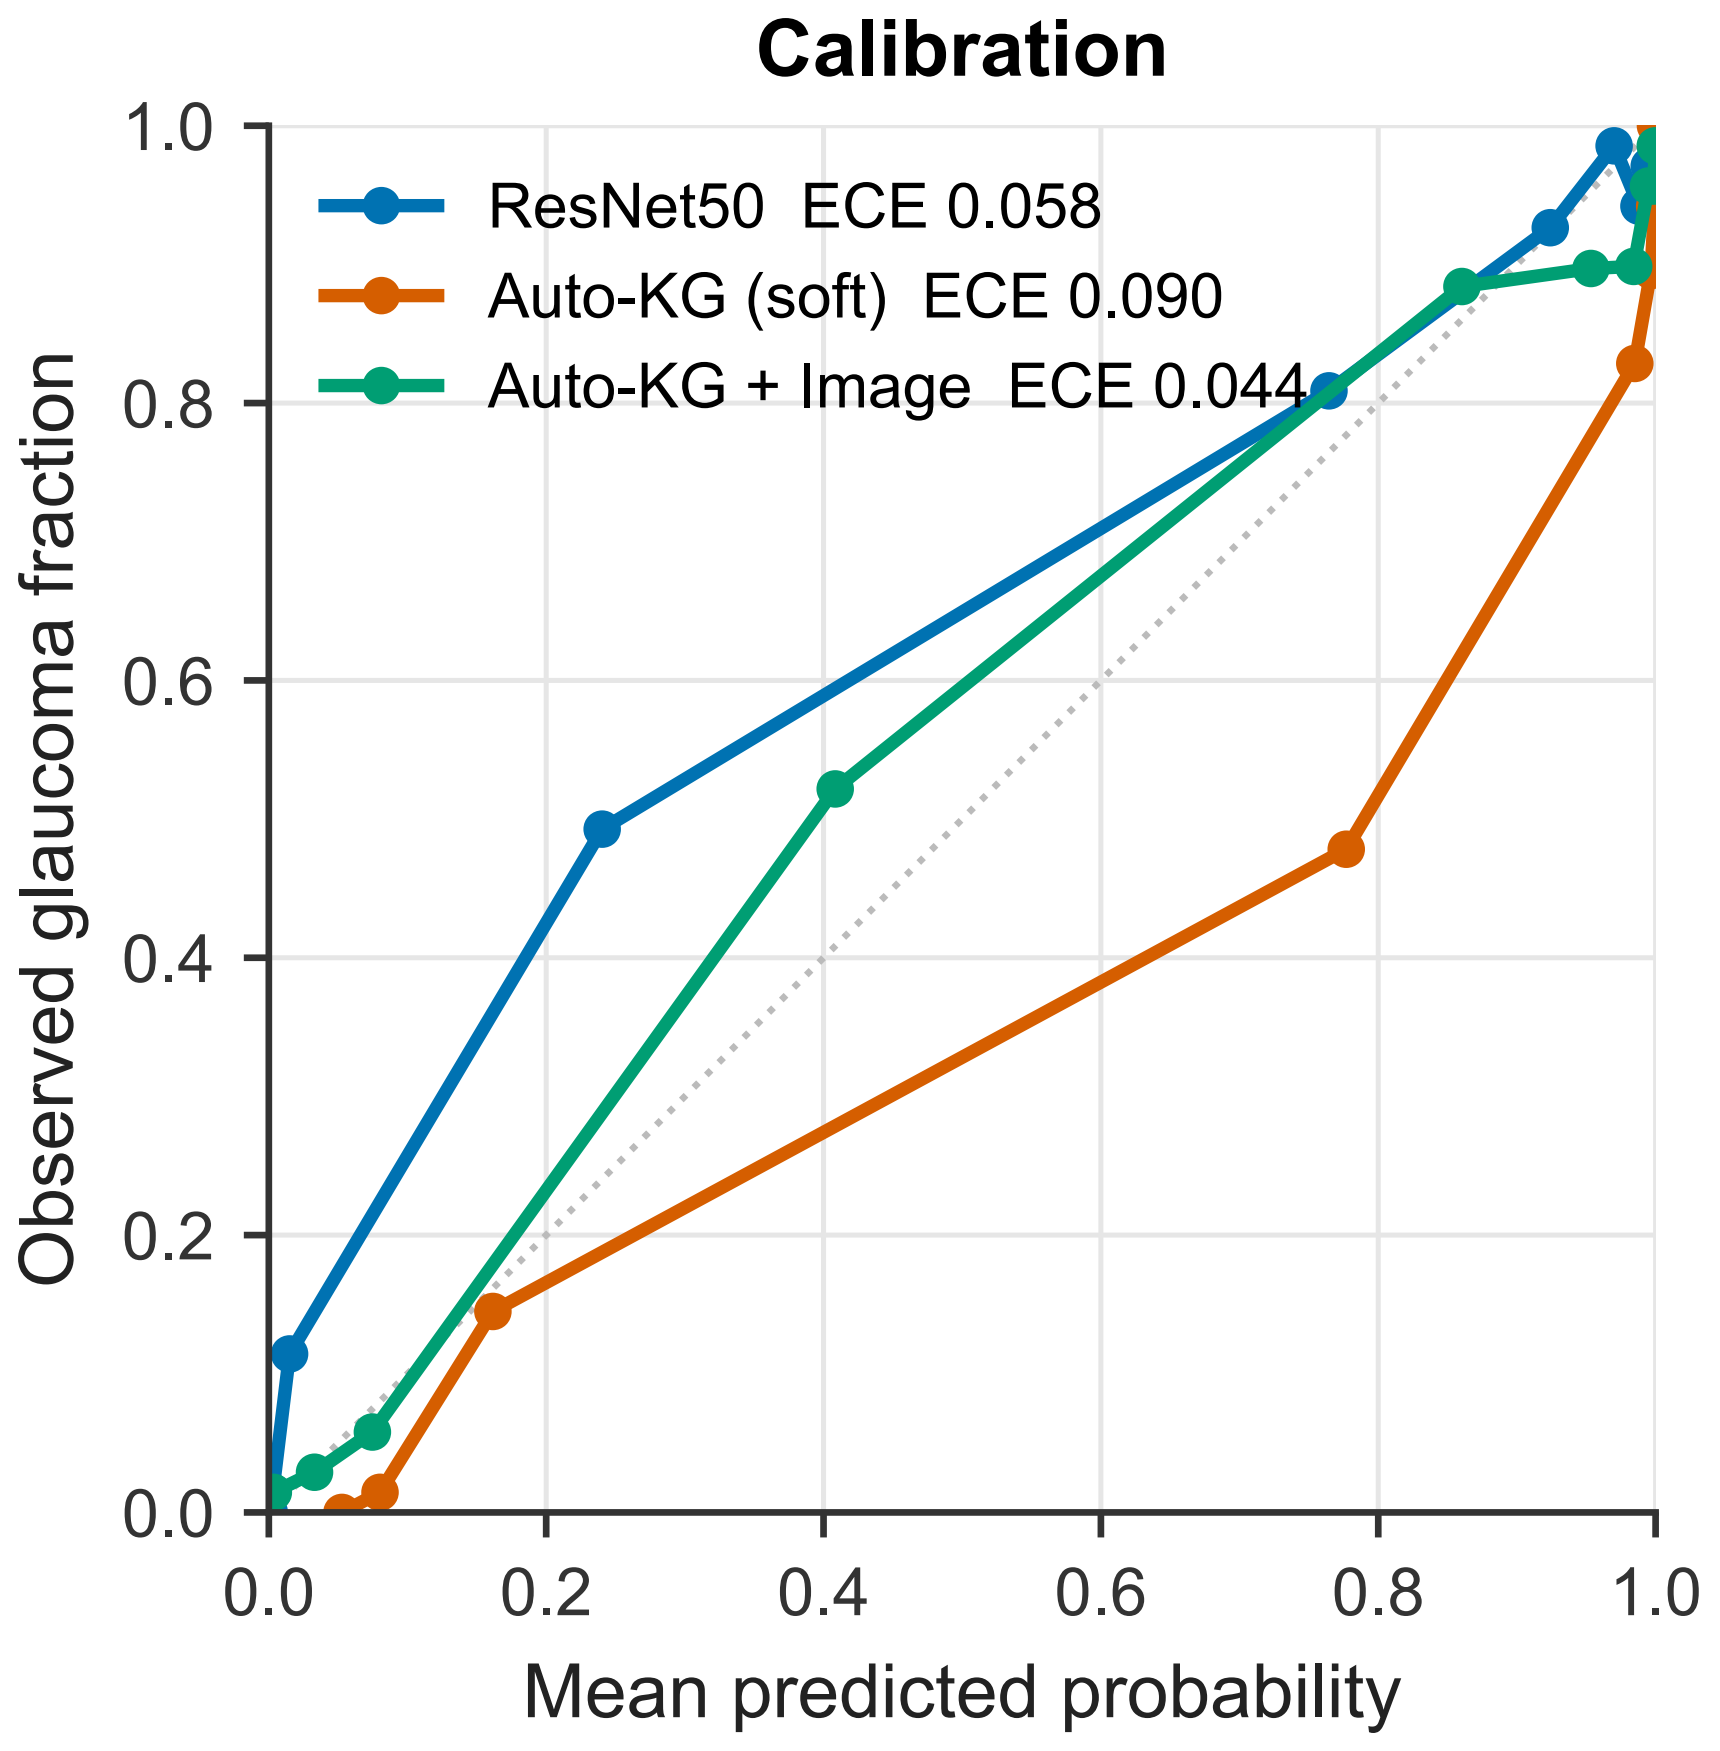
Calibration
ResNet50 ECE 0.058
Auto-KG (soft) ECE 0.090
Auto-KG + Image ECE 0.044
Observed glaucoma fraction
Mean predicted probability
0.0
0.2
0.4
0.6
0.8
1.0