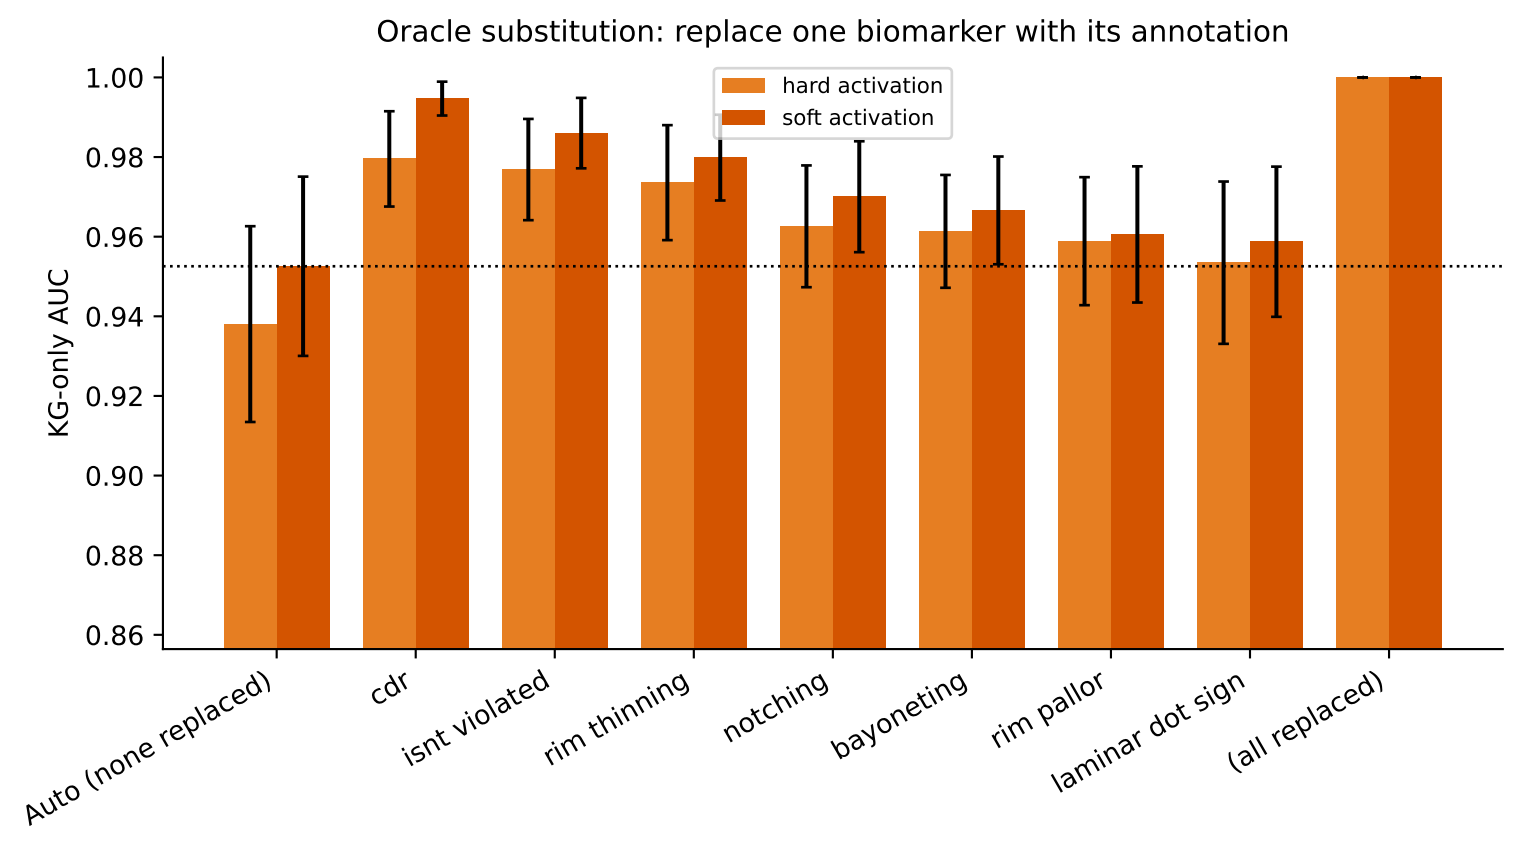
Oracle substitution: replace one biomarker with its annotation
hard activation
soft activation
KG-only AUC
1.00
0.98
0.96
0.94
0.92
0.90
0.88
0.86
Auto (none replaced)
cdr
isnt violated
rim thinning
notching
bayoneting
rim pallor
laminar dot sign
(all replaced)