


Temperature Change (°C)

Placebo Filter Real Filter

Fan Off

Fan On

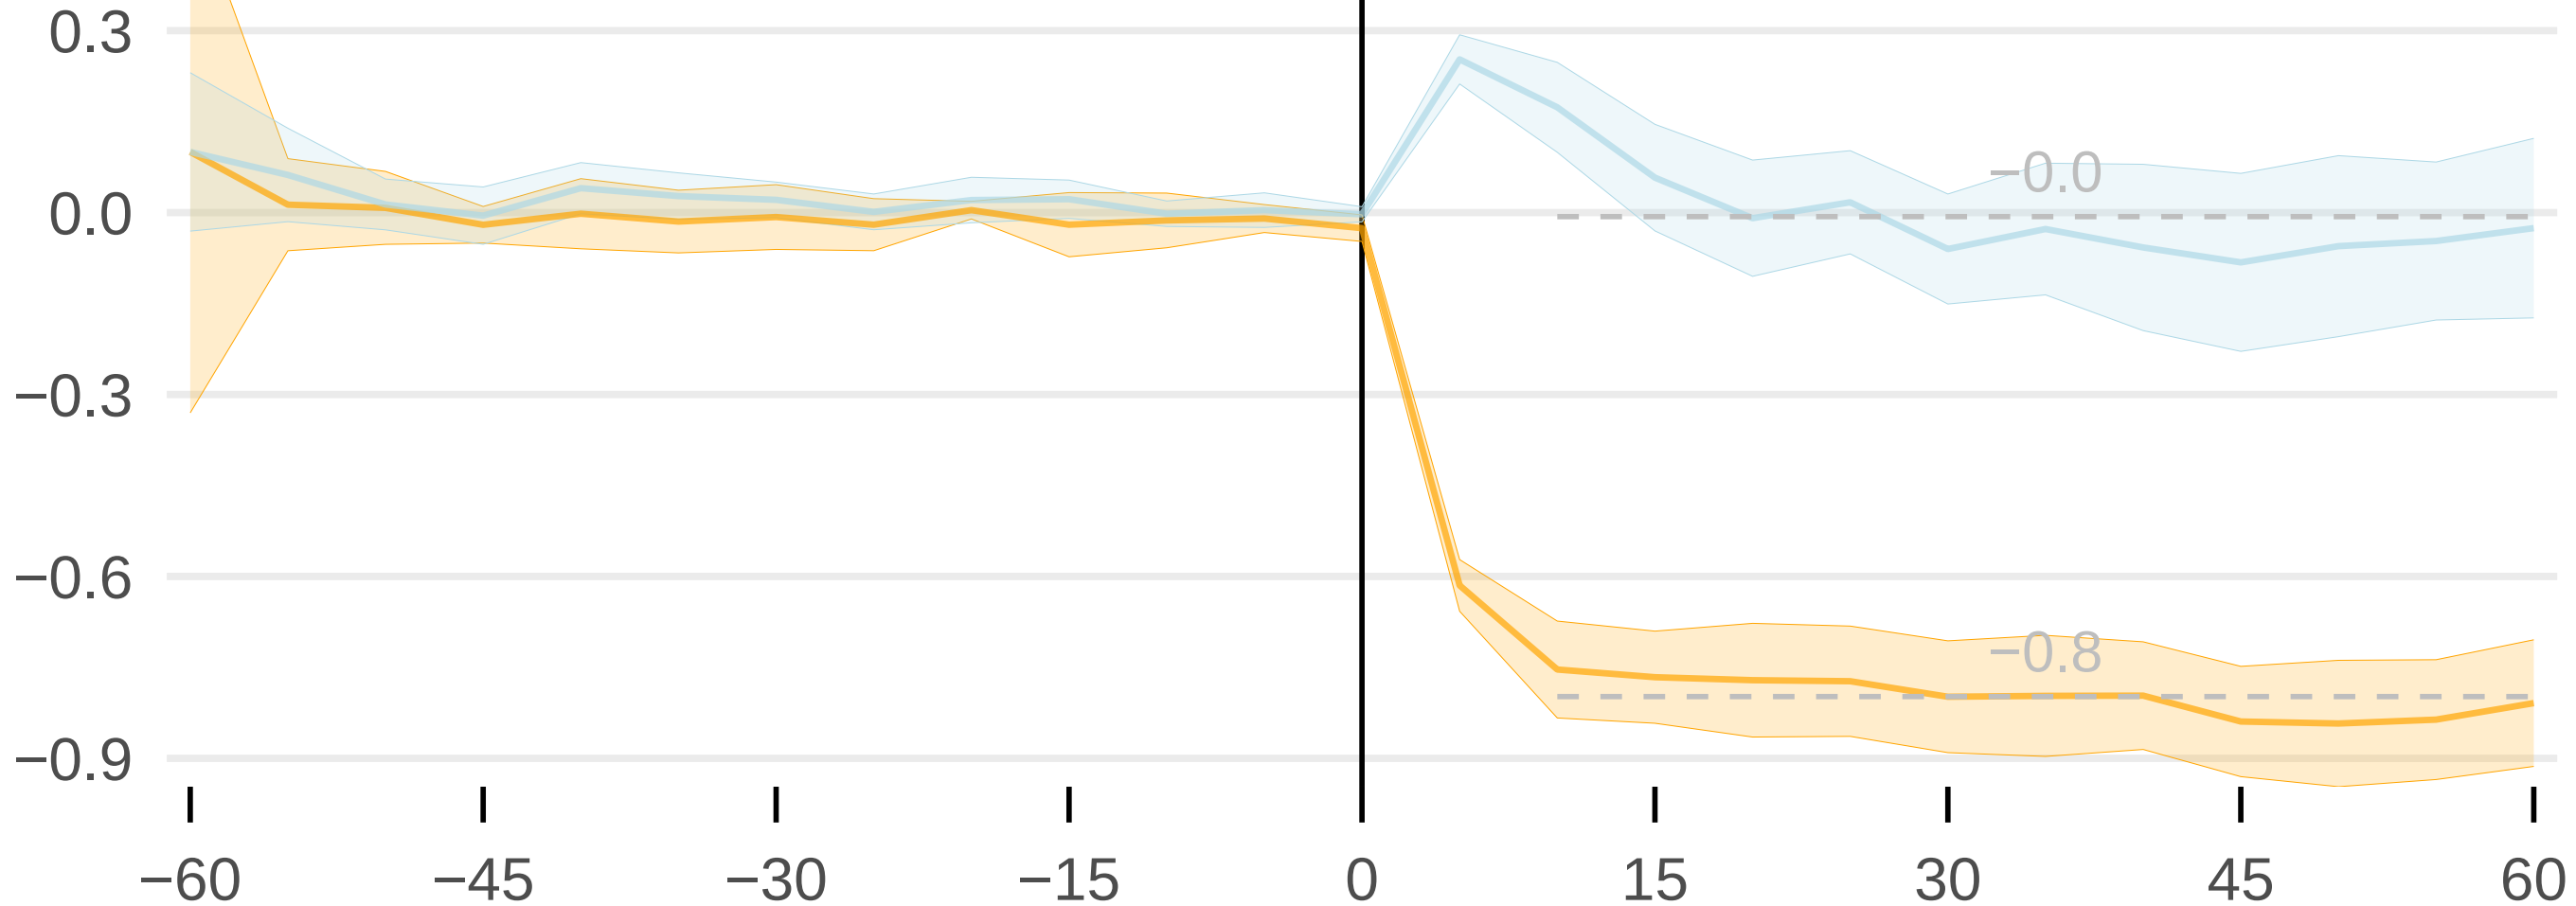

Minutes Since Fans Turned On