CMS *ETL ETROC Charge Injection*
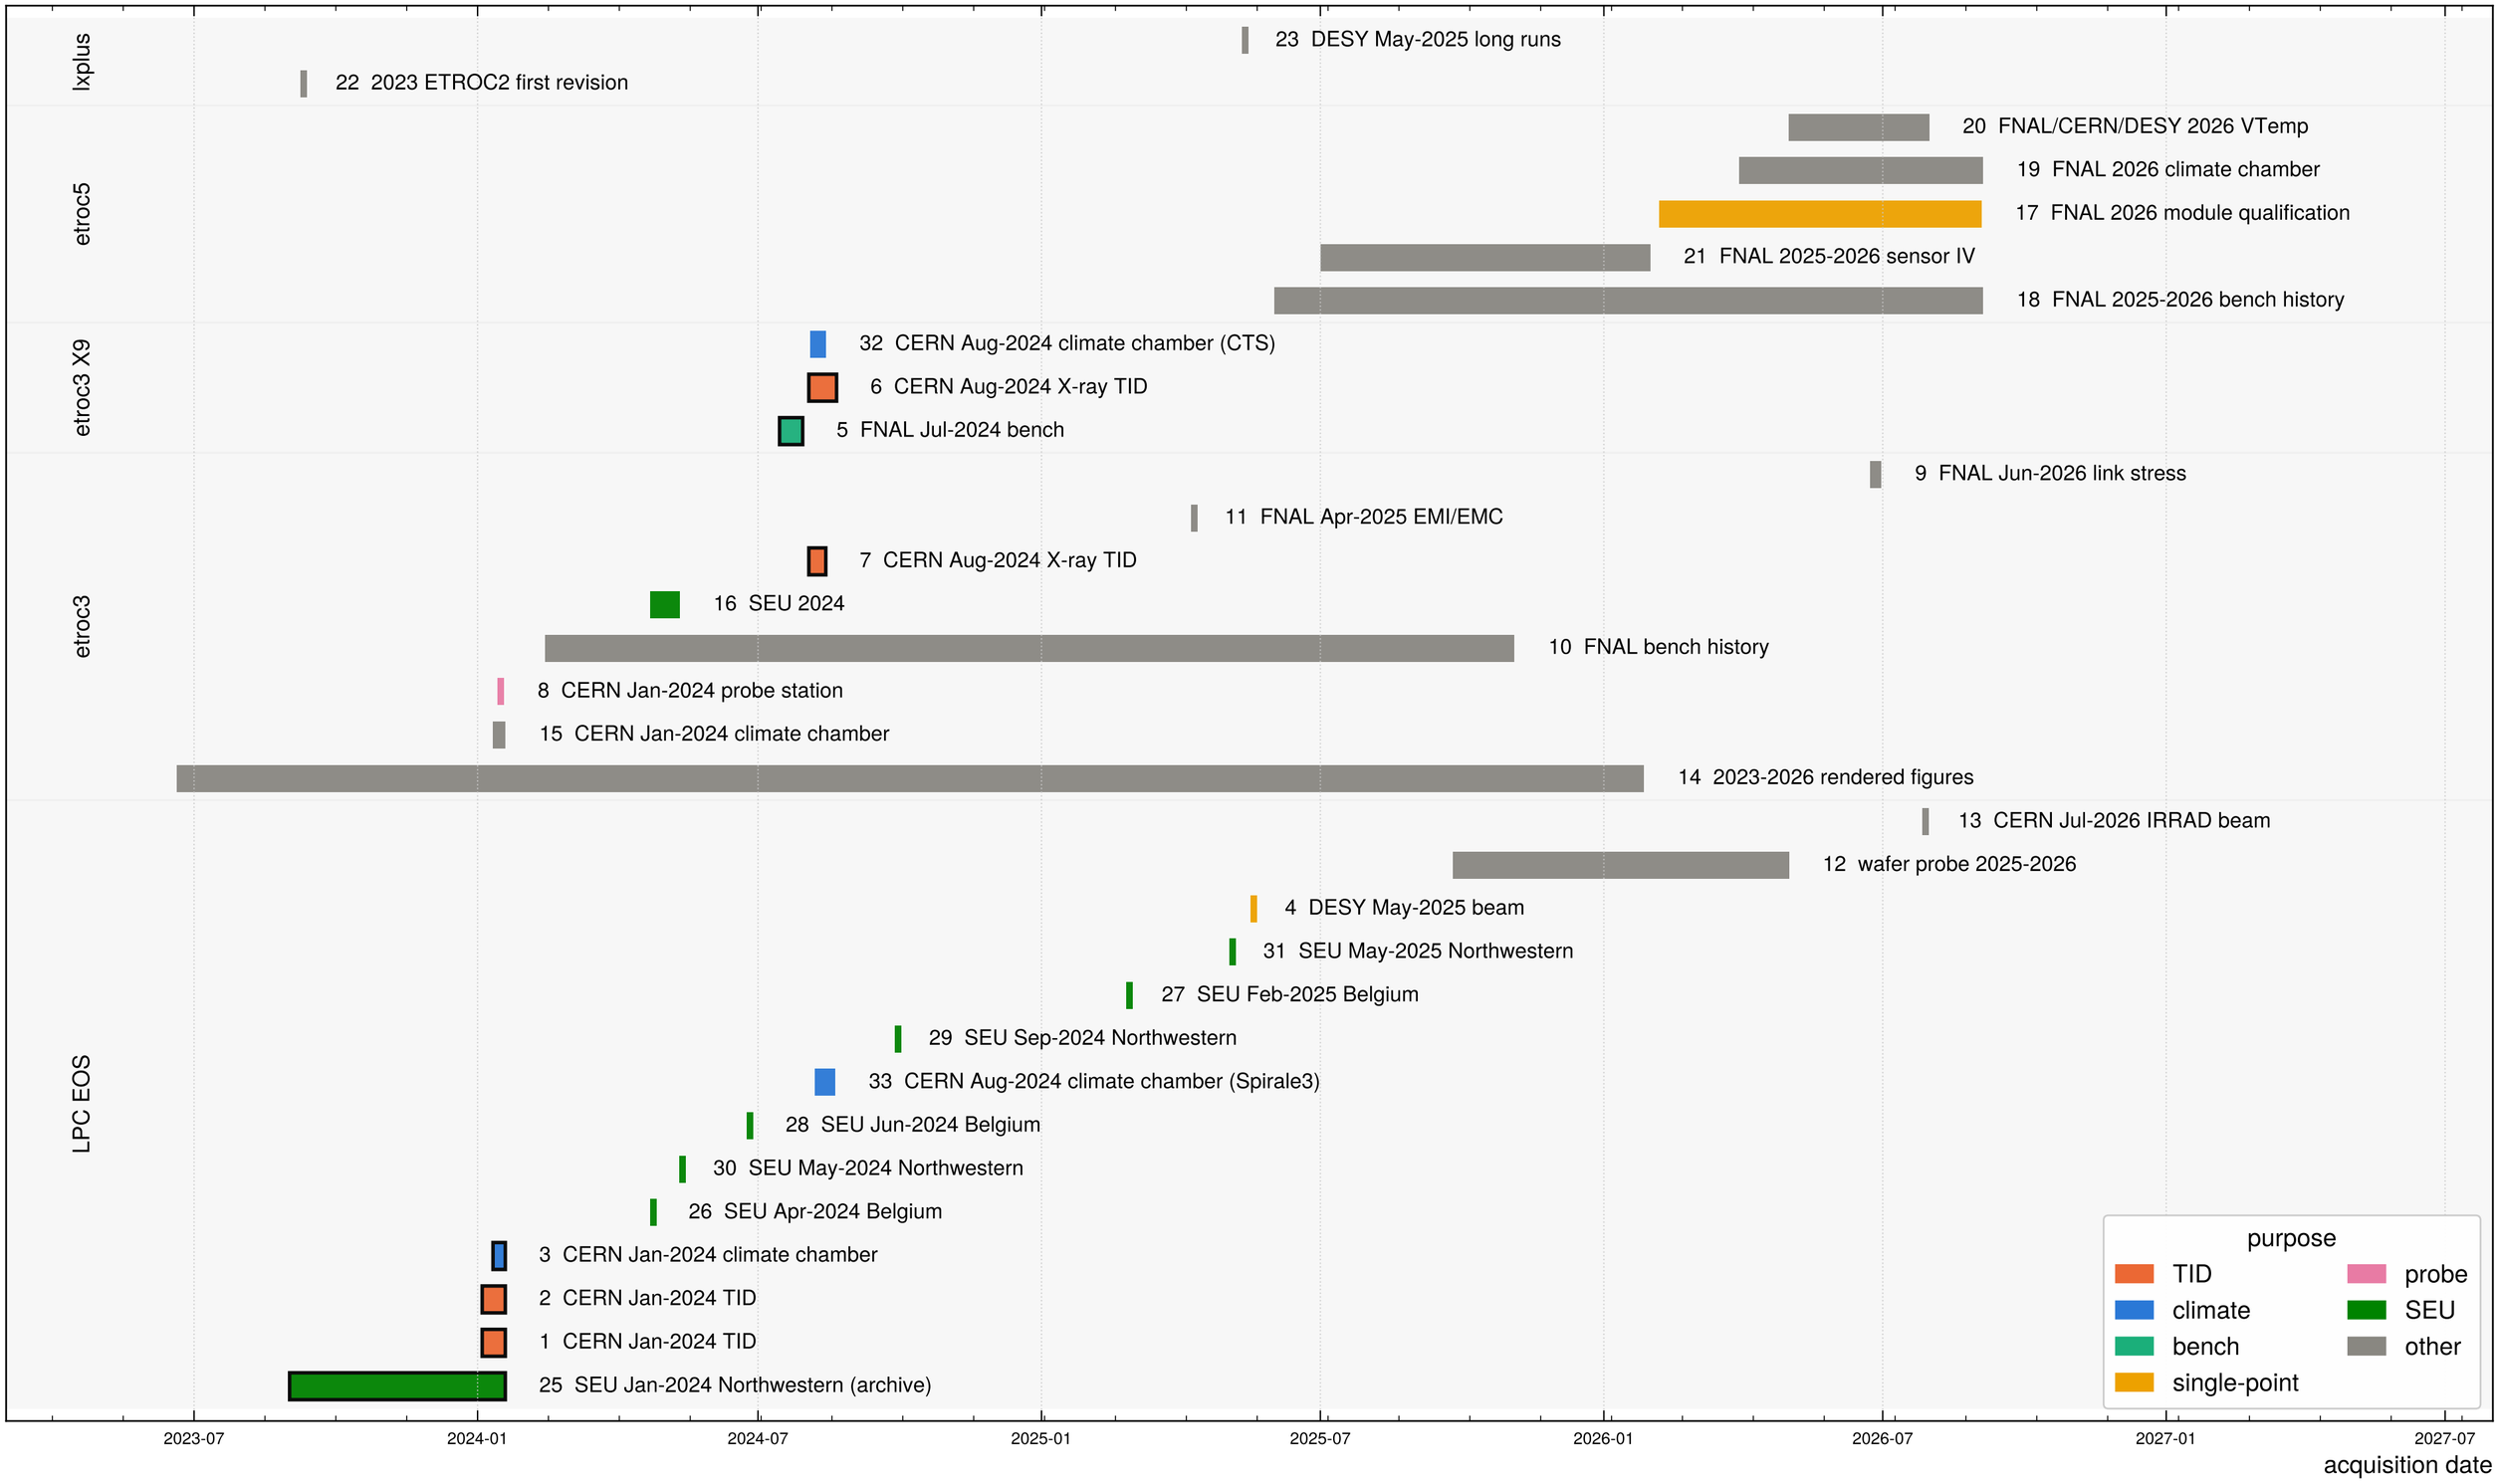
Timeline of charge-injection data sets
a black outline marks a charge × threshold scan; row 24, a whole-location negative, is not drawn
Data census, 2026-09