



COMPASS_Iron_Reacidification_Comparison_2026


Zoe Read

2026-04-14

##Collected samples from TEMPEST and GCW TR in March 2026. Some samples were added directly to vials with 75 uL of 50% HCl in the field, some samples were added to empty vials, and then those were acidified in the lab a few weeks later using 75 uL HCl.

Mean with SD Plot Acidified vs Re-acidified Samples

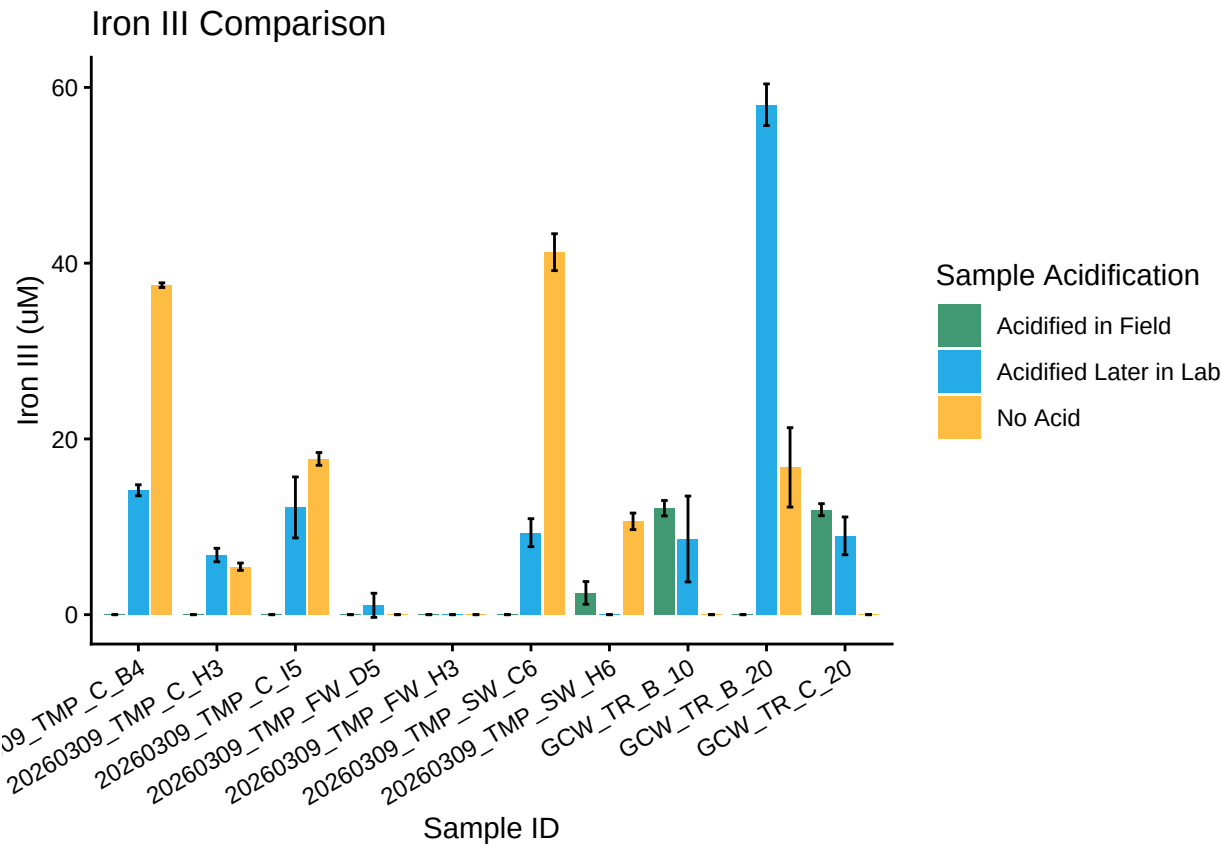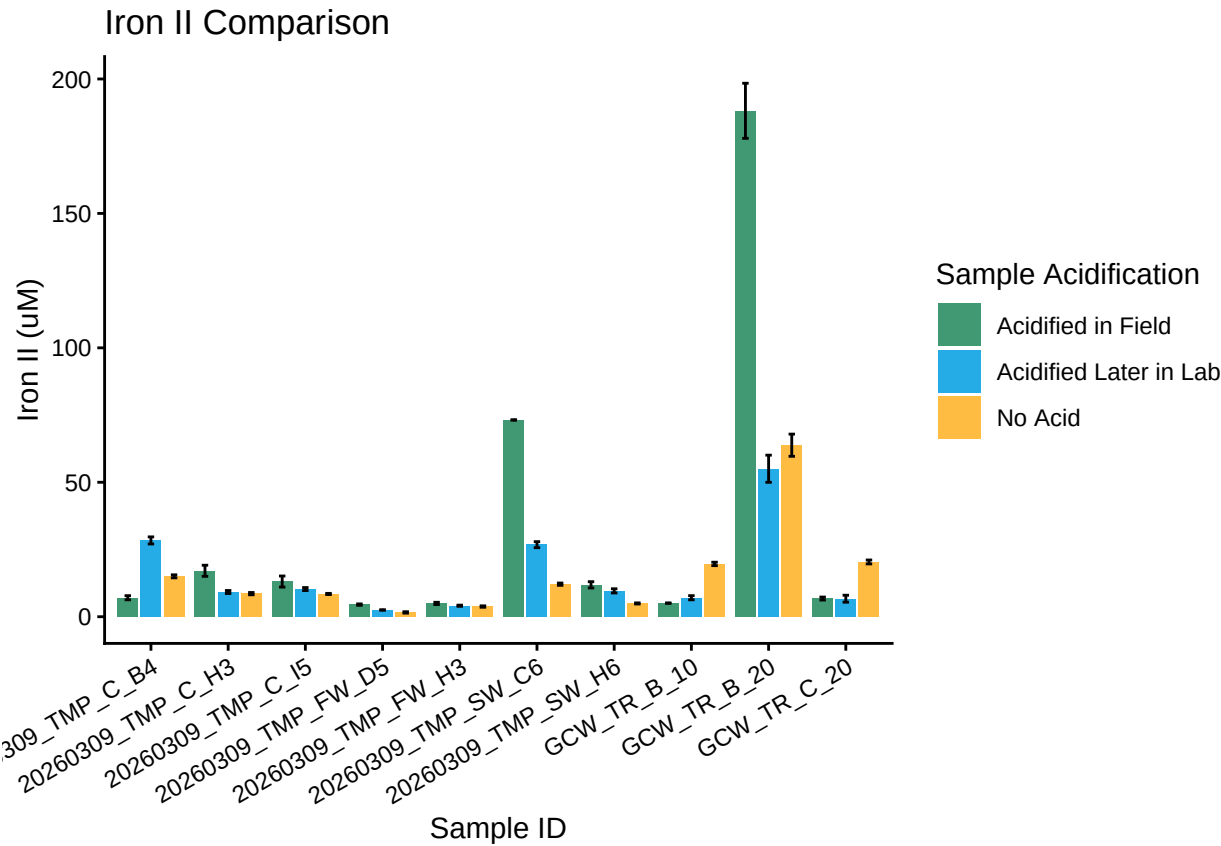

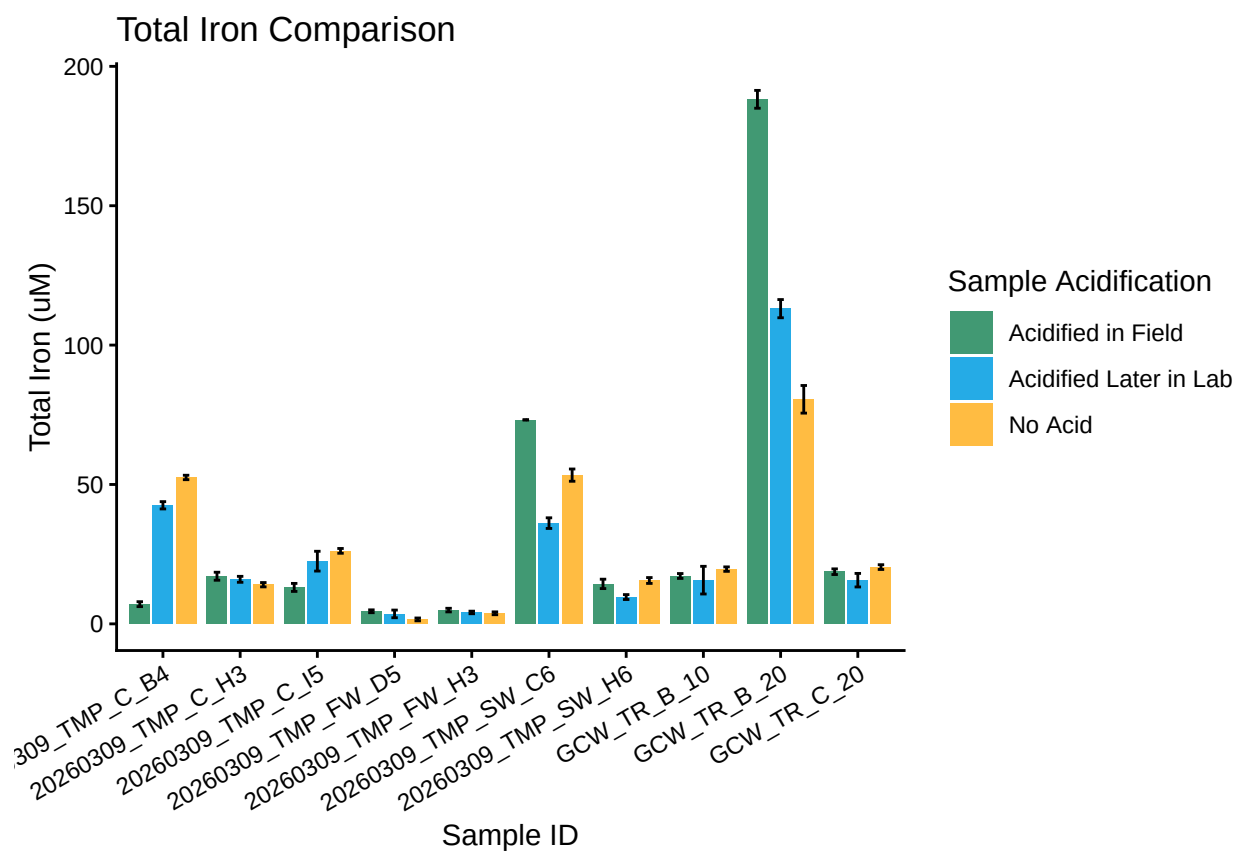

Plotting values against each other

