




A-A
(Not to Scale Indicative 1:100)
B-B
Total L=95.000 m
CW=7.500 m
A1 W=8.900 m
A2 W=8.900 m
47.500 m
47.500 m
KERB=1.2 m
KERB=1.2 m
KERB=1.2 m
KERB=1.2 m
CL
CL
CL
CL



CONTINUOUS WEARING COAT OVER APPROACH SLABS
(Not to Scale — Indicative)
RL 0.000
PL -0.600
N LEVEL
EXISTING GROUND LEVEL
BED LEVEL
CHAINAGE



CL
KERB L=0.25 m
KERB R=0.25 m
CAMBER 20 mm (IRC:112 Cl.6.5)
2.0% XF
R 900mm
RL 0.000 TOP OF WC / RL
RL -0.265 SOFFIT OF SLAB
GD=1.800m
RL -2.065 GIRDER SOFFIT / RL
CW=7.500 m
OW=8.900 m

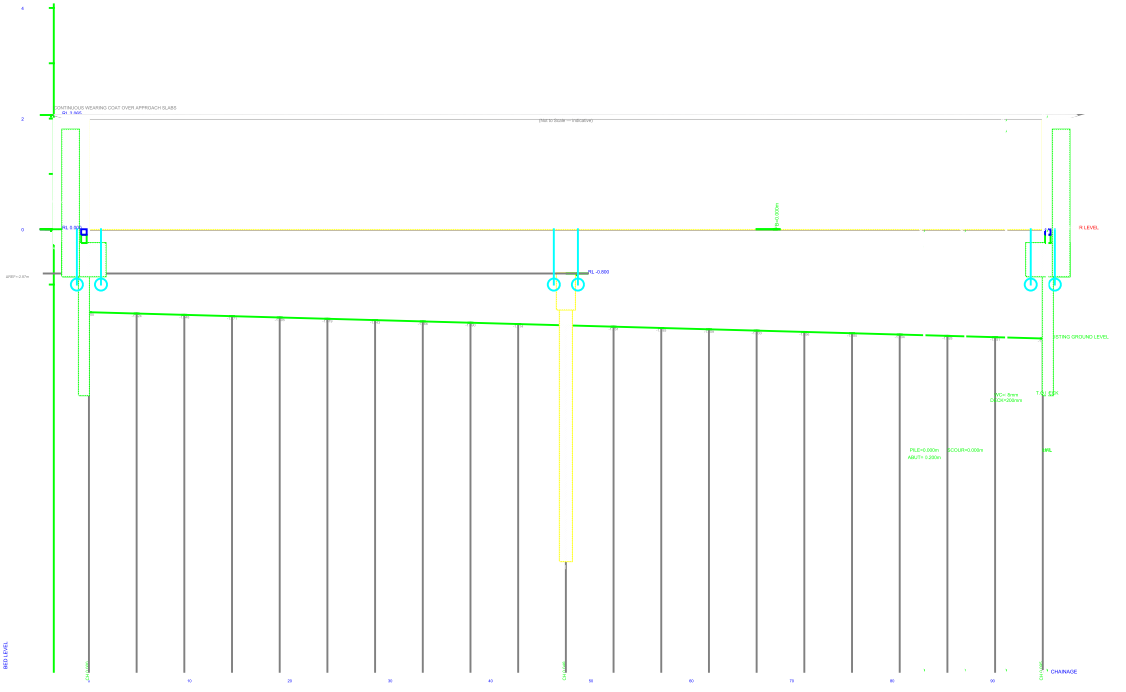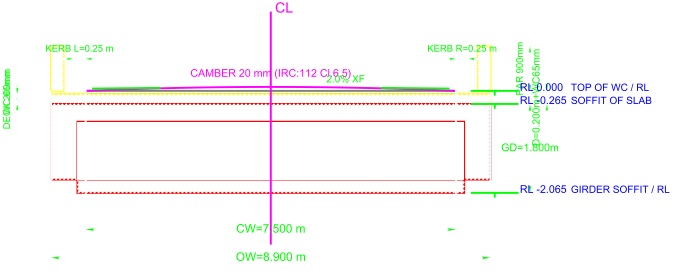



DESIGN SCOUR RL 0.000














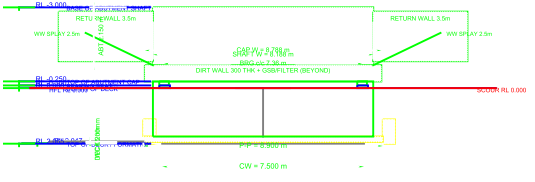
| | | | | |
|---|---|---|---|---|
| QA-ABT-CAP-001 | Abutment cap depth | 0 mm | >= 450 mm | OK |
| QA-ABT-CAP-002 | Cap projection front/rear | 0/0 mm | 100-250 / 200-800 mm | OK |
| QA-DWL-THK | Dirt wall thickness | 0 mm | >= 250 mm | OK |
| QA-DWL-TOP | Dirt wall to slab soffit | 1.45 m | >= 1.50 m | OK |
| QA-DWL-WEEP | Weep holes provided | 4 | 1 per 3 m | OK |
| QA-ABT-OT | Overturning FOS | 1.19 | >= 1.40 | FAIL |
| QA-ABT-SL | Sliding FOS | 1.31 | >= 1.40 | FAIL |
| QA-ABT-BRG | Base pressure | 193.58 kPa | <= 350.00 kPa | OK |





80 mm
450 mm
PIPE Ø570 mm
Ø450 mm
Ø800 mm


GAP 161 mm
+ GAP +
JOINT 160 mm
DEPTH mm

(Not to Scale — indicative)

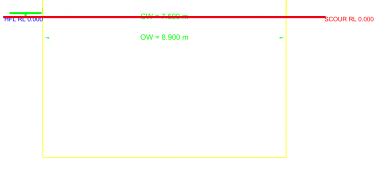


| | | | |
|---|---|---|---|
| QA-ABT-C Kh-DIRT top depth | 0 mm | >= 450 mm | OK |
| QA-ABT-C Kh-PIER section front/rear | 0/0 mm | 100-250 / 250-600 mm | OK |
| QA-DW-TI Dirt wall thickness | 0 mm | >= 250 mm | OK |
| QA-DW-TI Dirt wall to slab soffit | 1.48 m | >= 0.30 m | OK |
| QA-DW-TI Drain holes provided | 4 | 1 per 3 m | OK |
| QA-ABT-C Overturning FOS | 1.19 | >= 1.40 | FAIL |
| QA-ABT-E Sliding FOS | 1.31 | >= 1.40 | FAIL |
| QA-ABT-E Base pressure | 139.50 kPa | <= 350.00 kPa | OK |