


Next: replacing a human adjective with a calibrated dose

$$E = m g L (1 - \cos \theta)$$

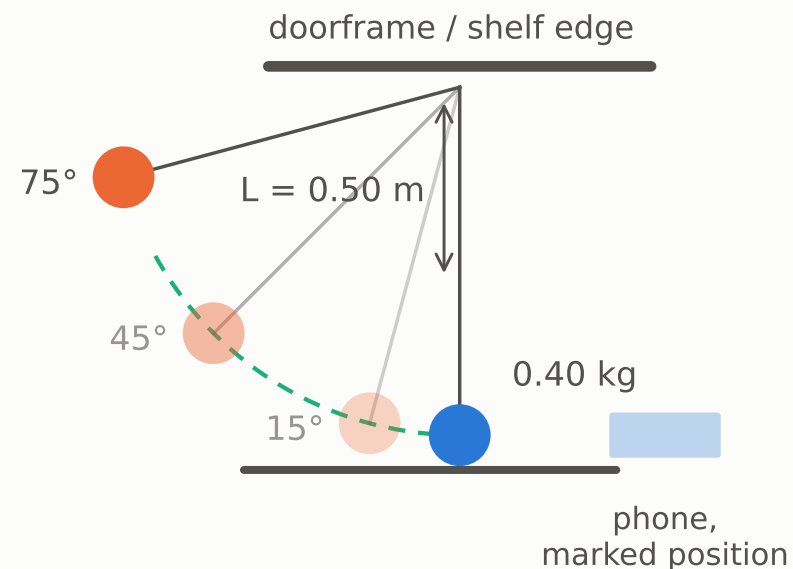

Five levels, six trials each, randomised order

n = 6 because an exact permutation test at n = 2 cannot return a p below 0.167 — the pilot design could not have reached significance on any data.

release angle	impact energy	
15°		0.067 J
30°		0.263 J
45°		0.574 J
60°		0.981 J
75°		1.454 J

22× range, mechanically fixed — replacing “close it hard”, which varied 3.9× between two trials.