

# **System Water Balance Report: "CalLite 2" vs "CalLite 1"**


**Author:**

Generated on 03-May-2013


## System Flow Comparison: "CalLite 2" vs "CalLite 1"

	1922-2003				1929-1934				1987-1992			
	"CalLite 2"	"CalLite 1"	Diff	% Diff	"CalLite 2"	"CalLite 1"	Diff	% Diff	"CalLite 2"	"CalLite 1"	Diff	% Diff
<b>River Flow</b>												
Trinity R blw Lewiston	509	509	0	0	341	341	0	0	341	341	0	0
Trinity Export	716	716	0	0	482	482	0	0	583	583	0	0
Clear Cr blw Whiskeytown	44	44	0	0	33	33	0	0	38	38	0	0
Sacramento R @ Keswick	6510	6510	0	0	4146	4146	0	0	4682	4682	0	0
Sacramento R @ Wilkins Slough	6765	6765	0	0	4050	4050	0	0	4799	4799	0	0
Feather R blw Thermalito	3163	3163	0	0	1627	1627	0	0	1621	1621	0	0
American R blw Nimbus	2378	2378	0	0	1234	1234	0	0	1073	1073	0	0
<b>Delta Inflow</b>	<b>21692</b>	<b>21692</b>	<b>0</b>	<b>0</b>	<b>9885</b>	<b>9885</b>	<b>0</b>	<b>0</b>	<b>10478</b>	<b>10478</b>	<b>0</b>	<b>0</b>
Sacramento R @ Hood	15675	15675	0	0	8266	8266	0	0	9100	9100	0	0
Yolo Bypass	2346	2346	0	0	100	100	0	0	168	168	0	0
Mokelumne R	666	666	0	0	206	206	0	0	155	155	0	0
San Joaquin R d/s Vernalis	3005	3005	0	0	1314	1314	0	0	1055	1055	0	0
<b>Delta Outflow</b>	<b>10785</b>	<b>10785</b>	<b>0</b>	<b>0</b>	<b>2532</b>	<b>2532</b>	<b>0</b>	<b>0</b>	<b>2630</b>	<b>2630</b>	<b>0</b>	<b>0</b>
Delta Outflow for X2 and NDO	3633	3633	0	0	2029	2029	0	0	2051	2051	0	0
<b>Delta Exports</b>	<b>6295</b>	<b>6295</b>	<b>0</b>	<b>0</b>	<b>4135</b>	<b>4135</b>	<b>0</b>	<b>0</b>	<b>4540</b>	<b>4540</b>	<b>0</b>	<b>0</b>
Banks SWP	3586	3586	0	0	2478	2478	0	0	2512	2512	0	0
Banks CVP	108	108	0	0	20	20	0	0	59	59	0	0
Jones	2601	2601	0	0	1637	1637	0	0	1970	1970	0	0
<b>SWP SOD Deliveries</b>	<b>3638</b>	<b>3638</b>	<b>0</b>	<b>0</b>	<b>2481</b>	<b>2481</b>	<b>0</b>	<b>0</b>	<b>2528</b>	<b>2528</b>	<b>0</b>	<b>0</b>
Table A (Incl. Article 56)	3124	3124	0	0	1785	1785	0	0	2200	2200	0	0
Article 21	365	365	0	0	666	666	0	0	264	264	0	0
Article 56	149	149	0	0	31	31	0	0	64	64	0	0
<b>CVP SOD Deliveries</b>	<b>2754</b>	<b>2754</b>	<b>0</b>	<b>0</b>	<b>1609</b>	<b>1609</b>	<b>0</b>	<b>0</b>	<b>2076</b>	<b>2076</b>	<b>0</b>	<b>0</b>


# Exceedance Trinirty Storage (Sept)

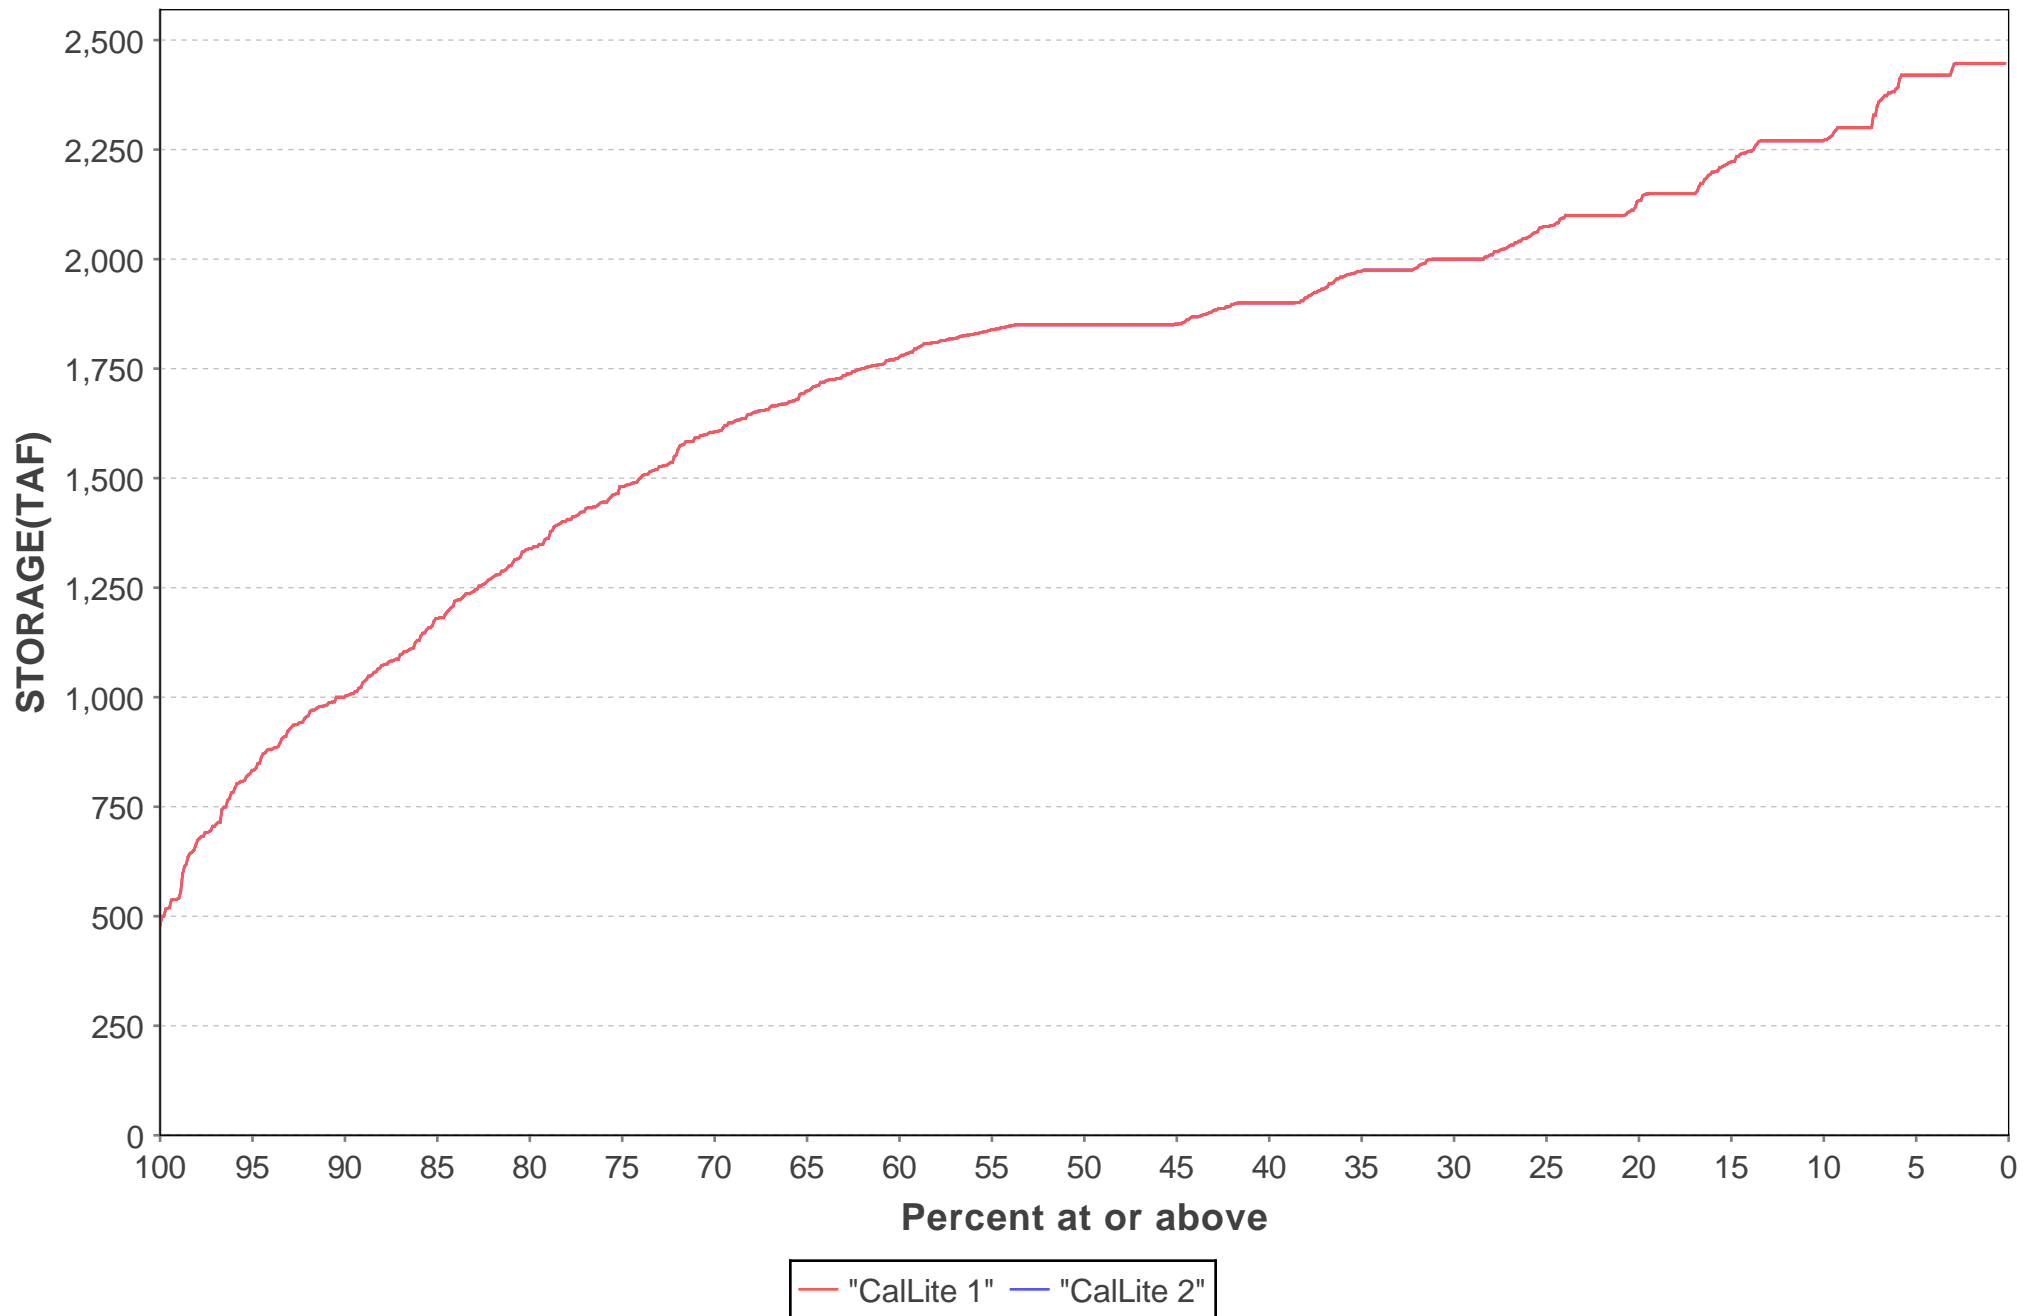


## Exceedance Shasta Storage (Sept)

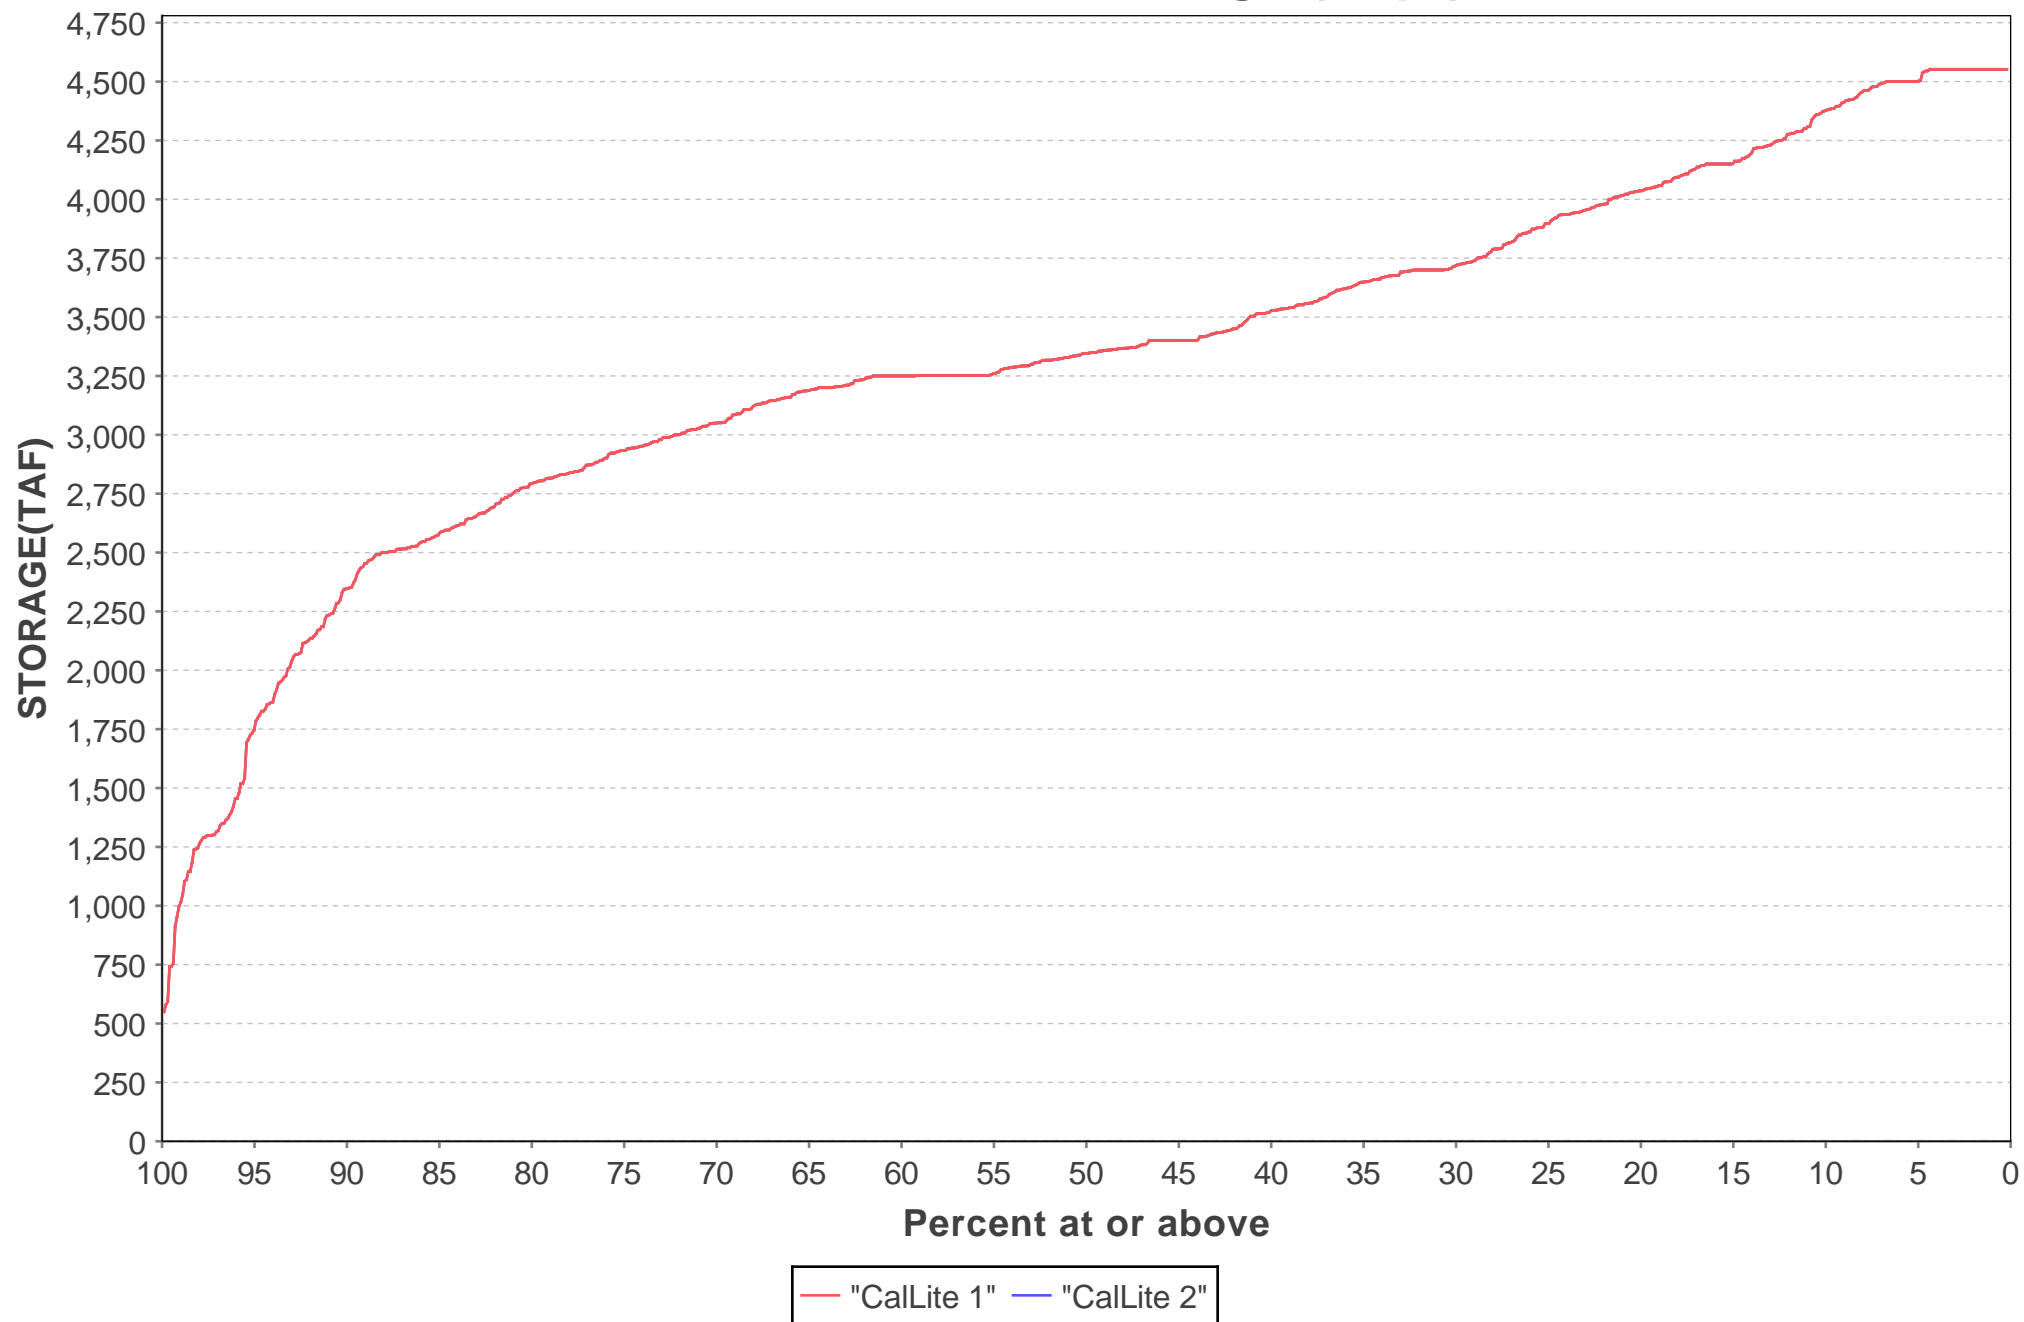


## Exceedance FolSom Storage (Sept)

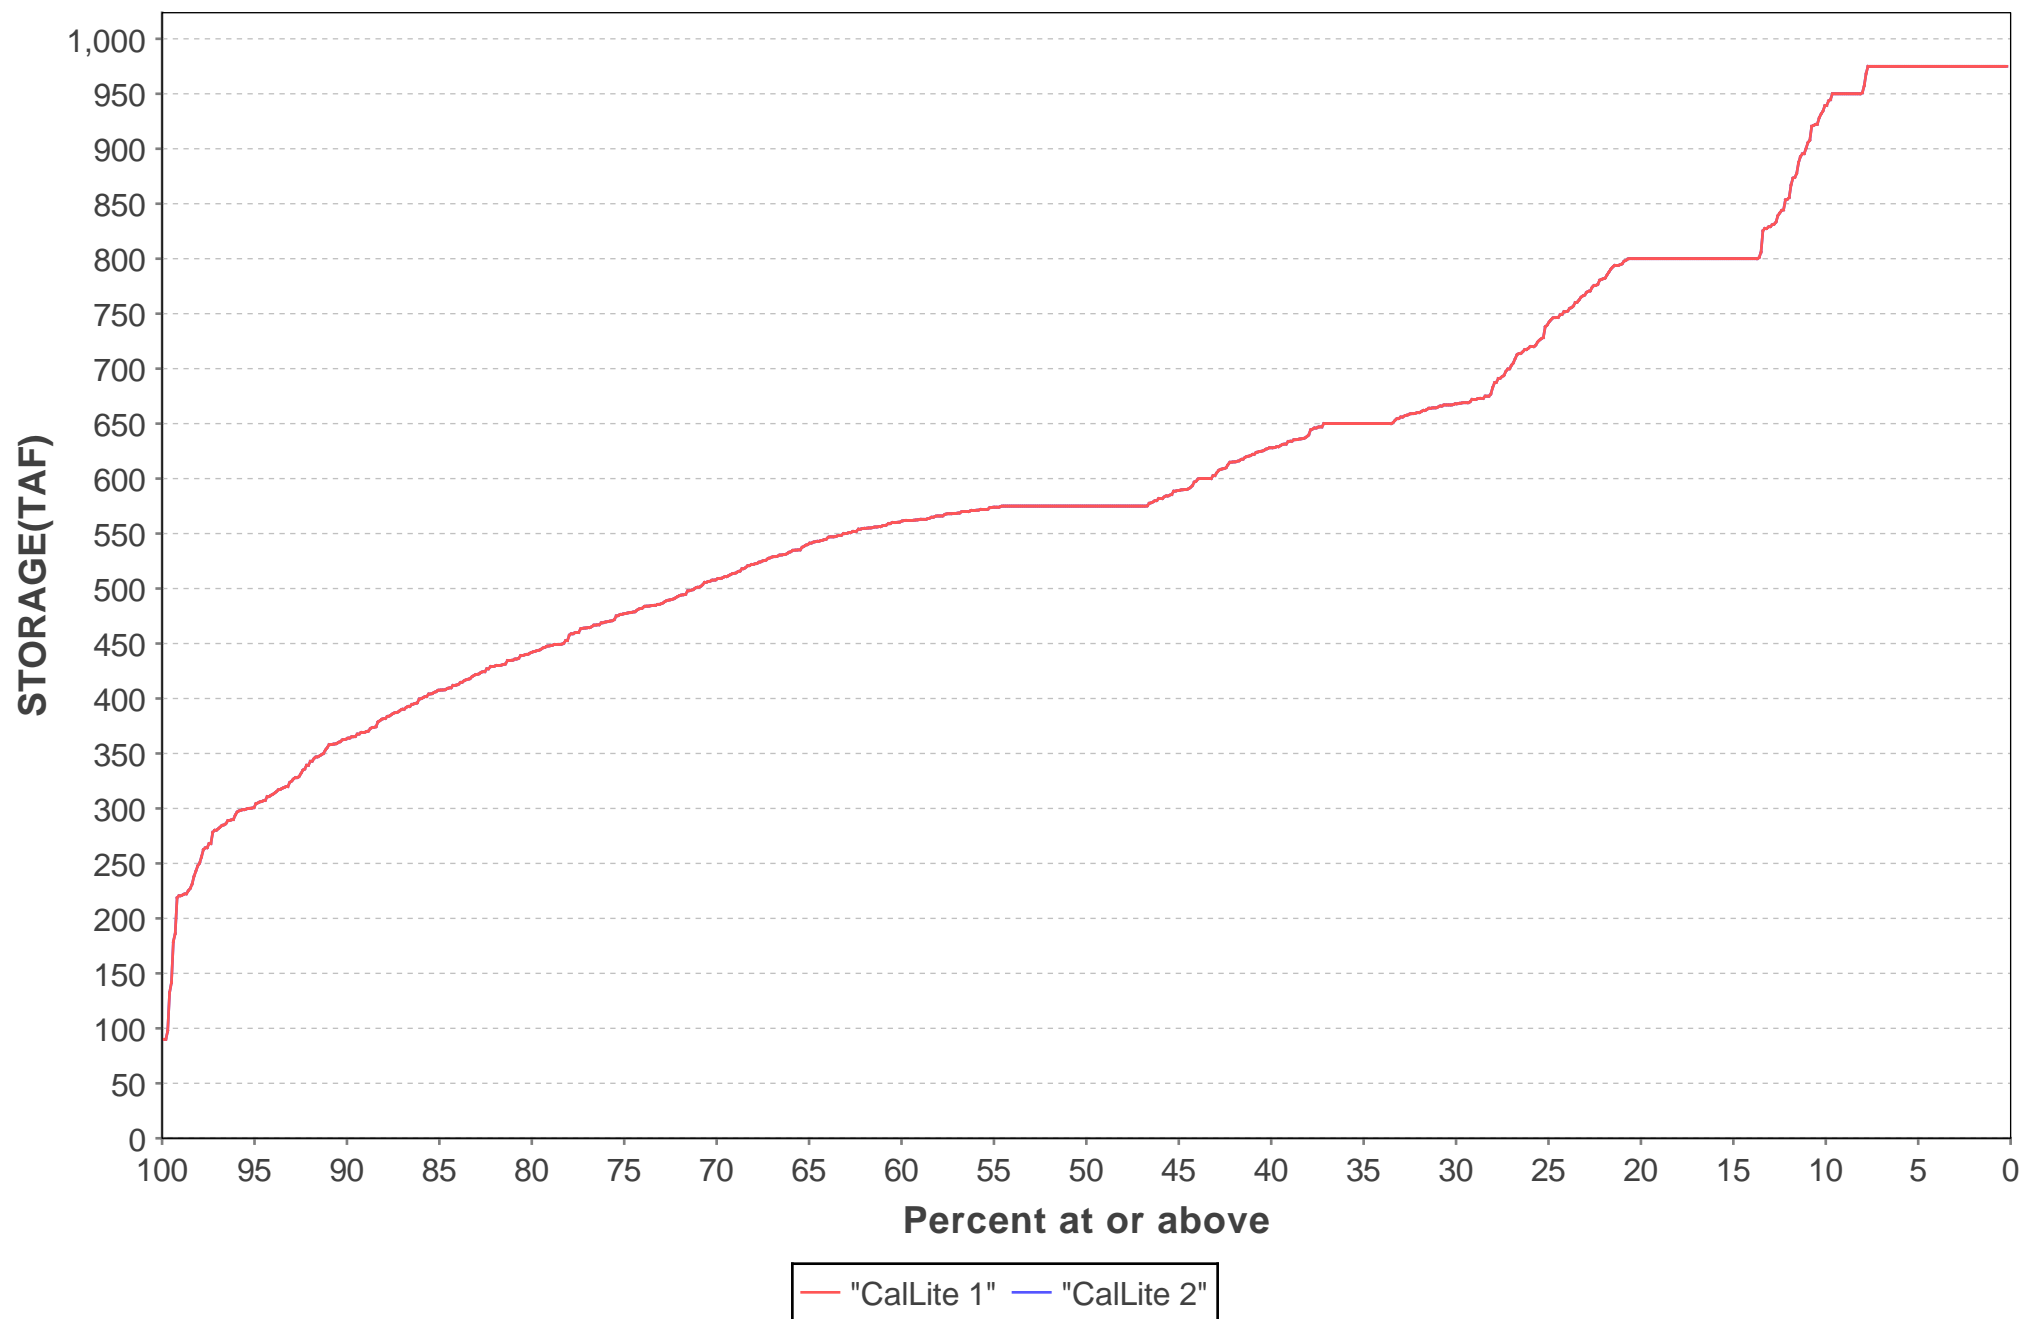


## Exceedance NOD Storage (Sept)

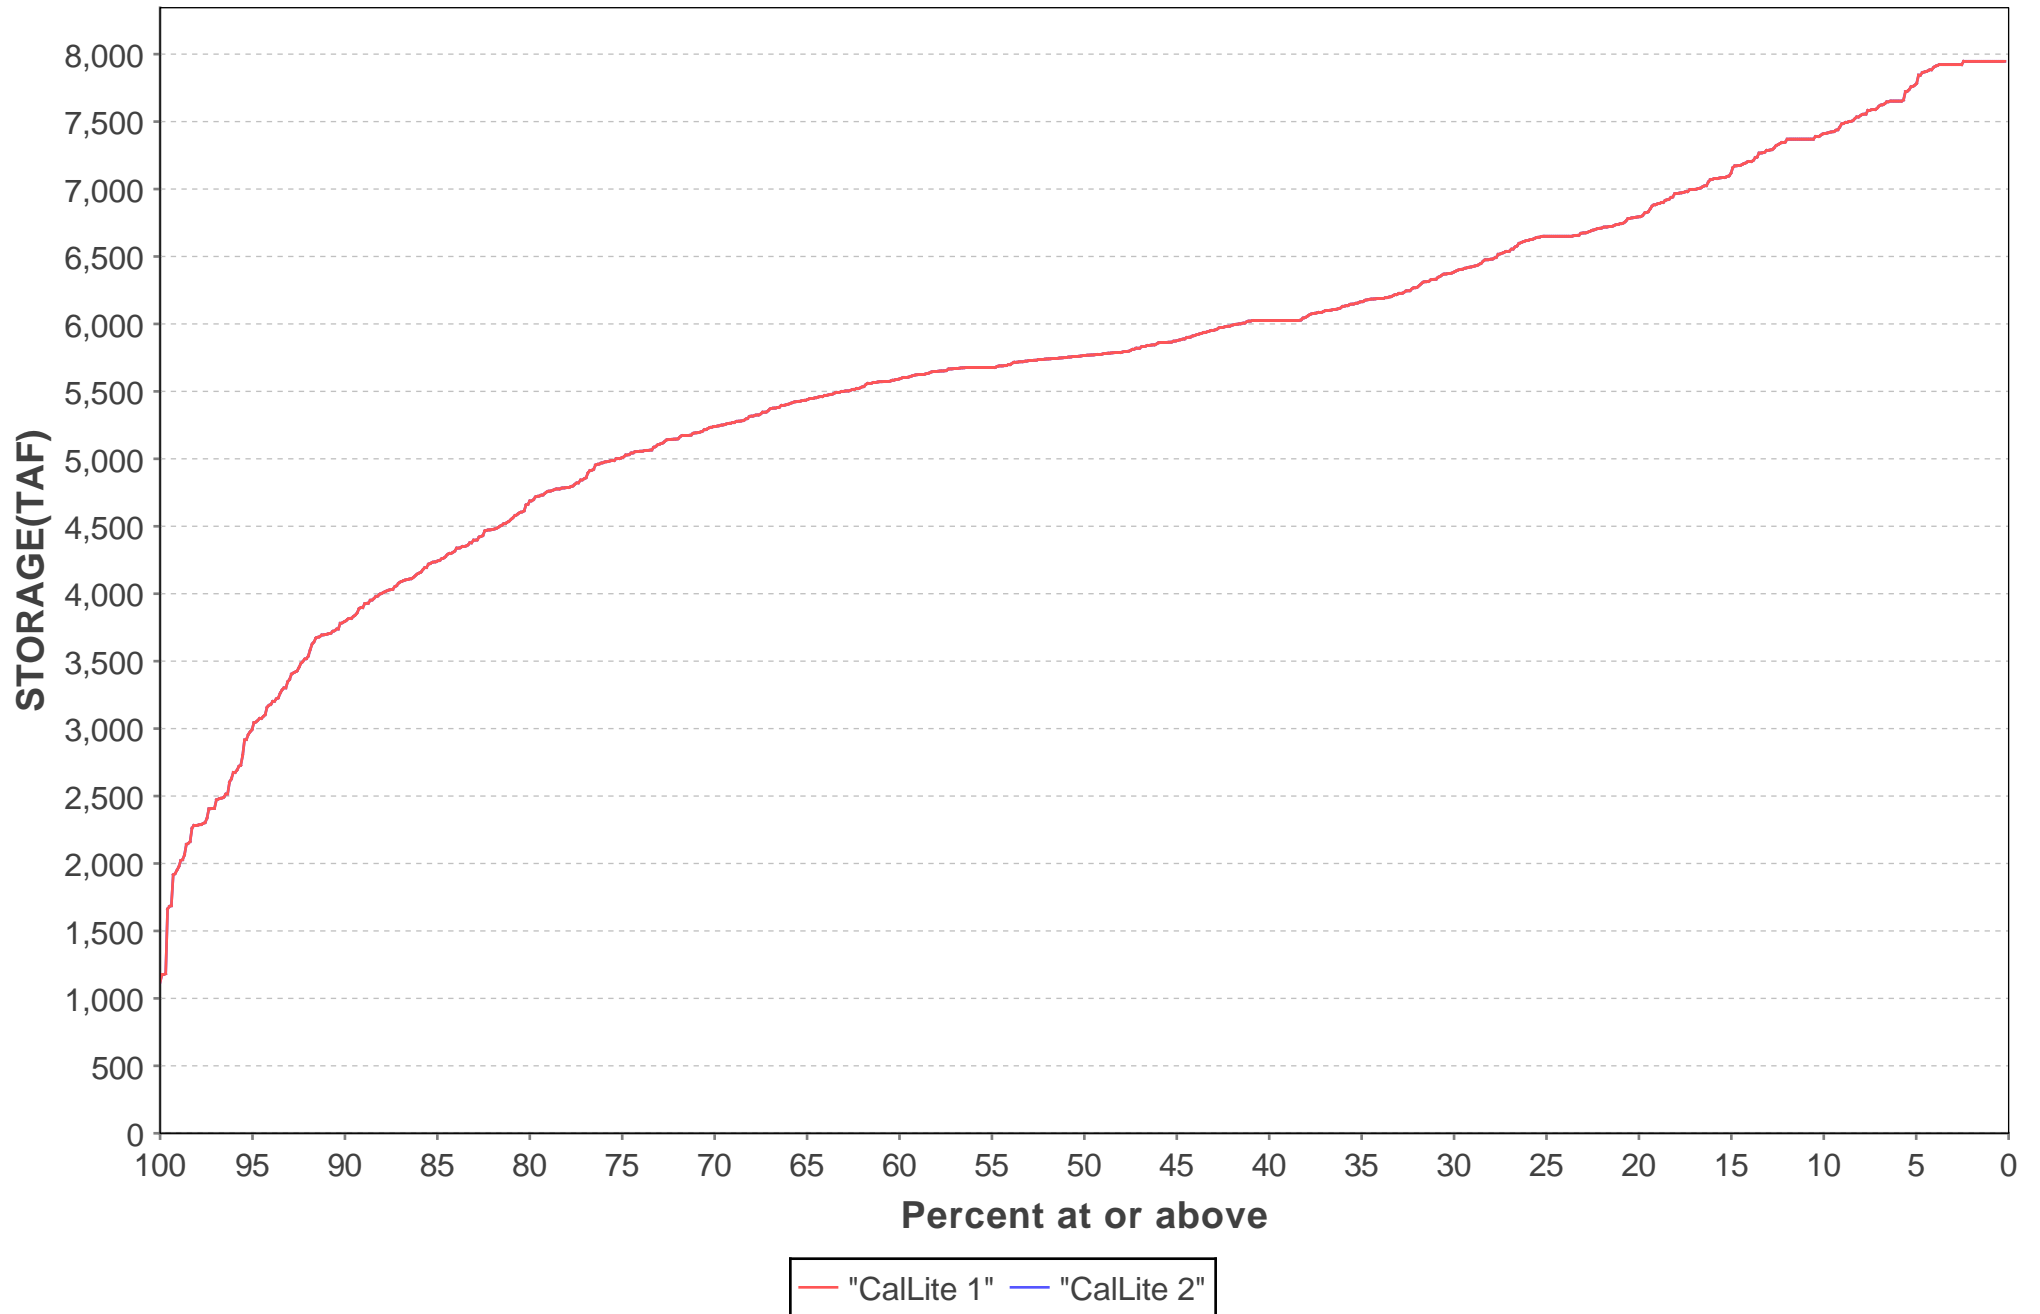

## Exceedance Oroville Storage (Sept)

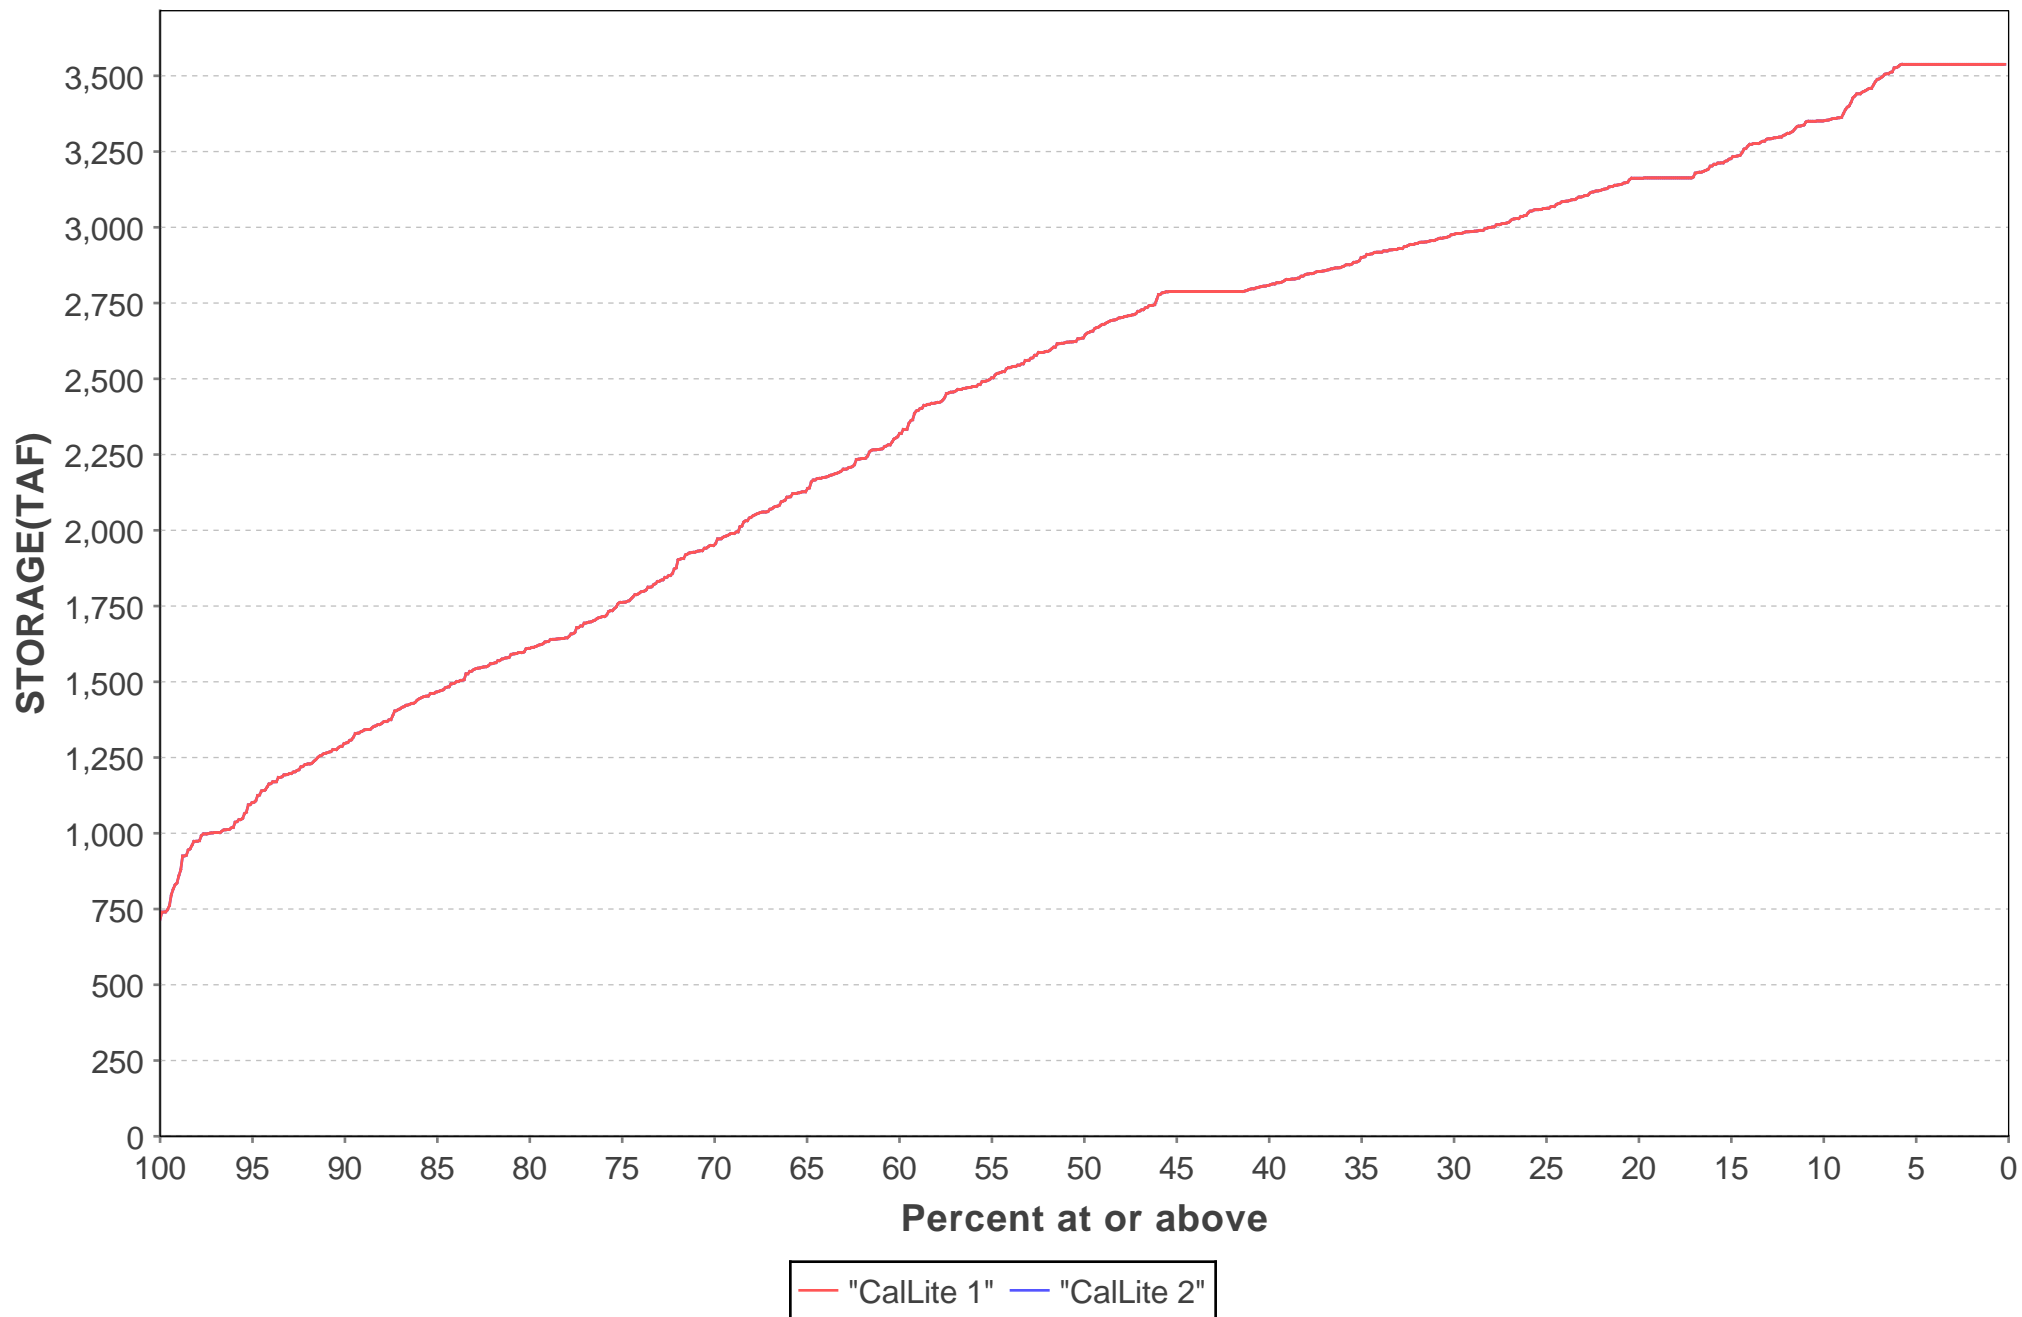


## Exceedance CVP SanLuis Storage (Sept)

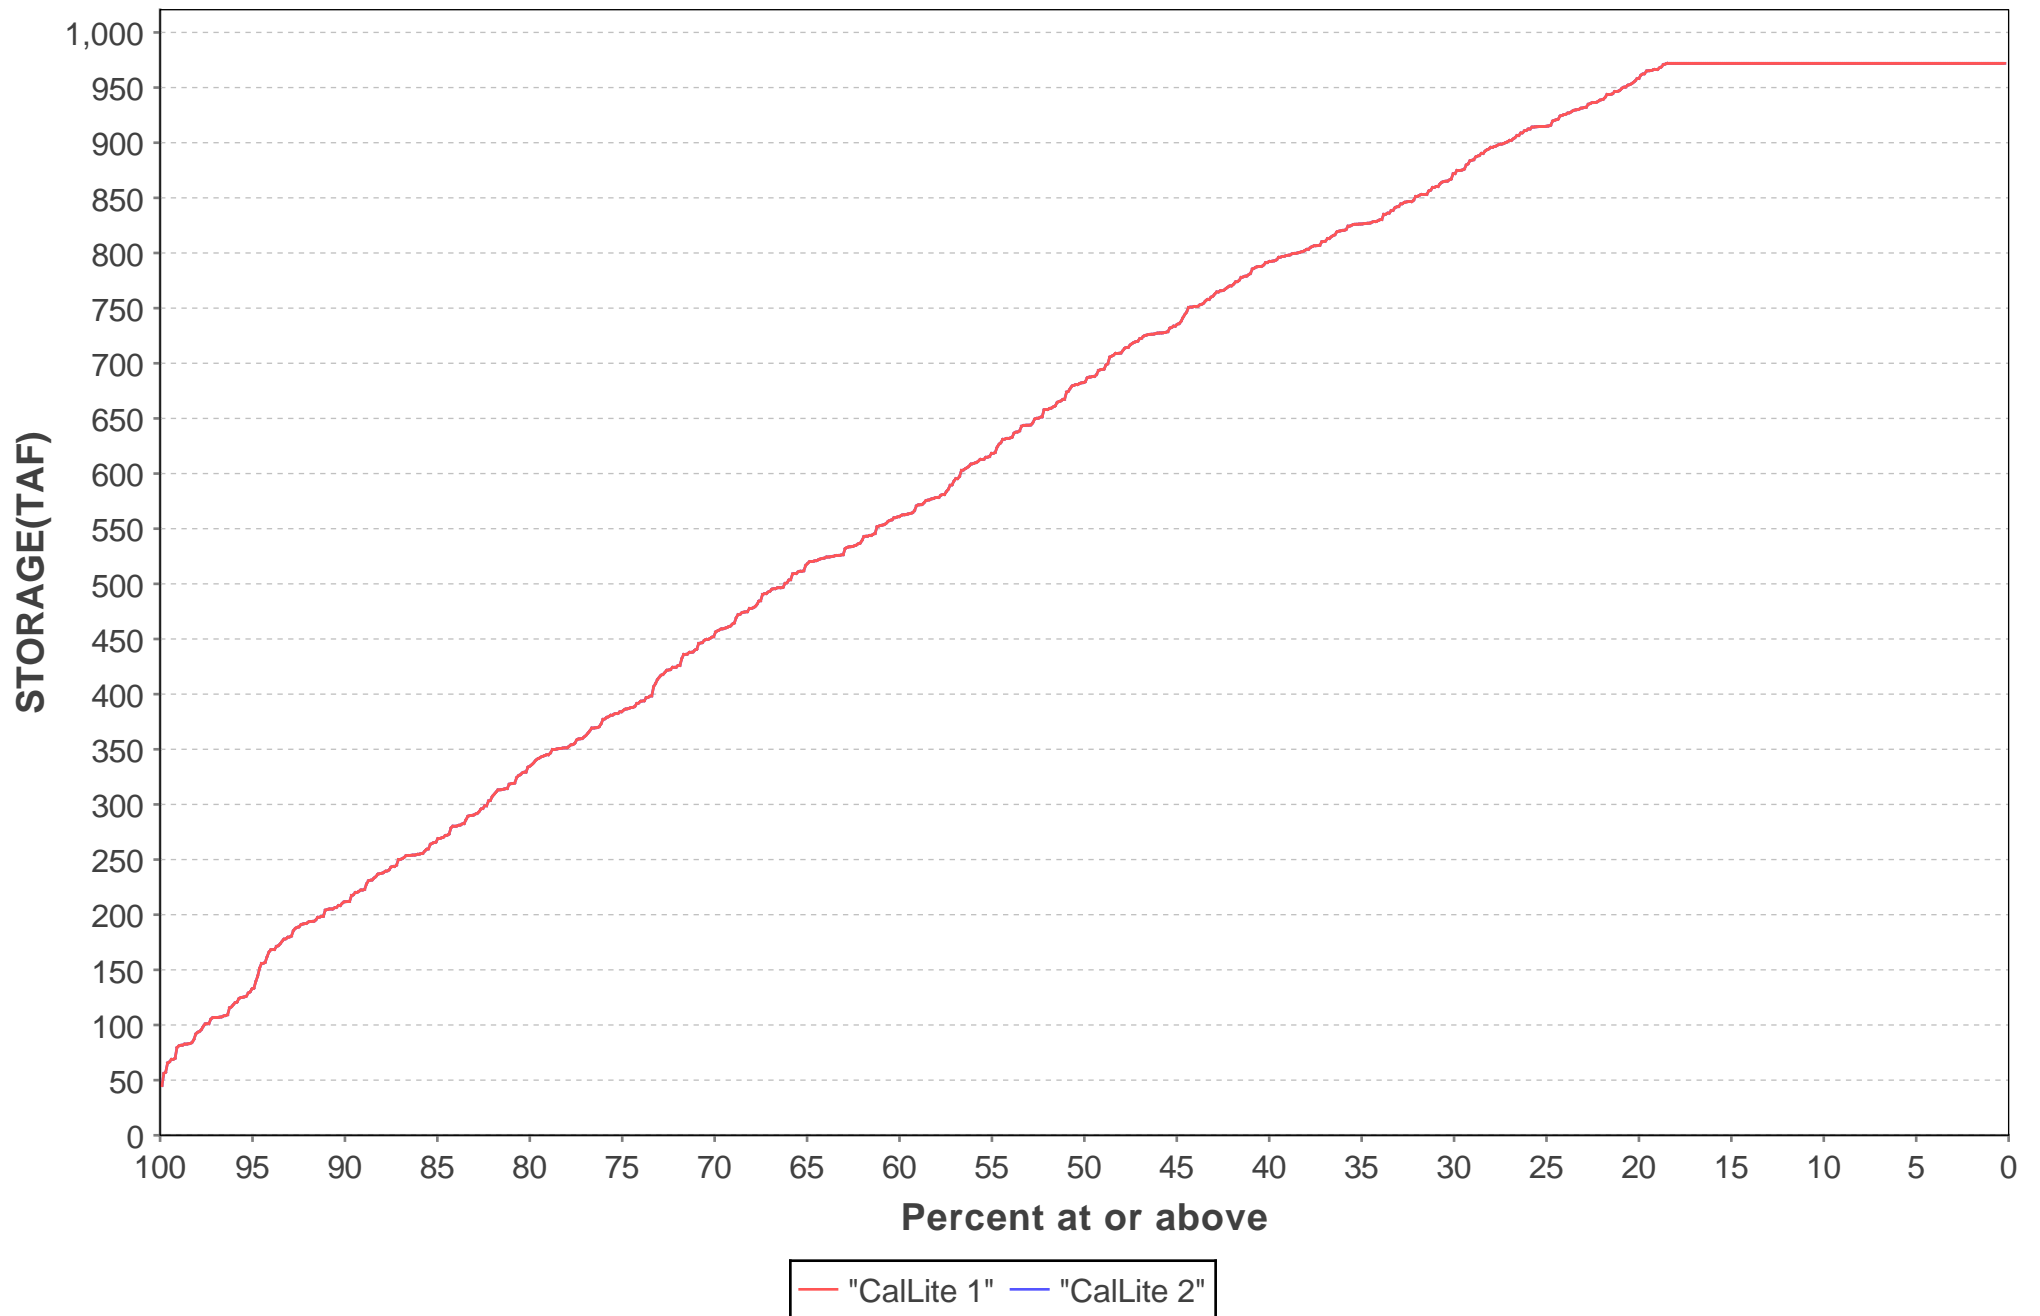





## Exceedance SWP SanLuis Storage (Sept)

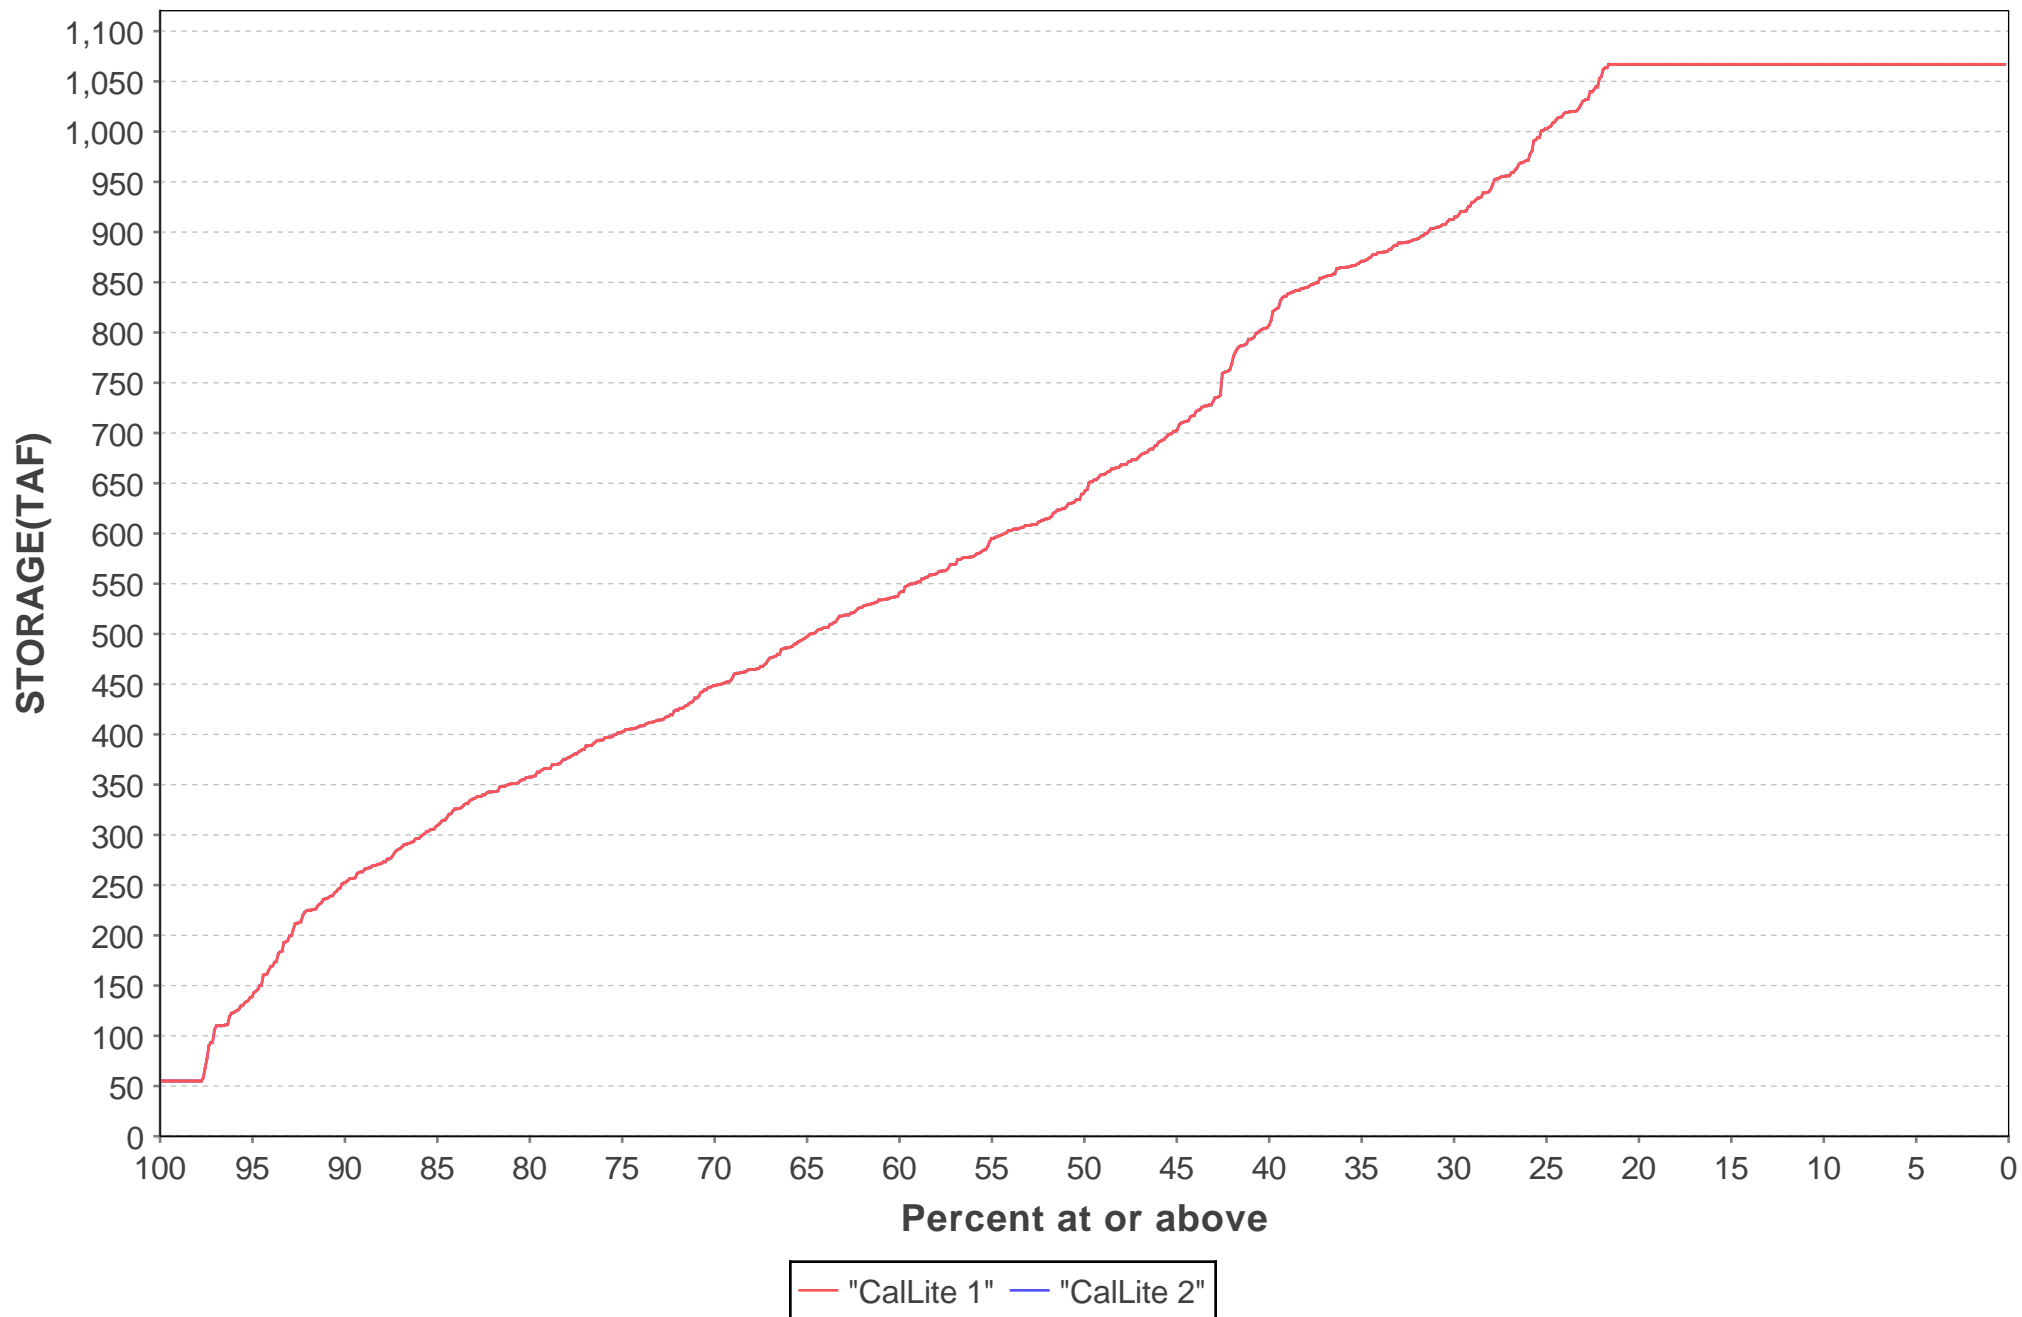


# Average Sacramento R @ Keswick

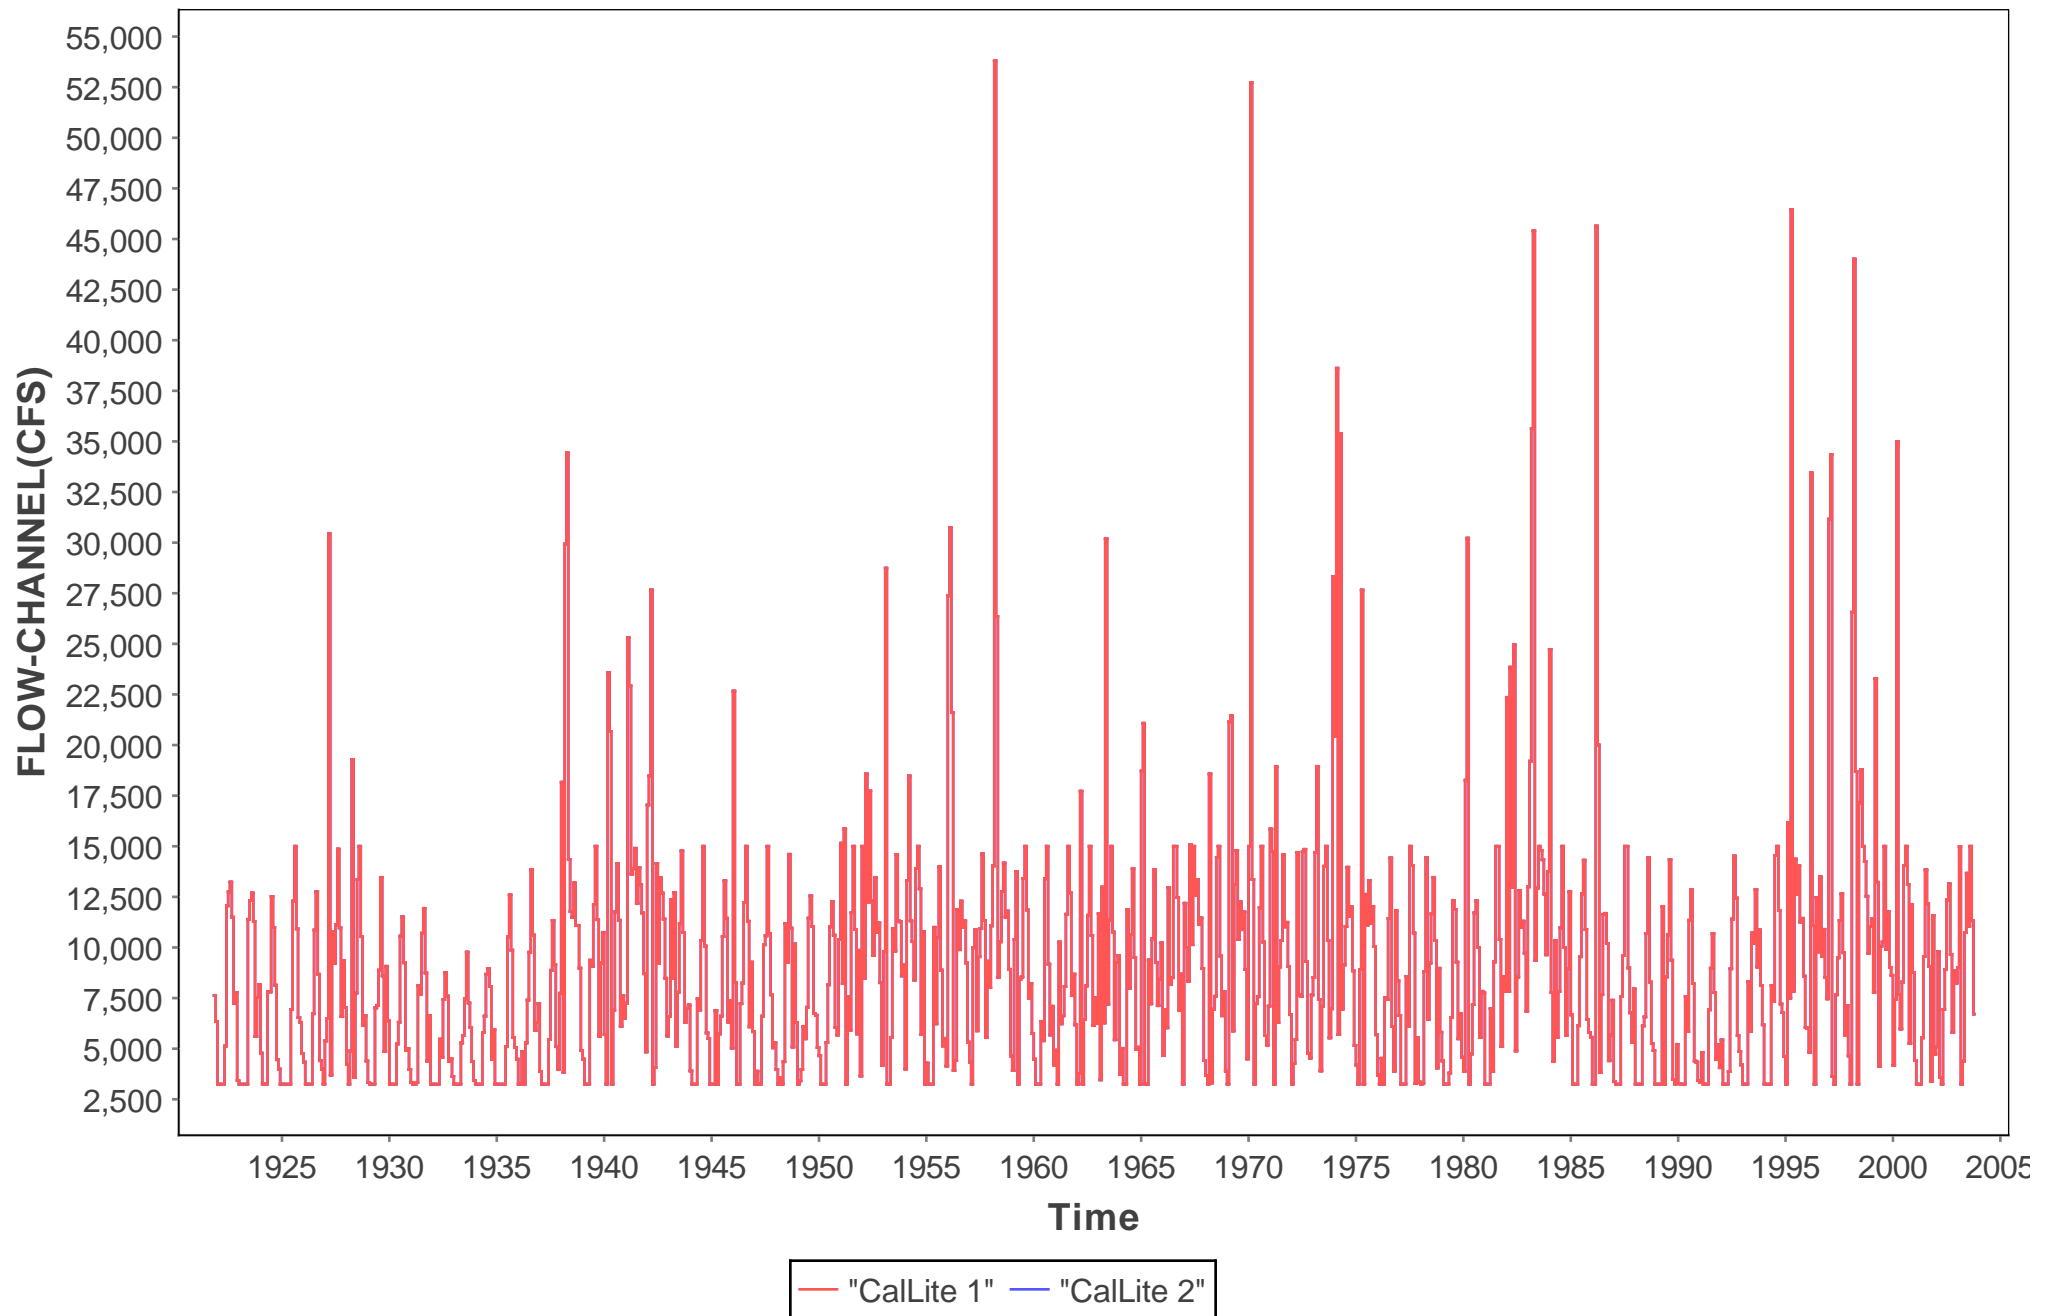


# Average Delta Inflow

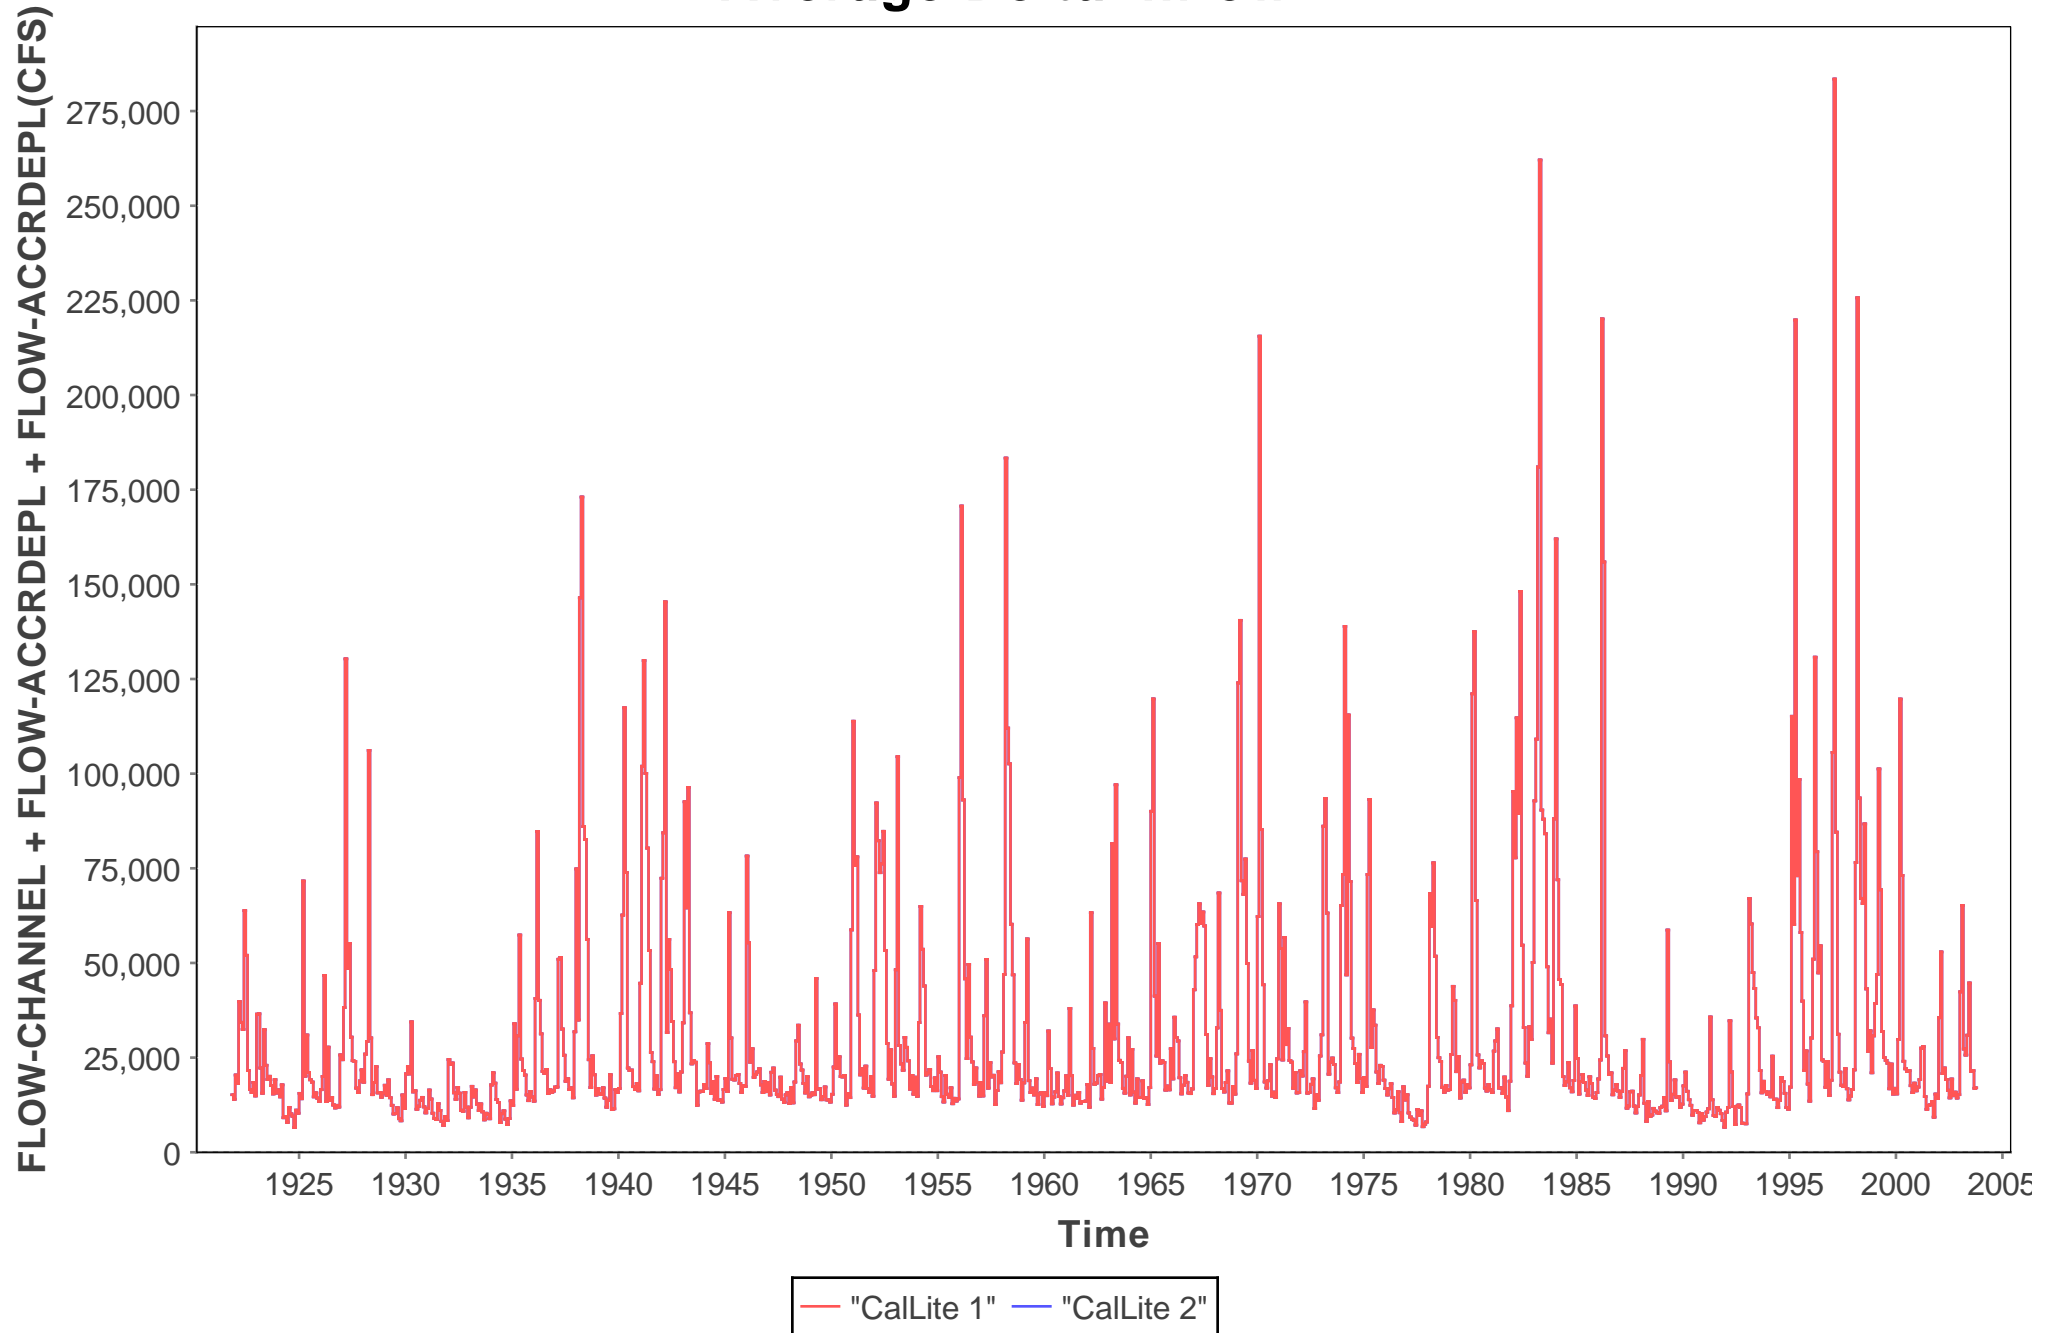

# Average SWP SOD Deliveries

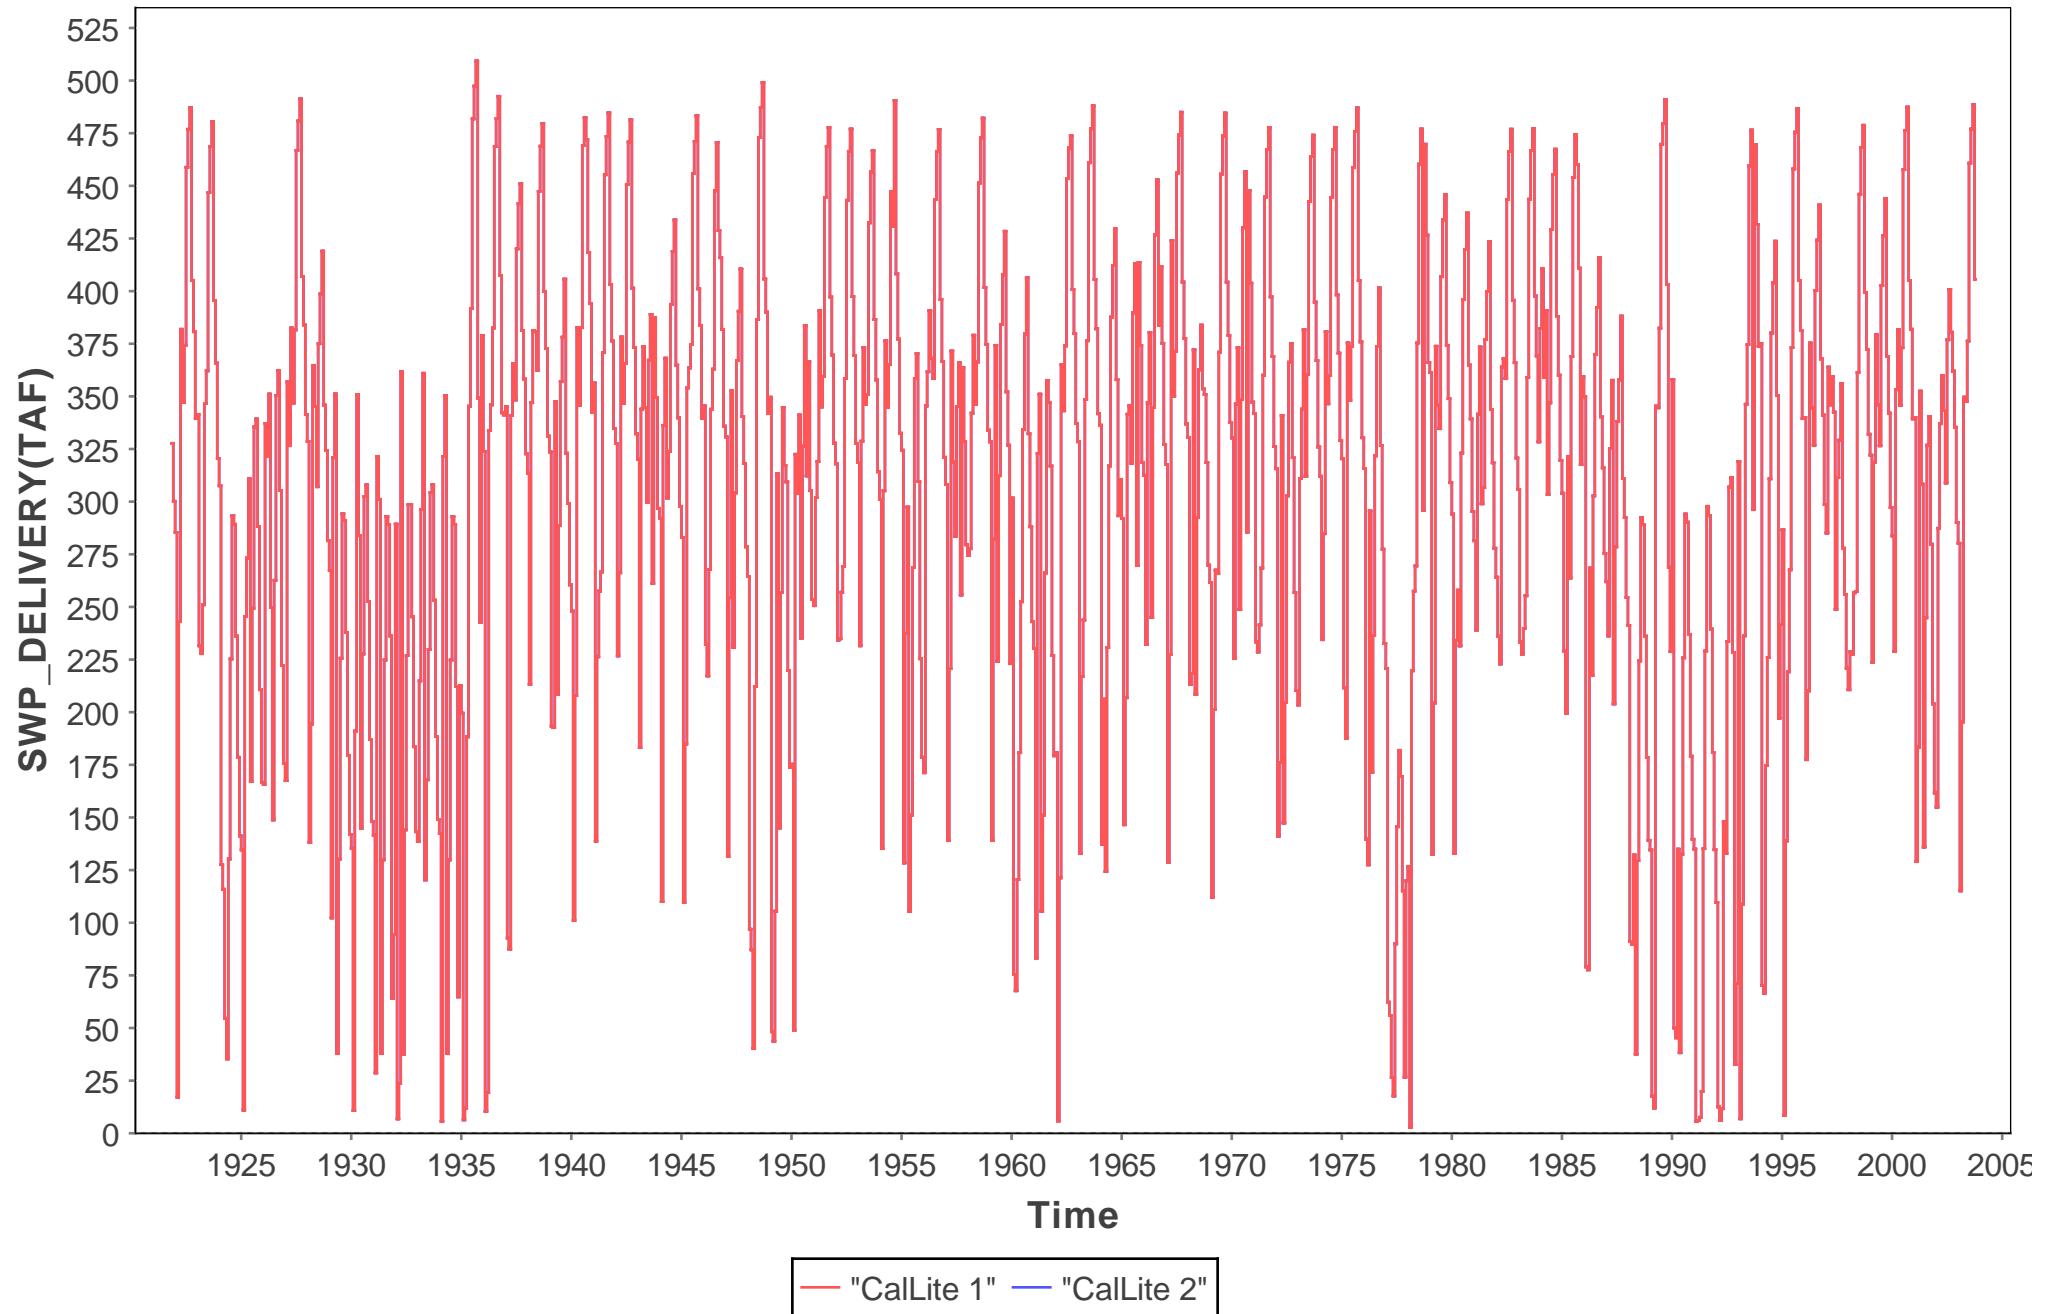


# Exceedance SWP SOD Deliveries

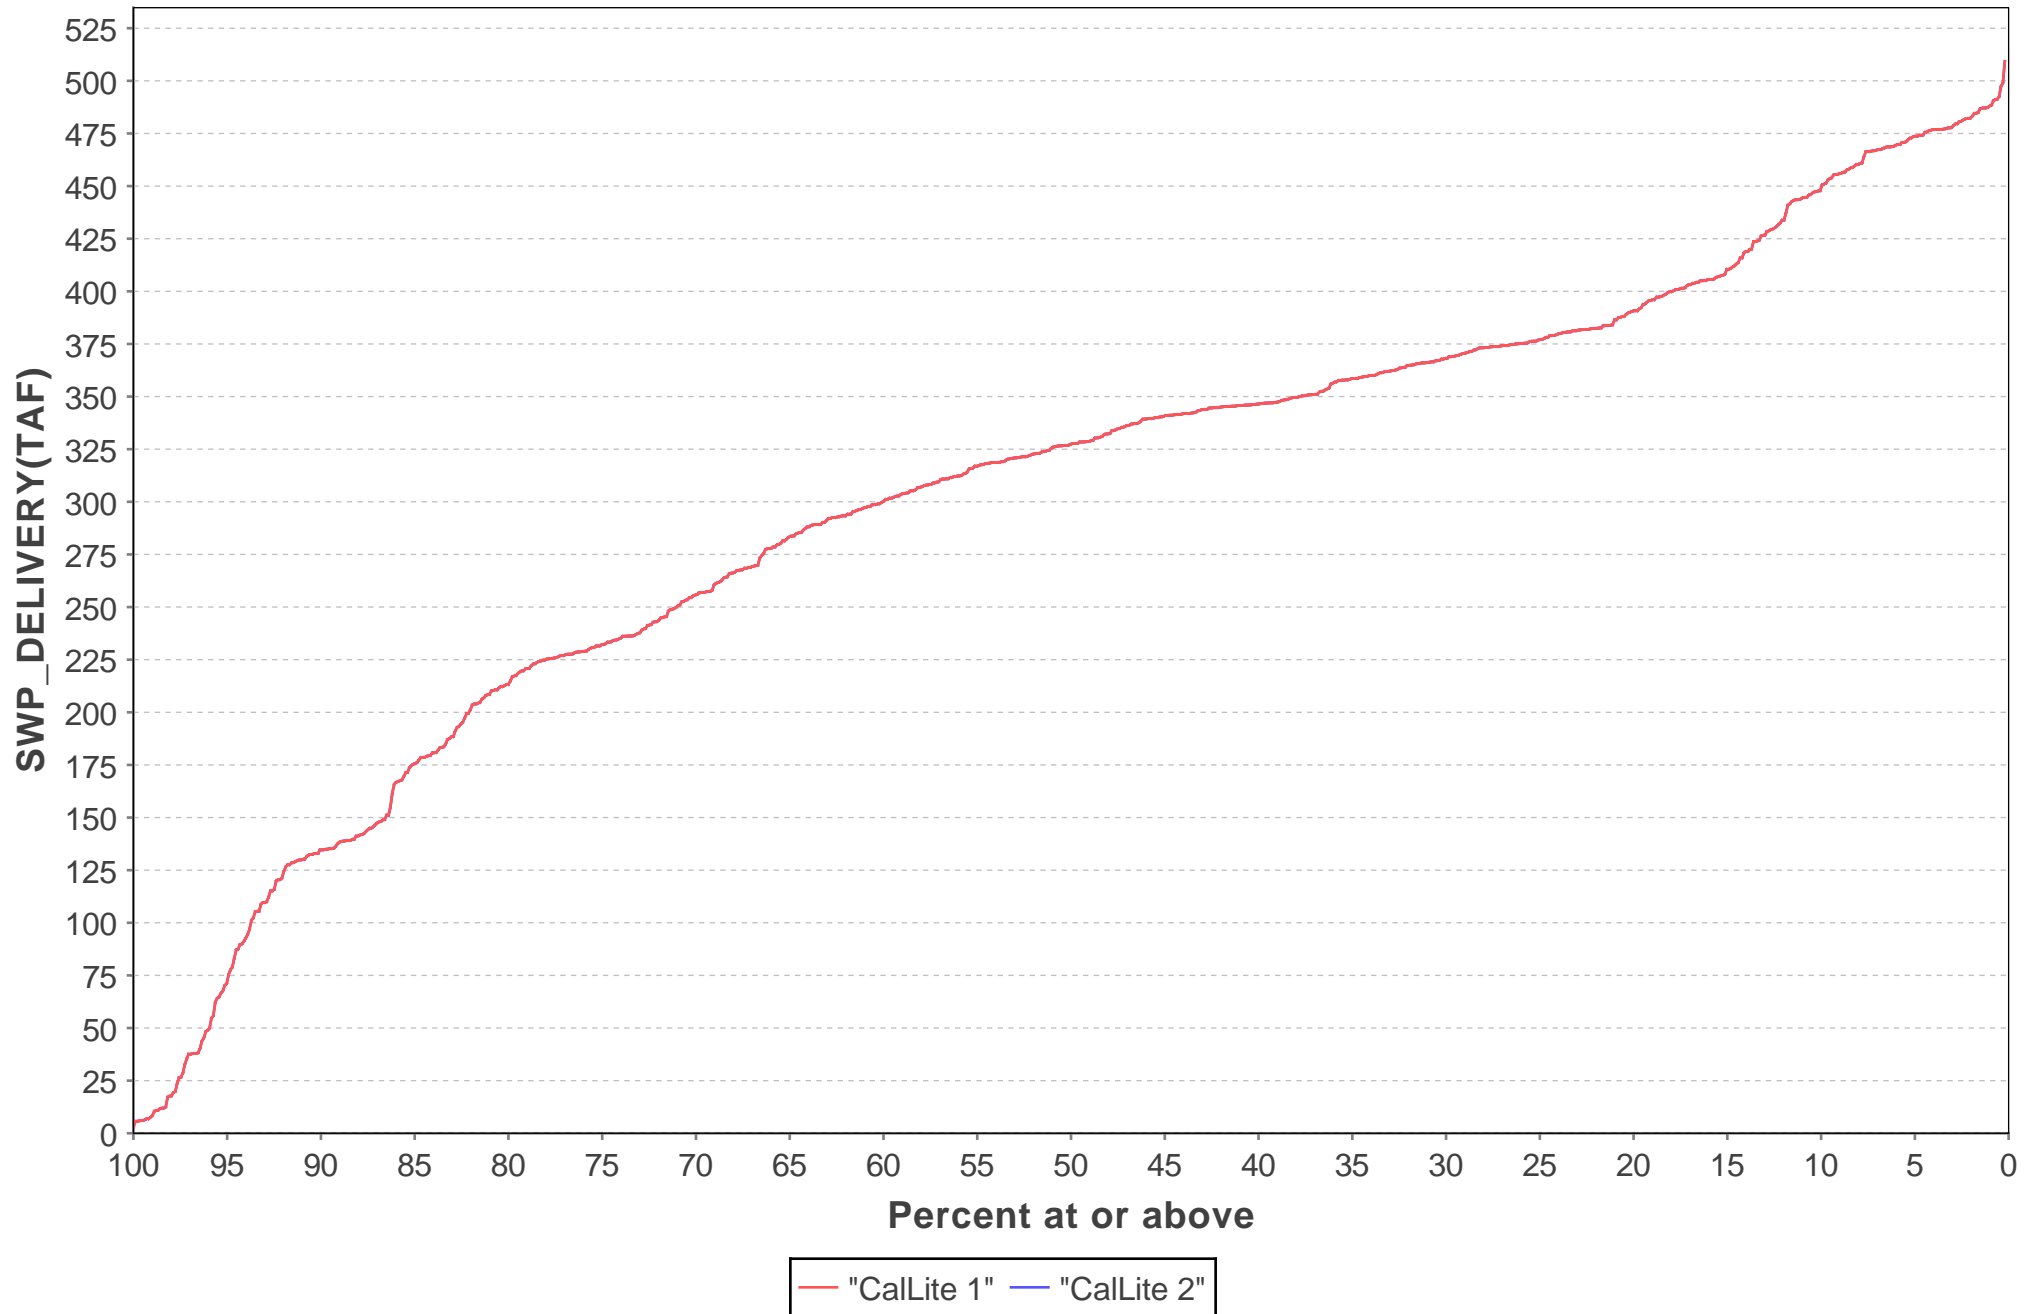


# Average CVP SOD Deliveries



# Exceedance CVP SOD Deliveries

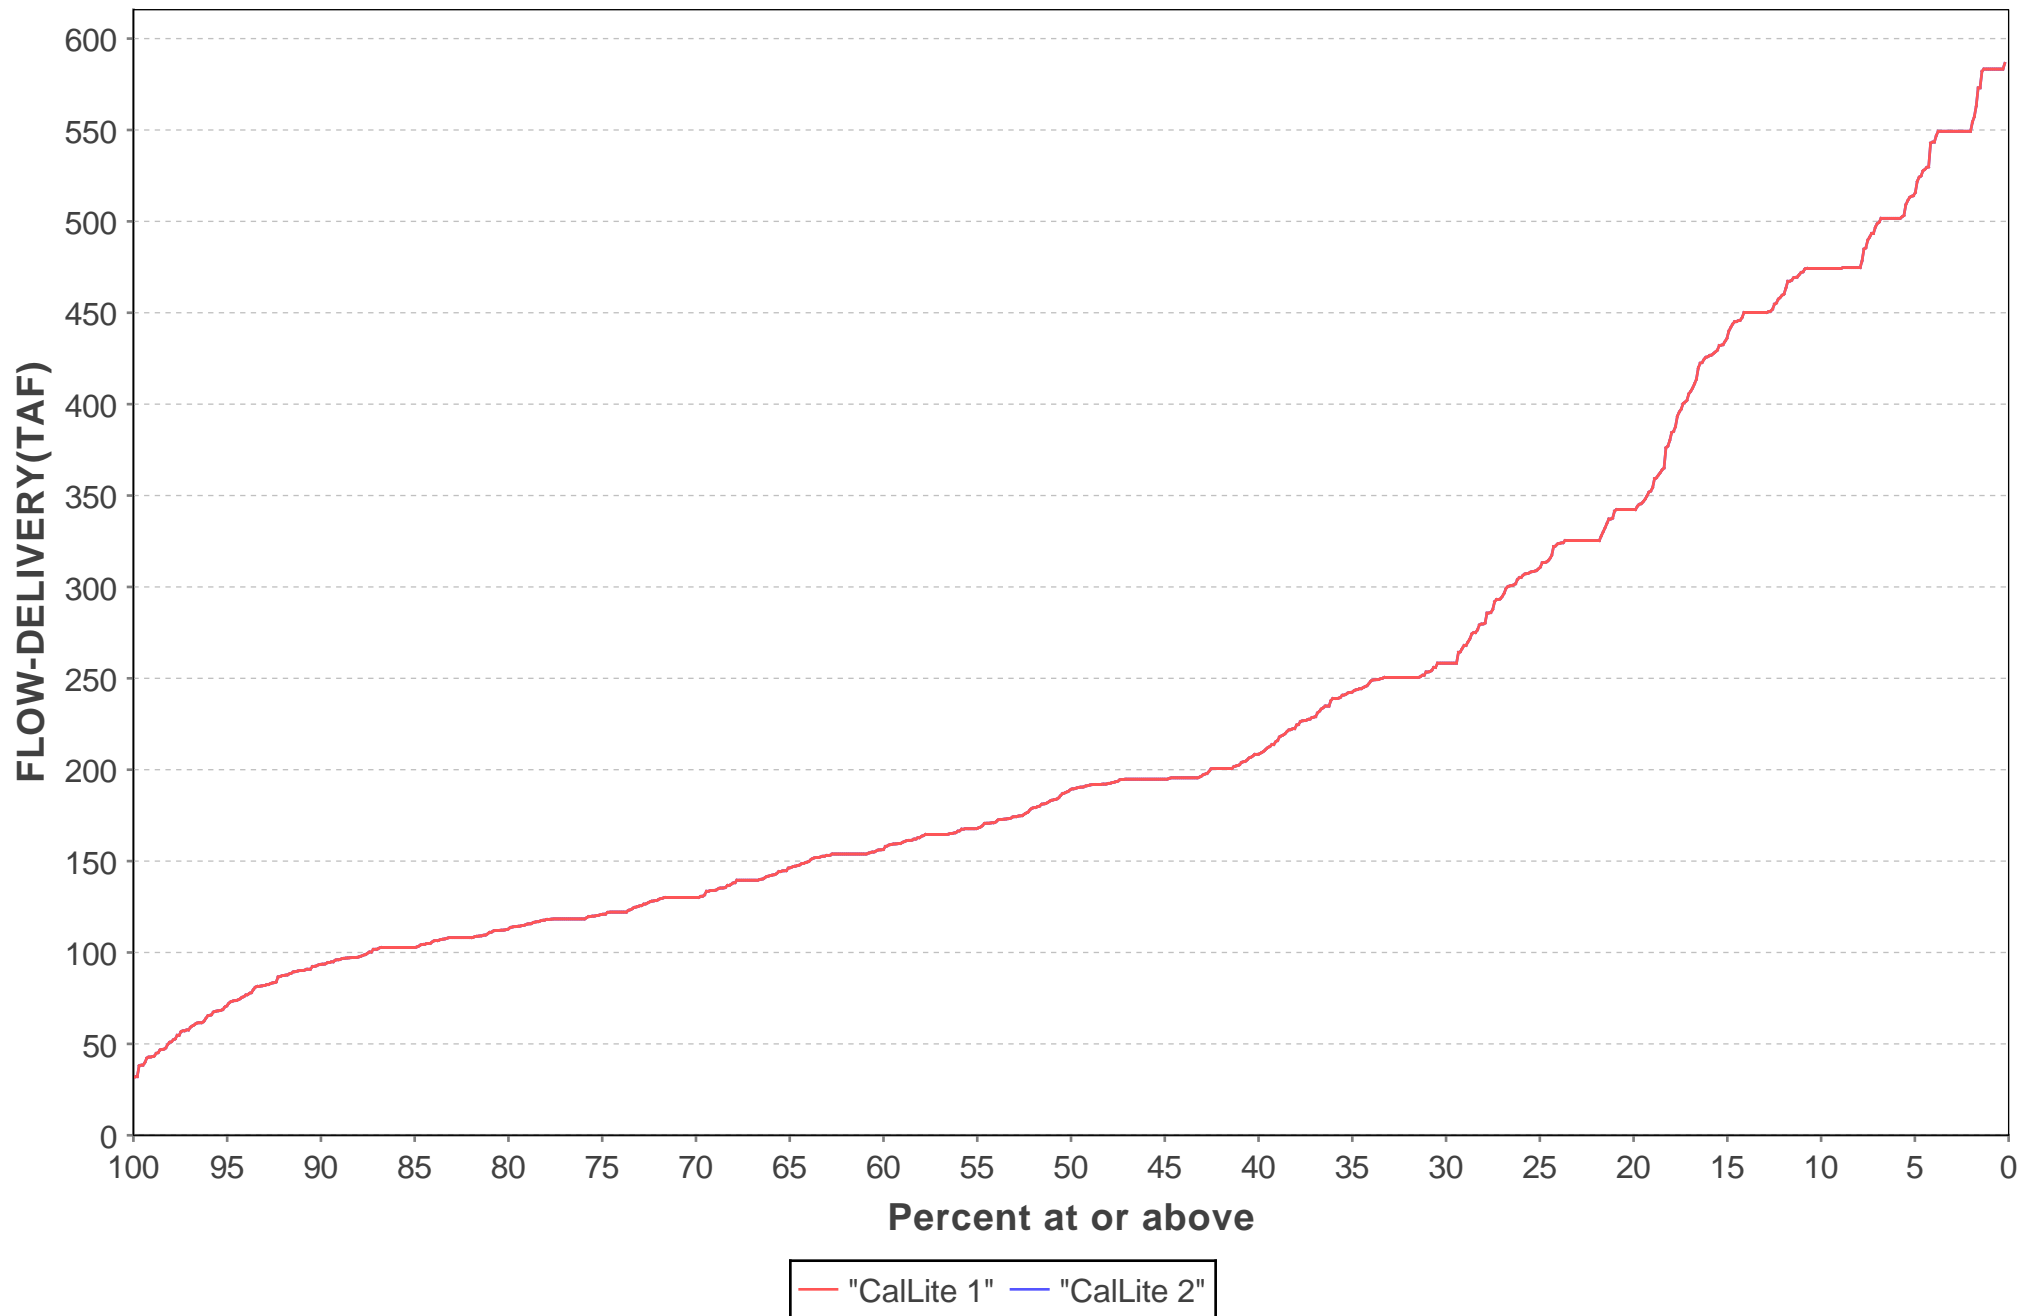


# Exceedance SWP Table A Allocation

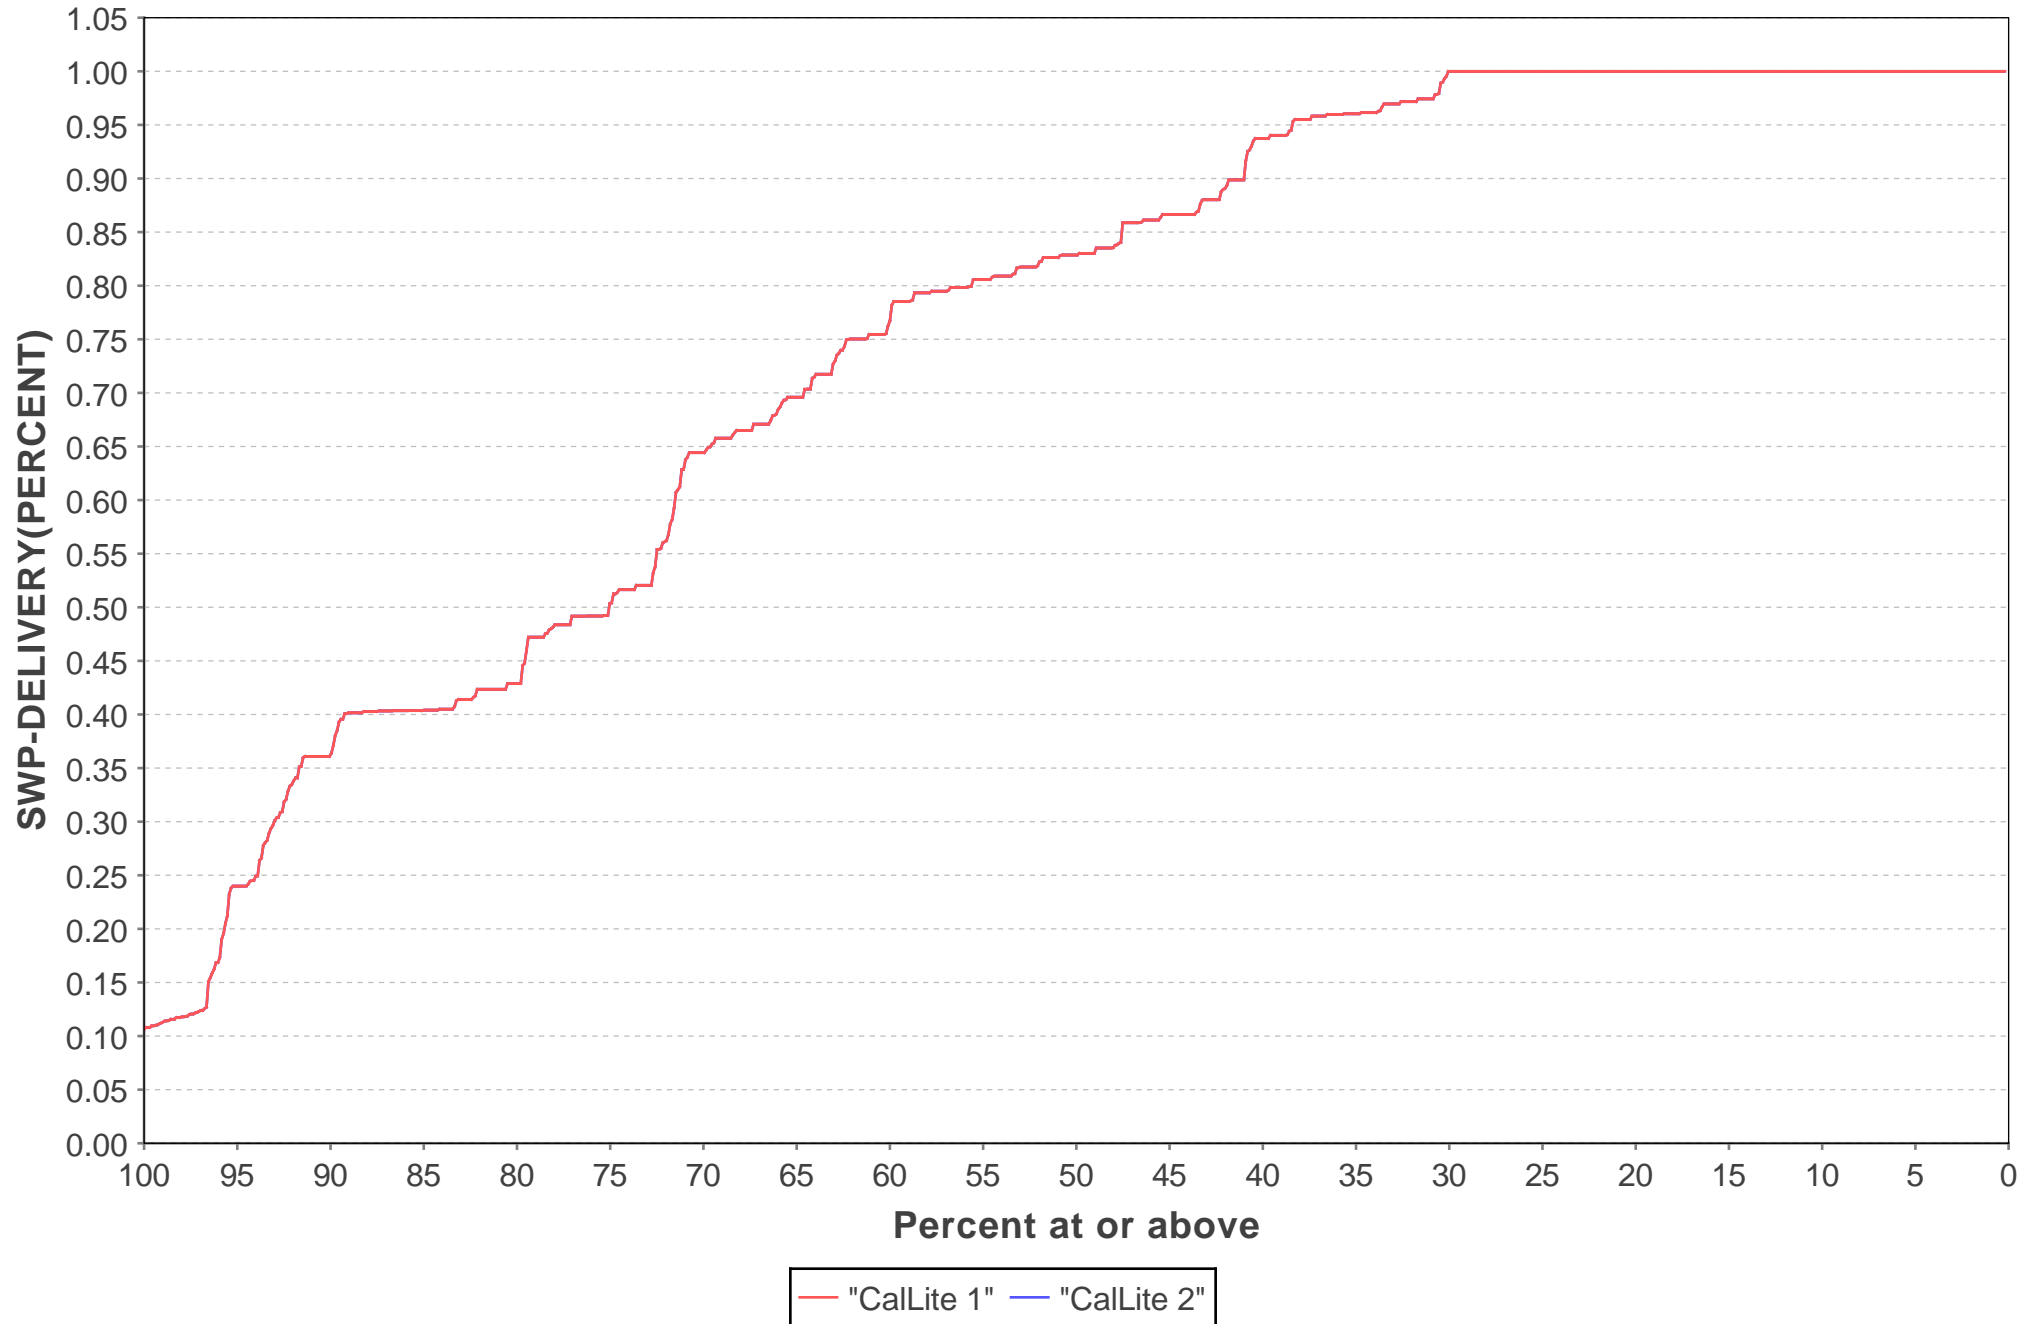




# Exceedance CVP SOD AG Allocation

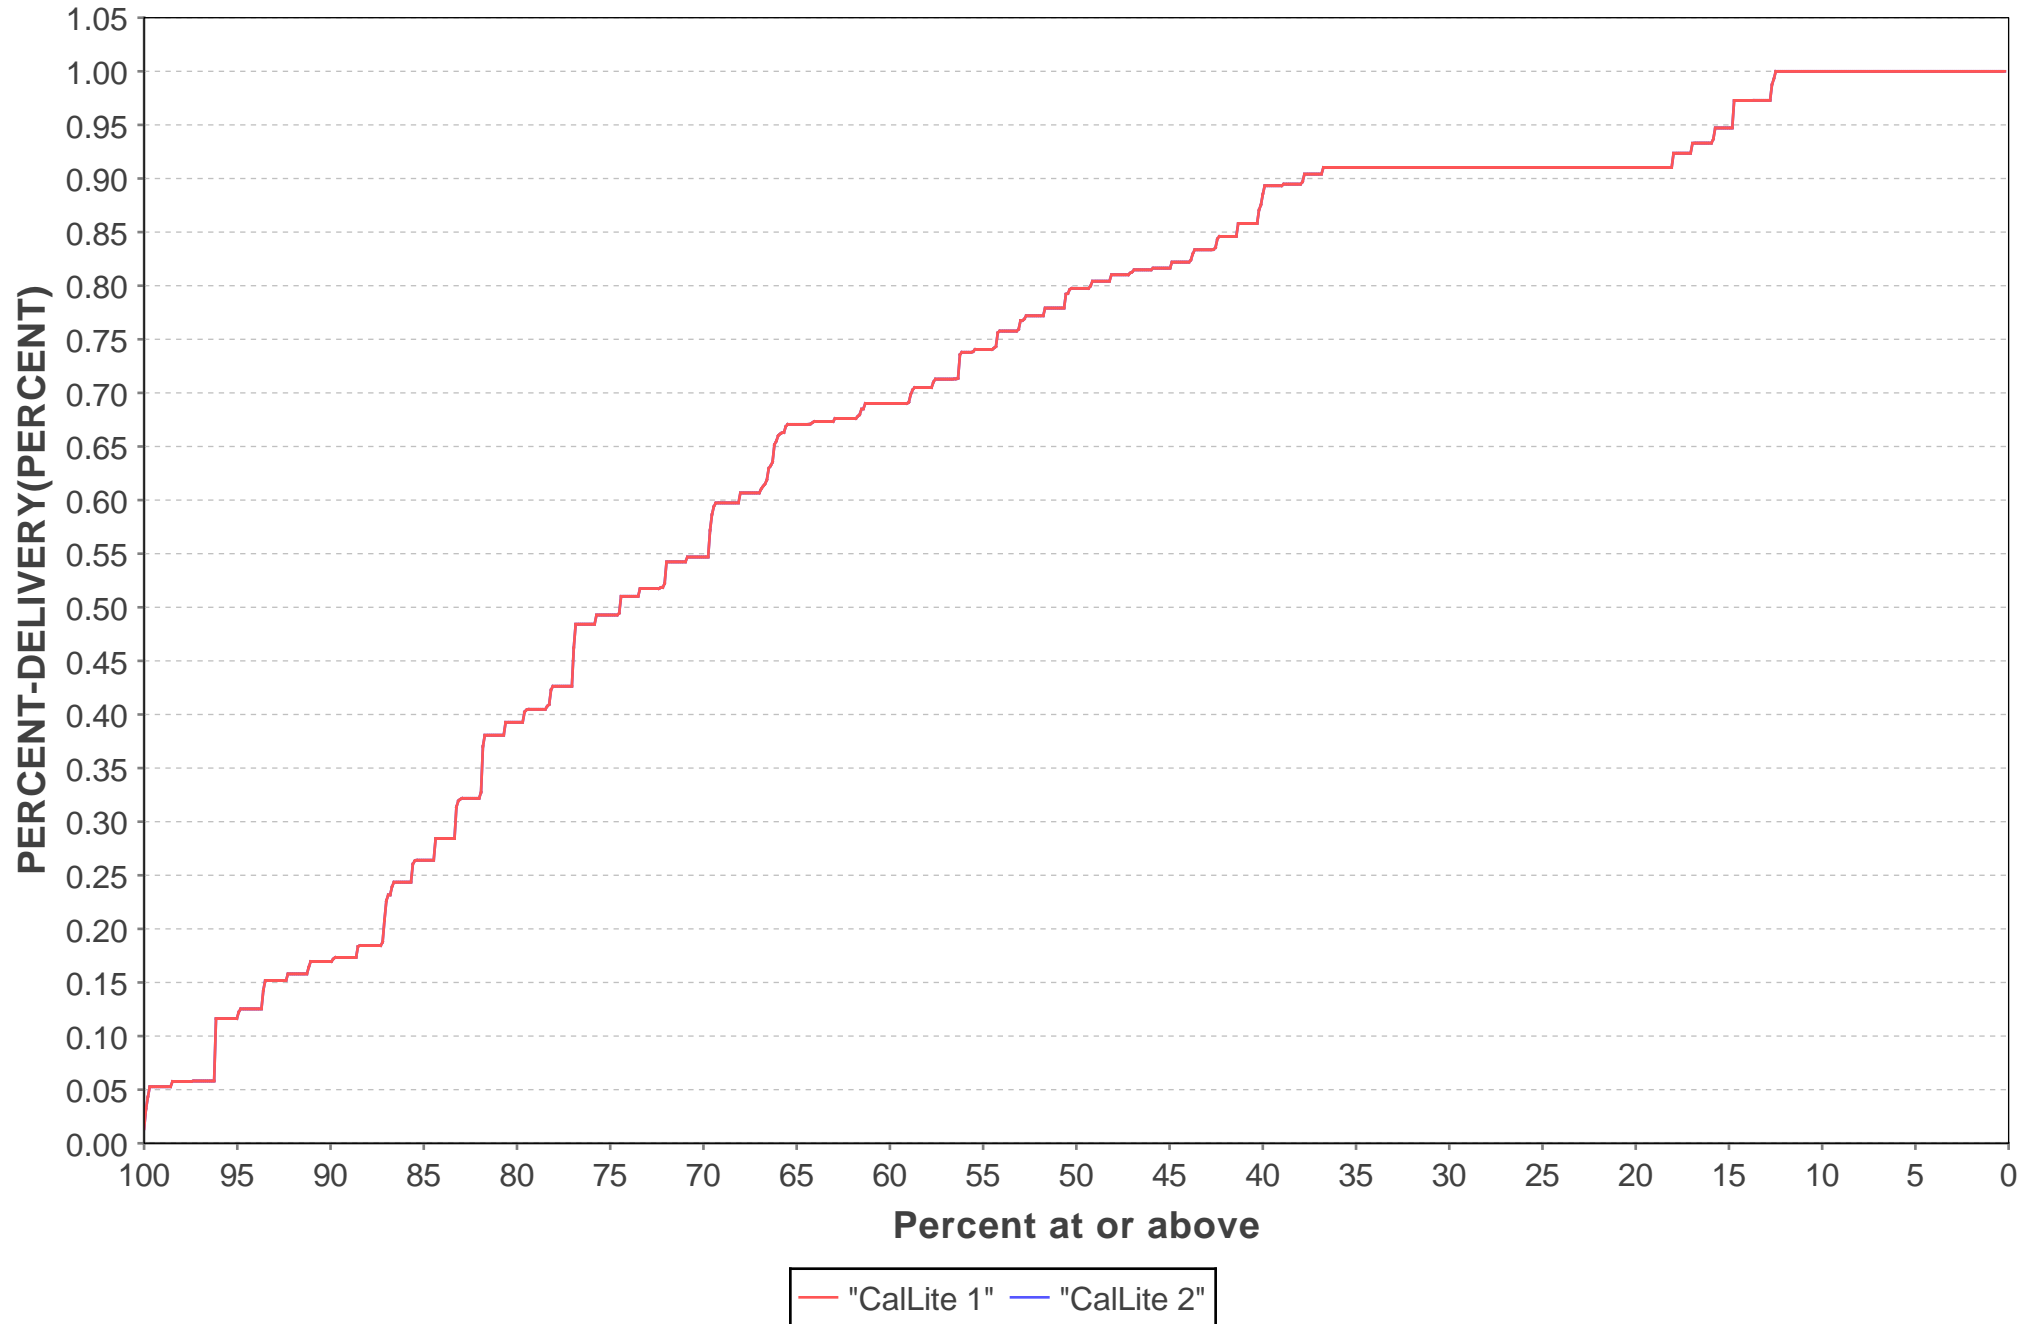

# Average X2 Position

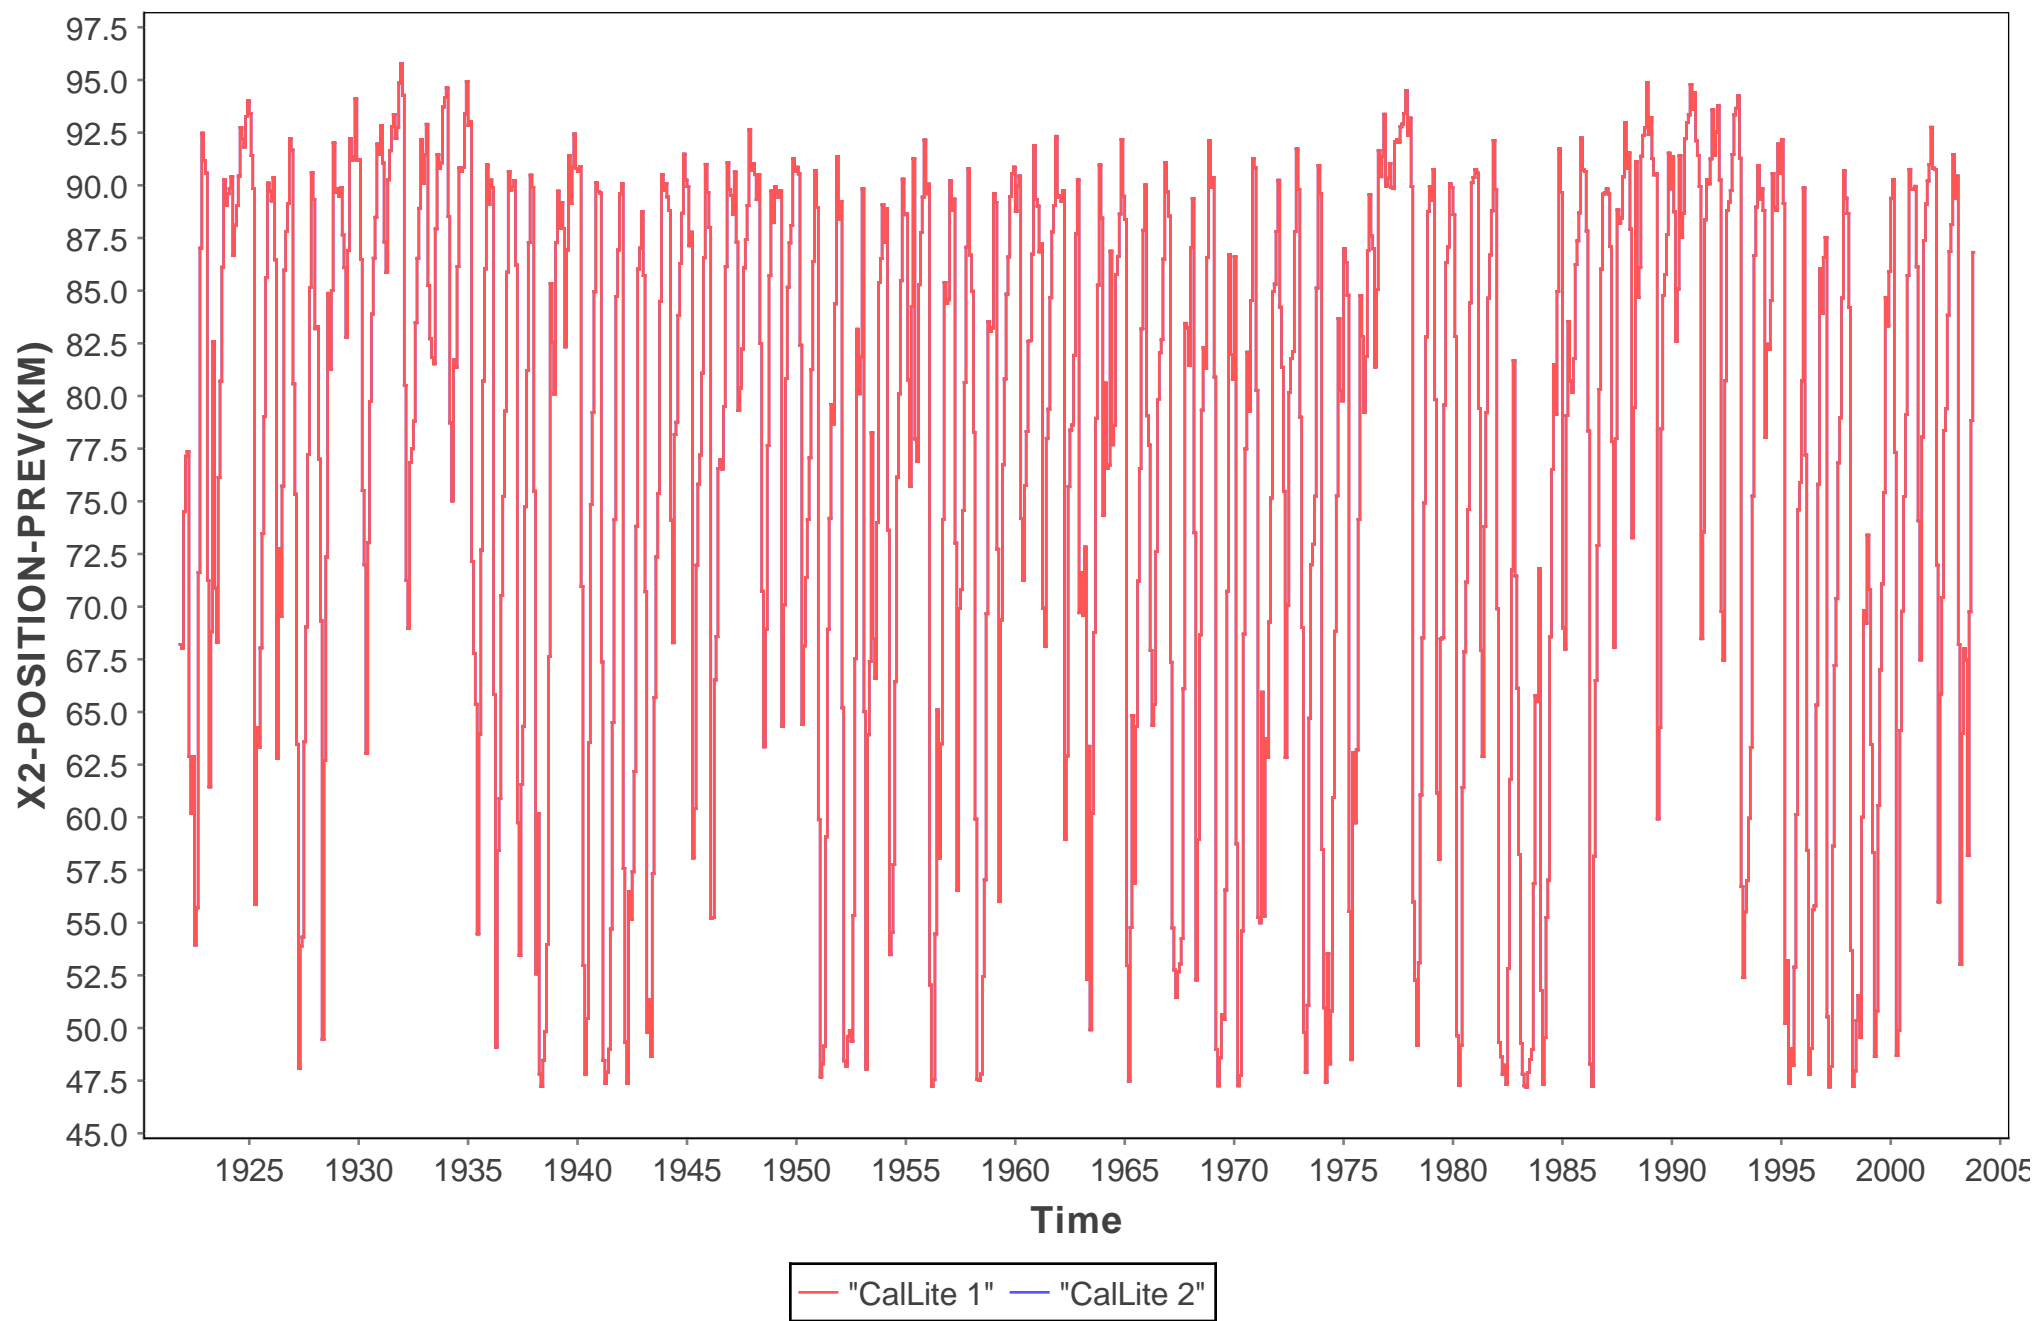

# Average Rock Slough EC

